IP2 Left – DFBXC

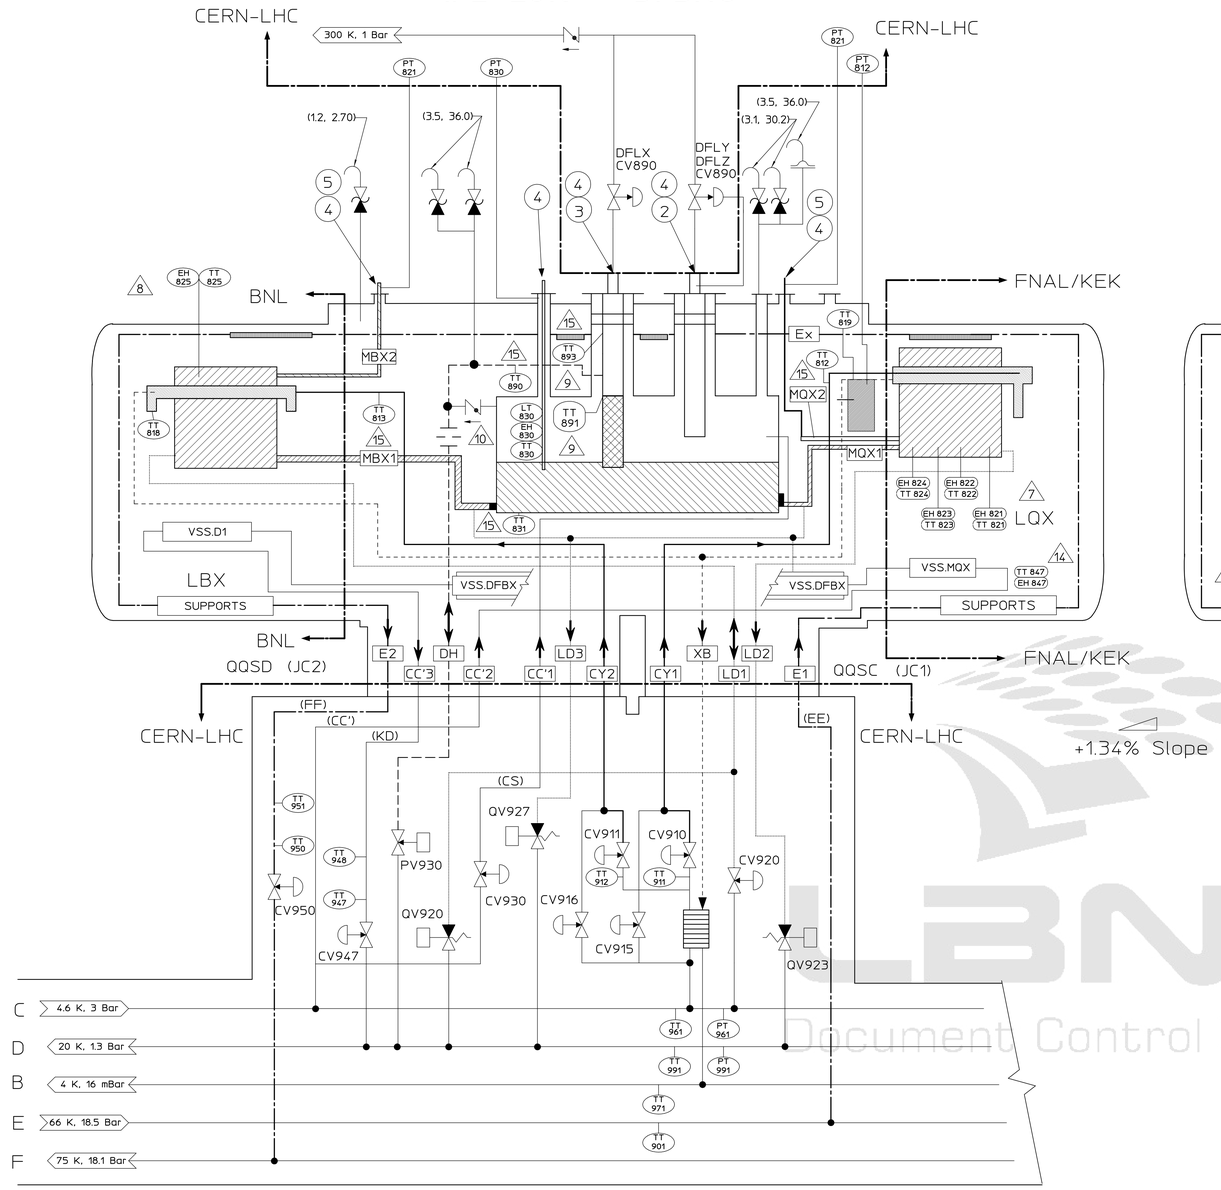

IP2 Right – DFBXD

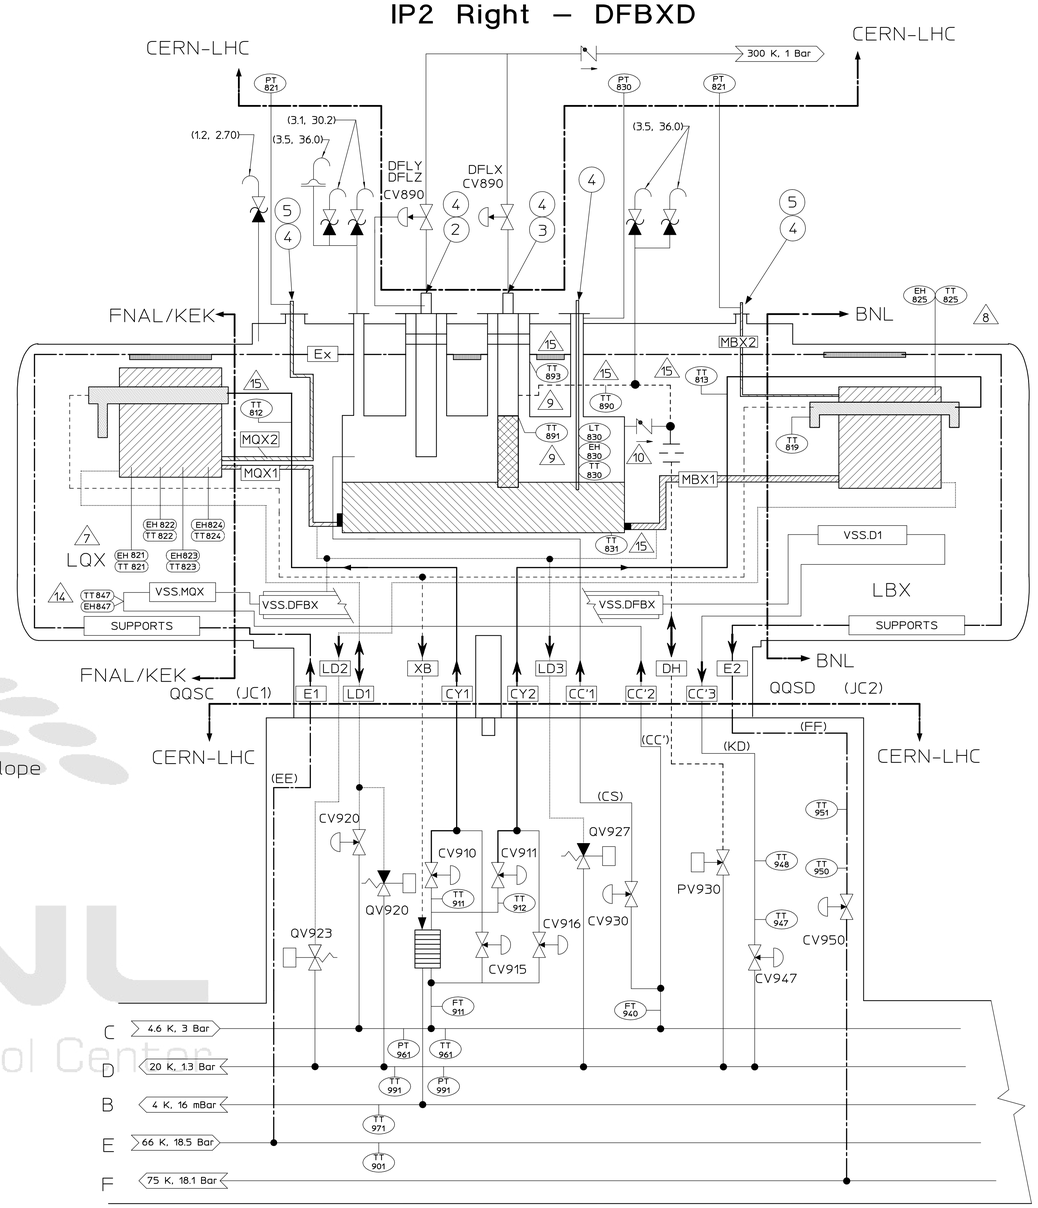

Shield Cooling
HTS Cooling
Cooldown, Quench
4.5 K Cooling
1.9 K Supply
1.9 K Return
XYn Piping Designation
7 *SEE NOTE _* Designation
Interface
CERN-LHC

1.9 K, 16 mBar
1.9 K, 1 Bar
4.5 K, 1.3 Bar
Shield
HTS

1 Conduction Cooled
2 Vapor Cooled
3 MQX, MBX Leads
4 Electrical Signals
5 Q.P. HEATERS
LT Level Sensor
EH Heater
TT Temp Sensor
PT Pressure Sensor
FT Flowmeter

Automatic Control Valve (Fail Closed)
Automatic Control Valve (Fail Open)
Automatic On-Off Valve (Fail Closed)
Relief Valve: Press. setting (bar, psig)
Rupture Disk: Press. setting (bar, psig)
CERN Special Safety Relief Valve
Heat Exchanger
Collection Volume
Check Valve
Orifice

LEGEND

NOTES:
1. HEADER TEMPERATURES AND PRESSURES ARE APPROXIMATE NOMINAL CONDITIONS.
2. INTERFACE BOUNDARIES ARE INDICATED.
3. ALL SENSORS IN LQX AND LBX NOT SHOWN.
4. QRL SENSORS INCLUDED FOR REFERENCE.
5. PIPING DESIGNATIONS PER LHC-Q-ES-0001.00 rev 1.0 SHOWN IN ( ) AS REQUIRED.
6. SAFETY RELIEF DEVICES PER LBNL ENG. NOTE M8054.
7. INSTRUMENTATION IS 2X REDUNDANT AT EACH LOCATION. WIRES CONNECT TO LQX FEEDTHROUGH VIA MQX2 TUBE.
8. INSTRUMENTATION IS 2X REDUNDANT AT EACH LOCATION. WIRES CONNECT TO LBX FEEDTHOUGH VIA MBX2 TUBE.
9. INSTRUMENTATION WIRES IN HTS LEAD FEEDTHROUGH. ONLY TT891 IS 2X REDUNDANT. 6 HTS LEADS PER BOX.
10. INSTRUMENTATION WIRES IN LHE DIAGNOSTIC FEEDTHROUGH 2X REDUNDANT.
11. UNLESS OTHERWISE NOTED, INSTRUMENTATION WIRES IN VACUUM SPACE.
12. VSS INTERCONNECTION HARDWARE PROVIDED BY CERN.
13. RELIEF DEVICE PRESSURE SETTINGS IN BAR (ABSOLUTE)
14. WIRES EXIT AT Q1.
15. SENSOR NOT REDUNDANT.

25H4096

FORMERLY 24C3706-2

FOR CERN USE

REV	DWG	CHK	ZONE	DATE	CHANGES

PART NO. | DESCRIPTION

UNLESS OTHERWISE SPECIFIED
TOLERANCES
THREADS ARE CLASS 2.
CHAMFER ENDS OF ALL SCREW THREADS 30°.
CUT 1.5 PITCH THRD RELIEF WITH ROUND NOSE TOOL ON MACHINE CUT THREADS.
BREAK EDGES .016 MAX. ON MACHINED WORK.
REMOVE BURRS WELD SPLATTER & LOOSE SCALE.
REFERENCES: ANSI Y14.5 & B46.1.

SHOP ORDERS
ACCT. NO. | SERIAL NO.
DATE ISSD. | DATE REQD. | NO. REQD.
DELIVER TO
SURFACE TREATMENT
IDENT. METH.
DWG. BY Y. KAJIYAMA | DATE 23-OCT-02
CHK. BY JON ZBASNIK | DATE 23-OCT-02

LAWRENCE BERKELEY LABORATORY
UNIVERSITY OF CALIFORNIA-BERKELEY
LARGE HADRON COLLIDER, IR FEEDBOX
CRYOGENICS
DFBX IP2 FLOW SCHEMATICS

PATENT CLEAR | DWG. TYPE SCHEMATIC | SHOWN ON | SCALE N/A | DO NOT SCALE PRINTS
MICROFILMED | DESIGN ACCT. NO. Z5LCE6 | CATEGORY CODE LH2003 | DWG. NO. 25H4096 | SIZE | REV.

Officially Released to the LBNL Document Control Center
Released: October 25th, 2002 DCC Auth Key: X1O4LGU2D2
Downloaded by: Daniel Pulsifer at April 10, 2007 08:07:07
AUTO GENERATED PDF – Dec 14 2005 14:59:21 PST