IP5 Left – DFBXE

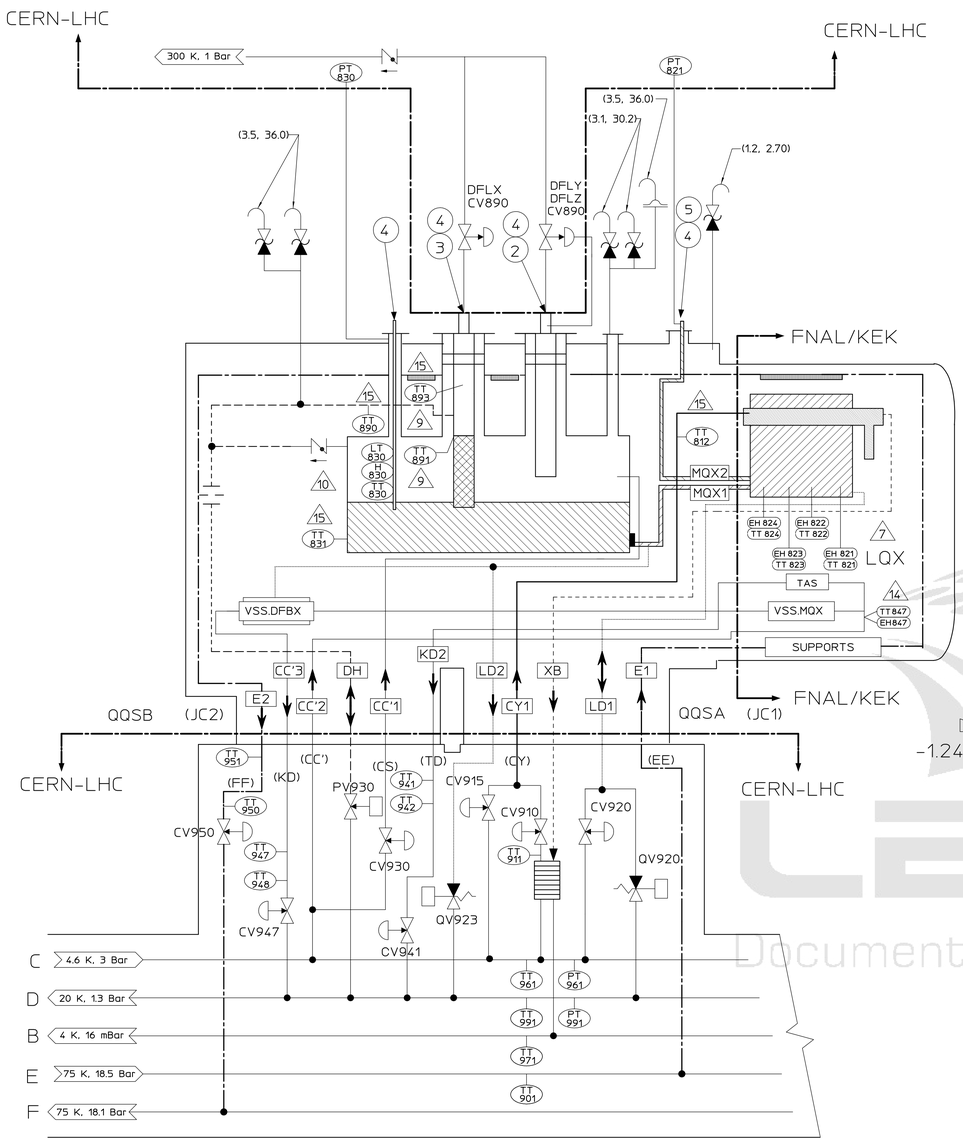

IP5 Right – DFBXF

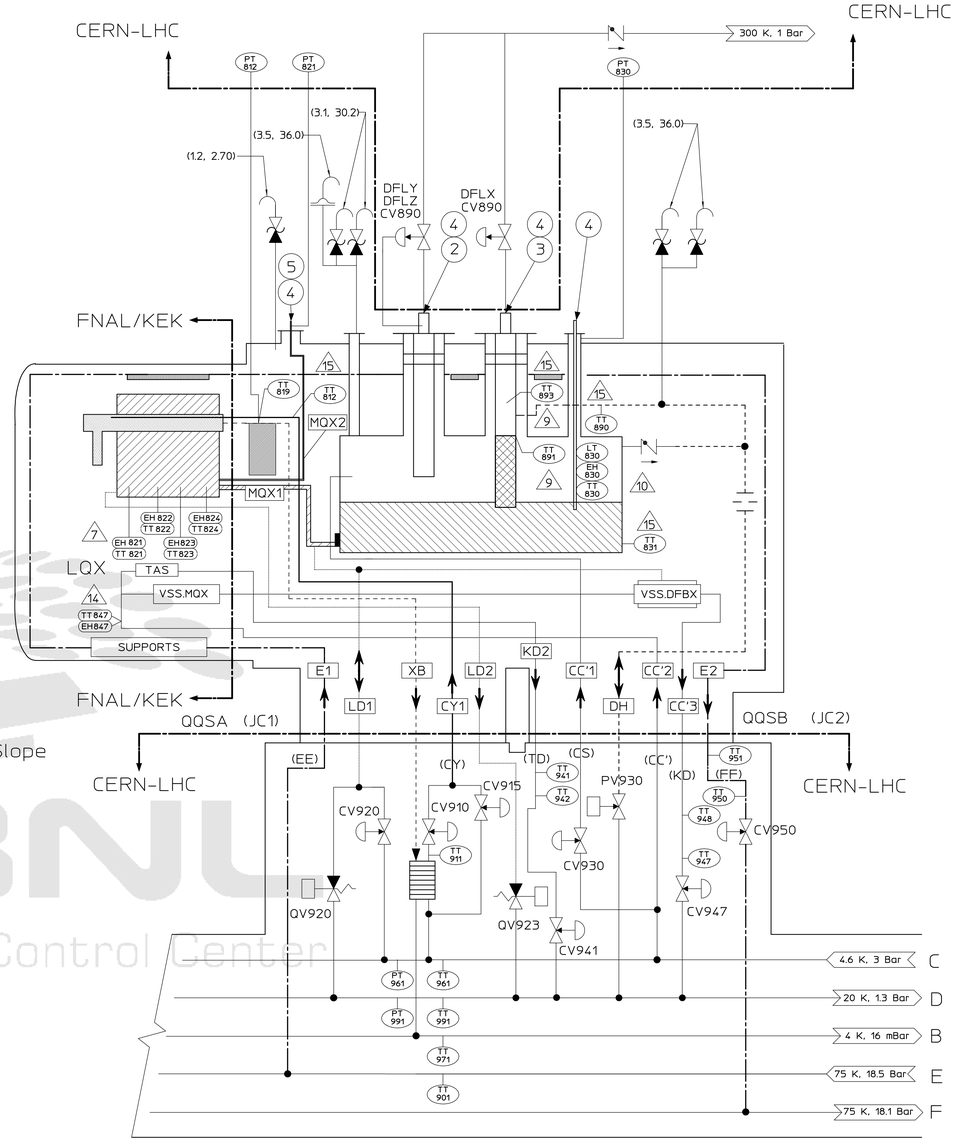

LBNL Document Control Center

25H4116

Shield Cooling
HTS Cooling
Cooldown, Quench
4.5 K Cooling
1.9 K Supply
1.9 K Return
Piping Designation
SEE NOTE _ Designation
Interface
CERN-LHC

1.9 K, 16 mBar
1.9 K, 1 Bar
4.5 K, 1.3 Bar
Shield
HTS

1 Conduction Cooled
2 Vapor Cooled
3 MQX, MBX Leads
4 Electrical Signals
5 Q.P. HEATERS
LT Level Sensor
EH Heater
TT Temp Sensor
PT Pressure Sensor
FT Flowmeter

Automatic Control Valve (Fail Closed)
Automatic Control Valve (Fail Open)
Automatic On-Off Valve (Fail Closed)
Relief Valve: Press. setting (bar, psig)
Rupture Disk: Press. setting (bar, psig)
CERN Special Safety Relief Valve
Heat Exchanger
Collection Volume
Check Valve
Orifice

LEGEND

NOTES:

1. HEADER TEMPERATURES AND PRESSURES ARE APPROXIMATE NOMINAL CONDITIONS.
2. INTERFACE BOUNDARIES ARE INDICATED.
3. ALL SENSORS IN LQX NOT SHOWN.
4. QRL SENSORS INCLUDED FOR REFERENCE.
5. PIPING DESIGNATIONS PER LHC-Q-ES-0001.00 rev 1.0 SHOWN IN ( ) AS REQUIRED.
6. SAFETY RELIEF DEVICES PER LBNL ENG. NOTE M8054.
7. INSTRUMENTATION IS 2X REDUNDANT AT EACH LOCATION. WIRES CONNECT TO LQX FEEDTHROUGH VIA MQX2 TUBE.
8. RESERVED.
9. INSTRUMENTATION WIRES IN HTS LEAD FEEDTHROUGH. ONLY TT891 IS 2X REDUNDANT. 4 HTS LEADS PER BOX.
10. INSTRUMENTATION WIRES IN LHE DIAGNOSTIC FEEDTHROUGH 2X REDUNDANT.
11. UNLESS OTHERWISE NOTED, INSTRUMENTATION WIRES IN VACUUM SPACE.
12. VSS INTERCONNECTION HARDWARE PROVIDED BY CERN.
13. RELIEF DEVICE PRESSURE SETTINGS IN BAR (ABSOLUTE)
14. WIRES EXIT AT Q1.
15. SENSOR NOT REDUNDANT.

FORMERLY 24C3706-4

REV	DWG	CHK	ZONE	DATE	CHANGES

PART NO.	DESCRIPTION

UNLESS OTHERWISE SPECIFIED — TOLERANCES

SHOP ORDERS: ACCT. NO. / SERIAL NO. / DATE ISSD / DATE REQD. / NO. REQD. / DELIVER TO

THREADS ARE CLASS 2. CHAMFER ENDS OF ALL SCREW THREADS 30°. CUT 1.5 PITCH THRD RELIEF WITH ROUND NOSE TOOL ON MACHINE CUT THREADS. BREAK EDGES .016 MAX. ON MACHINED WORK. REMOVE BURRS WELD SPLATTER & LOOSE SCALE. REFERENCES: ANSI Y14.5 & B46.1.

SURFACE TREATMENT / IDENT. METH.

DWG. BY: Y. KAJIYAMA — DATE: 25-OCT-02
CHK. BY: JON ZBASNIK — DATE: 25-OCT-02

LAWRENCE BERKELEY LABORATORY
UNIVERSITY OF CALIFORNIA-BERKELEY
LARGE HADRON COLLIDER, IR FEEDBOX
CRYOGENICS
DFBX IP5 FLOW SCHEMATICS

PATENT CLEAR | DWG. TYPE: SCHEMATIC | SHOWN ON | SCALE: N/A | DO NOT SCALE PRINTS
MICROFILMED | DESIGN ACCT. NO.: Z5LCE6 | CATEGORY CODE: LH2003 | DWG. NO.: 25H4116 | SIZE | REV.

FOR CERN USE

AUTO GENERATED PDF – Dec 14 2005 14:59:54 PST

Officially Released to the LBNL Document Control Center
Released: October 25th, 2002 DCC Auth Key: WSQ6IRT8E
Downloaded by: Daniel Pulsifer at April 10, 2007 08:07:07