

Requested By <i>DAN ARCHER / BOB PATTERSON</i>				Extension <i>2159</i>	Pager <i>56400</i>	Building/Room <i>132 S-2223</i>	TR Number <i>2743</i>
Engineering Safety Note Number <i>MESN 99-020-0A</i>				Job Description <i>8952-81</i>		TR Date <i>5-19-99</i>	
Requested Completion Date				Account Number <i>8960-04</i>			
Type of Request:							
<input type="checkbox"/> Burst <input type="checkbox"/> Leak <input type="checkbox"/> Inspection <input checked="" type="checkbox"/> Proof Test <input type="checkbox"/> Other							
Test Fluid							
<input type="checkbox"/> Water <input type="checkbox"/> Helium <input checked="" type="checkbox"/> Other (Specify) <i>ARGON HIGH PURITY</i>							
Special Conditions		Specify Details		Other Details			
<input type="checkbox"/> Toxic <input type="checkbox"/> Classified		<input type="checkbox"/> Data Acquisition <input type="checkbox"/> LVDT		<i>SEE ESN</i> <i>ULTRA HIGH PURITY</i> <i>SYSTEM 604 PROOF TEST</i>			

I, the requester of this/these test(s), realize that I am responsible for pointing out to the Building 343 Facility Personnel any known or expected hazardous conditions or materials, such as toxic or radioactive components, which could be generated or released during this/these test(s).

Robert B. Patterson
Requester Signature

Charles V. Bonzile
B343 Approval

RESULTS

Pressure tested #2 vessel ME-2285 to 604 psig
1.5 X MAWP (1.5 X 402 psig = 604 psig)

Held for 15 minutes - NO leak noted. Dropped to 150 psig and Snoop Leak check. - NO Leak noted.

Conventional Vacuum Leak Check with leak detector using helium as leak source. Leak check - OK

Vessel #1 Took to 1400 psig & held for seven minutes Found 4 5/8 Flange to be leaking. Recommend putting Grade 8 bolts and nuts on this flange also. This vessel should be good for 900 ~~MAWP~~ per Chuck Bonzile. Vessel #1 Rechecked with Grade 8 Bolt + nuts Held pressure no leak Reduced to 150 psig and checked with Snoop no leaks found

Estimate of Time Charges	Estimate By	Total Time Charged	Work Performed By <i>A. Suarez & V. Switzer</i>
--------------------------	-------------	--------------------	--

3 PAGES

Maintain Systems and Vessels

General Information (Format - Dates: MM/DD/YYYY ; Names: Last name, First name)

ME Test No	2286	RD No	
		Temp	
MAWP	150	PSIG	From 40 To 70 F
Status	Oper Mode Config	As of Date	As per Person
IN USE	Manned Vessel		
Inspector - Cert	FAIRCHILD, RICHARD F 002976	Insp - Trainee	Please specify
System Fluid	Helium		
Device Owner	002678 9	Designer	DOBIE D.
	HEFFNER, MICHAEL D 90		
	Ex: LASTNAME, FIRSTNAME		

P/R # Please specify

Inspection Date	12/13/2006	Test Date	12/13/2006
Inspection Freq	3 years	Test Freq	6 years
Expiration Date	12/13/2009		
Safety Document		Secondary Safety Document	
MESN	01-091-OA		

Location	Facility	Room
LLNL	194A 90	1131
AD		PAD
Department	Name not found	
Division	Name not found	
Assurance Manager	THOMSON, STEPHEN B	FPOC Alternate
		SPRINGER, MICHAEL B
Facility Contact	LIND, SUSAN G	FPOC Exception
		Name Not Found

Description (also appears on label)	Comments
"Main pressure vessel #1 (AAA98-104242, weld flange). Derated vessels on 8/31/01 to 150psig. Vessel feed thrus will not have blast covers. Vessel will expire on original expiration date of 6/01/02. Stored in place as per Bob Foerschler 8/12/03"	This system was retested on 12/13/2006 to 225 for helium only at 130 PSIG .RF. Have tested an add on cone and flang it was tested at 343 by RF on 3/5/07.

Save

Assign RD(s)

Print Labels

View Test Insp

New Test Insp

Copy

Maintain PTRS Tests and Inspections

Test Information (Dates should be in the format MM/DD/YYYY)

ME Test No 2286 Date 12/13/2006

Test Request No TR-4191 Test Fluid Helium

Test Pressure 225 PSIG Test Temp 70 F

Size Measurements (pressure vessel tests ONLY) Test Comments

Location (marked)	Before Test (inches)	After Test (inches)	Difference (inches)	This system was tested to 225PSIG with Helium and will be used with He only at 130 PSIG.
Top				
Center				
Bottom				

Inspection Information

Inspect the following and check the appropriate column, explaining as required. Status is OK or Not Applicable

Question OK N/A Remarks

1. General appearance of system (or vessel) ☒ ☐
2. Relief devices are: ☒ ☐
- a) properly set (have them checked - reset as required)
- b) properly seated ☒ ☐
- c) pointed in safe direction or safely vented ☒ ☐
3. All fittings and vessel seals are leak tight ☒ ☐
4. Replaced or added fittings, gauges, valves (and piping*) are properly rated ☒ ☐
5. All system components are adequately secured ☒ ☐
6. Valve packing nuts are tight and locked (if locking type) ☐ ☒ N/A
7. Oil is not apparent on or in* gas (especially oxygen) systems ☒ ☐
8. The outside surface of the vessel shows no evidence of strain, damage or corrosion. ☒ ☐
9. The inside surface of the vessel shows no evidence of strain, damage or corrosion. ☒ ☐
10. Lined vessel vent path is unobstructed: check with helium ☐ ☒ N/A
11. Vessel or system seals are leak-tight. Have replaced as required ☒ ☐
12. The vessel or system is safe for continuing operation ☒ ☐
13. Vessel or system was pressure tested within the last 6 years, or as required by the safety note. If not, and certified for manned area operation, retest it and submit a Pressure Test Record. ☒ ☐

* consider assurance by the responsible user as satisfactory verification

This data applies to a ☒ Test ☐ Inspection Only FAIRCHILD, RICHARD F 002976

LL3586 (Feb.2000); Send this completed form to the LLNL Pressure Inspector at L-383

Save

Go to Sys/Vess

Print Labels

Copy Test/Insp

Cancel

Maintain Relief Devices

General Information (Format - Dates: MM/DD/YYYY ; Names: Last name, First name)

RD Number	6224	ME #	
MAWP	151	PSIG	
Status	DELETED	Deleted as of	Deleted per Person
		03/01/2010	CARTER, DARRELL D
Inspector	FAIRCHILD, RICHARD F 002976		
System Fluid	Helium		
Device Owner	141683		
	CARTER, DARRELL D		
	Ex: LASTNAME, FIRSTNAME		
Inspection Date (MM/DD/YYYY)	12/11/2006		
Inspection Freq	3 years		
Expiration Date	12/11/2009		
P/R #	9785 - ST-TRED-TECHNOLOGY RESOURCES ENGINEERING		
Safety Document	Secondary Safety Document		
	N/A		
Location	Facility	Room	
LLNL	194A	1131	
AD	ST-ENGR-ENGINEERING	PAD	ST-ST PAD-SCIENC TECHNOLOGY
Department	Name not found		
Division	ST-TRED-TECHNOLOGY RESOURCES ENGINEERING		
Assurance Manager	THOMSON, STEPHEN B	FPOC Alternate	SPRINGER, MICHAEL
Facility Contact	LIND, SUSAN G	FPOC Exception	Name Not Found
Comments			

Save

Copy

Cancel

Maintain PTRS Tests and Inspections

Test Information (Dates should be in the format MM/DD/YYYY)

ME Test No 2356 Date 12/03/1999

Test Request No TR-2833 Test Fluid Argon

Test Pressure 604 PSIG Test Temp 70 F

Size Measurements (pressure vessel tests ONLY) Test Comments

Location (marked)	Before Test (inches)	After Test (inches)	Difference (inches)	RD 6901 and RD 7319 have a 402 PSIG MAWP and will be used with pressure vessels #1 and # 2. Used with ME2349, ME2350, ME2351, ME2352, and ME2353. 2 Flanges were made under the same drawing number Modified Test temp -320
Top				
Center				
Bottom				

Inspection Information

Inspect the following and check the appropriate column, explaining as required. Status is OK or Not Applicable

Question	OK	N/A	Remarks
1. General appearance of system (or vessel)	<input checked="" type="radio"/>	<input type="radio"/>	
2. Relief devices are:	<input checked="" type="radio"/>	<input type="radio"/>	
a) properly set (have them checked - reset as required)	<input checked="" type="radio"/>	<input type="radio"/>	
b) properly seated	<input checked="" type="radio"/>	<input type="radio"/>	
c) pointed in safe direction or safely vented	<input checked="" type="radio"/>	<input type="radio"/>	
3. All fittings and vessel seals are leak tight	<input checked="" type="radio"/>	<input type="radio"/>	
4. Replaced or added fittings, gauges, valves (and piping*) are properly rated	<input checked="" type="radio"/>	<input type="radio"/>	
5. All system components are adequately secured	<input checked="" type="radio"/>	<input type="radio"/>	
6. Valve packing nuts are tight and locked (if locking type)	<input type="radio"/>	<input checked="" type="radio"/>	N/A
7. Oil is not apparent on or in* gas (especially oxygen) systems	<input checked="" type="radio"/>	<input type="radio"/>	
8. The outside surface of the vessel shows no evidence of strain, damage or corrosion.	<input checked="" type="radio"/>	<input type="radio"/>	
9. The inside surface of the vessel shows no evidence of strain, damage or corrosion.	<input checked="" type="radio"/>	<input type="radio"/>	
10. Lined vessel vent path is unobstructed: check with helium	<input type="radio"/>	<input checked="" type="radio"/>	N/A
11. Vessel or system seals are leak-tight. Have replaced as required	<input checked="" type="radio"/>	<input type="radio"/>	
12. The vessel or system is safe for continuing operation	<input checked="" type="radio"/>	<input type="radio"/>	
13. Vessel or system was pressure tested within the last 6 years, or as required by the safety note. If not, and certified for manned area operation, retest it and submit a Pressure Test Record.	<input checked="" type="radio"/>	<input type="radio"/>	

* consider assurance by the responsible user as satisfactory verification




















This data applies to a ☐ Test ☐ Inspection Only JUAREZ, ALBERT 454886

LL3586 (Feb.2000); Send this completed form to the LLNL Pressure Inspector at L-383

Save	Go to Sys/Vess	Print Labels	Copy Test/Insp	Cancel
------	----------------	--------------	----------------	--------

Maintain Systems and Vessels

General Information (Format - Dates: MM/DD/YYYY ; Names: Last name, First name)

ME Test No	2356	RD No	
MAWP	402 PSIG 	Temp	
		From -320 To 70 F 	
Status	Oper Mode Config	Stored as of	Stored per Person
STORED 	Manned  Vessel 	09/17/2004	DATA MIGRATION - M
Inspector - Cert	JUAREZ, ALBERT 454886 	Insp - Trainee	Please specify 
System Fluid	Ar/CH4/CO2/He/P10/Xe 		
Device Owner	002103 	Designer	DOBIE D.
	SPRINGER, MICHAEL B  		
	Ex: LASTNAME, FIRSTNAME		
P/R #	Please specify 		
Inspection Date	12/03/1999	Test Date	12/03/1999
Inspection Freq	3 years 	Test Freq	6 years 
Expiration Date	12/03/2002		
Safety Document		Secondary Safety Document	
MESN 	99-020-OA		
Location	Facility	Room	
LLNL 	132S  	2723	
AD		PAD	
Department	Name not found		
Division	Name not found		
Assurance Manager	THOMSON, STEPHEN B	FPOC Alternate	GOVERNOR, EDWARD J
Facility Contact	MCANENEY, GERALD P	FPOC Exception	Name Not Found
Description (also appears on label)	Comments		

"Flange, 350 MOP, CF type head,
AAA98-104240-00 Stored in place
as per Bob Foerschler 8/12/03"

Save

Assign RD(s)

Print Labels

View Test Insp

New Test Insp

Copy

Cancel

Maintain PTRS Tests and Inspections

Test Information (Dates should be in the format MM/DD/YYYY)

ME Test No 2285 Date 03/05/2010

Test Request No 1458 Test Fluid Helium

Test Pressure 225 PSIG Test Temp 70 F

Size Measurements (pressure vessel tests ONLY) Test Comments

Location (marked)	Before Test (inches)	After Test (inches)	Difference (inches)	This system was tested to 225 PSIG with helium to be used with helium only at 130PSIG.
Top				
Center				
Bottom				

Inspection Information

Inspect the following and check the appropriate column, explaining as required. Status is OK or Not Applicable

Question	OK	N/A	Remarks
1. General appearance of system (or vessel)	<input checked="" type="radio"/>	<input type="radio"/>	
2. Relief devices are:	<input checked="" type="radio"/>	<input type="radio"/>	6262
a) properly set (have them checked - reset as required)	<input checked="" type="radio"/>	<input type="radio"/>	
b) properly seated	<input checked="" type="radio"/>	<input type="radio"/>	
c) pointed in safe direction or safely vented	<input checked="" type="radio"/>	<input type="radio"/>	
3. All fittings and vessel seals are leak tight	<input checked="" type="radio"/>	<input type="radio"/>	
4. Replaced or added fittings, gauges, valves (and piping*) are properly rated	<input checked="" type="radio"/>	<input type="radio"/>	
5. All system components are adequately secured	<input checked="" type="radio"/>	<input type="radio"/>	
6. Valve packing nuts are tight and locked (if locking type)	<input type="radio"/>	<input checked="" type="radio"/>	N/A
7. Oil is not apparent on or in* gas (especially oxygen) systems	<input checked="" type="radio"/>	<input type="radio"/>	
8. The outside surface of the vessel shows no evidence of strain, damage or corrosion.	<input checked="" type="radio"/>	<input type="radio"/>	
9. The inside surface of the vessel shows no evidence of strain, damage or corrosion.	<input checked="" type="radio"/>	<input type="radio"/>	
10. Lined vessel vent path is unobstructed: check with helium	<input type="radio"/>	<input checked="" type="radio"/>	N/A
11. Vessel or system seals are leak-tight. Have replaced as required	<input checked="" type="radio"/>	<input type="radio"/>	
12. The vessel or system is safe for continuing operation	<input checked="" type="radio"/>	<input type="radio"/>	
13. Vessel or system was pressure tested within the last 6 years, or as required by the safety note. If not, and certified for manned area operation, retest it and submit a Pressure Test Record.	<input checked="" type="radio"/>	<input type="radio"/>	

* consider assurance by the responsible user as satisfactory verification

This data applies to a ☐ Test ☒ Inspection Only SWITZER, VERNON A 876136

LL3586 (Feb.2000); Send this completed form to the LLNL Pressure Inspector at L-383

Maintain Systems and Vessels



General Information (Format - Dates: MM/DD/YYYY ; Names: Last name, First name)

ME Test No	2285	RD No	6262
MAWP	150 PSIG	Temp	
		From 40 To 70 F	
Status	Oper Mode Config	As of Date	As per Person
IN USE	Manned Vessel		
Inspector - Cert	SWITZER, VERNON A 876136	Insp - Trainee	Please specify
System Fluid	Helium		
Device Owner	002678	Designer	DOBIE D.
	HEFFNER, MICHAEL D		
	Ex: LASTNAME, FIRSTNAME		
P/R #	9785 - ST-TRED-TECHNOLOGY RESOURCES ENGINEERING		
Inspection Date	03/05/2010	Test Date	12/13/2006
Inspection Freq	3 years	Test Freq	6 years
Expiration Date	03/05/2013		
Safety Document	Secondary Safety Document		
MESN	01-091-OA		
Location	Facility	Room	
LLNL	194A	1131	
AD	ST-ENGR-ENGINEERING	PAD	ST-ST PAD-SCIENCE, TECHNOLOGY
Department	Name not found		
Division	ST-TRED-TECHNOLOGY RESOURCES ENGINEERING		
Assurance Manager	THOMSON, STEPHEN B	FPOC Alternate	SPRINGER, MICHAEL B
Facility Contact	LIND, SUSAN G	FPOC Exception	Name Not Found
Description (also appears on label)	Comments		

Pressure vessel #2. Derated
vessels on 8/31/01 to 150psig.
Vessel feed thrus will not have
blast covers. Vessel will expire
on original experation date of
6/01/02. Stored in place as per
Bob Foerschler 8/12/03

This system was tested on
12/13/2006 to 225PSIG with Heluim
for use with He only at 130PSIG
.RF Have tested an add on
cone and flang it was tested at
343 by RF on 3/5/07.


*New Technologies Engineering Division*

Mechanical Engineering Safety Note


Time Projection Chamber

MESN99-020-OA


April 26, 1999

Prepared By: 
Douglas Dobie, Mechanical Engineer, Pressure Consultant

Reviewed By: 
Robert Patterson, Engineer Technical Associate

Reviewed By: 
Terry Alger, Mechanical Engineer

Approved By: 
Satish Kulkarni, NTED Division Leader

Reviewed By: 
Knud Pedersen, Pressure Consultant

Distribution:

T. Alger	L-045	High Pressure Lab	L-384
D. Dobie	L-142	Eng. Records Ctr.	L-118
S. Kulkarni	L-113		
R. Patterson	L-171		
E. See	L-186		
D. Archer	L-188		

Contents

A.	Description.....	3
B.	Operational Hazards	5
C.	Procedures.....	5
D.	Calculations.....	5
	Vessel.....	6
	Head / Flange Calculations	7
	Fracture Critical Components	11
	Fragment Hazard Mitigation.....	12
E.	Testing Requirements	13
F.	Labeling Requirements	13
G.	Associated Procedures.....	15
H.	References and Notes	15
	APPENDIX A: PROOF TESTING PROCEDURE FOR THE TPC	16
	APPENDIX B DRAWINGS	20
	APPENDIX C CALCULATIONS	33

A. Description

This safety note covers the design of time projection chambers (TPC) used in a full volume imaging detector. The chambers are used in building 132N, room 2723. There are three parts to the full volume imaging detector system. The first part is the gas purification subsystem that is used to purify and deliver electronegative free (99.9999999%) gas. This part of the system is being built commercially by Insync Systems. The second part of the system, designed and built at LLNL, includes the time projection chambers (TPC) where the experiments will be performed. Gas, from the purification panel, feeds the TPC's that will nominally operate at 300 psig but are being designed for 350 psig maximum operating pressure (MOP). It will be necessary to work around the TPC's with radioactive sealed sources for testing and calibration; thus this is a manned operation. The third part of the system uses cylinders to reclaim the purified gas. These cylinders have been fabricated by ACME CRYOGENICS INC. and are rated by them at 3000 psig MAWP. Gas will be transferred in the TPC system by thermal cycles, using LN2 to create the temperature gradient inside the chamber via conduction through the walls of the cryogenic thimble. A certain percentage of alcohol may be used in the LN2 bath to move the temperature of the bath above 73K.

The TPC's are the experimental chambers designed at LLNL. These chambers are used for two purposes but were mechanically designed to be identical. The first chamber will be used as an ionization chamber where electron drift will be used as a measure of gas purity. The second chamber is the actual TPC itself, which is used for position sensitive readout of electron clouds and hence gamma ray imaging. Figure 1 depicts a TPC with its associated hardware. In the experimental setup, the chambers are connected together with high pressure tubing. The chambers have been designed to allow a 400 keV gamma ray to penetrate the chamber wall in well-defined places, specifically in the center of the 2 3/4 inch conflat flange and in a linear series of VCR blanks on the side of the chamber. It will be necessary to use radioactive sources in conjunction with these windows to probe the capabilities of the chamber. The 1 3/4 inch conflat flanges has been outfitted with a high voltage (20 kV) ceramic feedthrough from Ceramaseal. Many of the penetrations into the chamber and the internals of the chamber are attached to the conflat gasketed chamber head to allow easy removal from the chamber body. The chambers will be filled with a gas (Ar, Xe, along with at least one the following: CH4, CO2, and P10) using the 135psi gas purification system and then condensed by cooling the chamber using a cryogenic thimble. LN2 will envelope the outside of the thimble creating non-uniform thermal stresses along with membrane stress throughout the vessel.

This ME Safety Note is required because the TPC of the system contains compressed gas at pressures exceeding 150 psig or 100kJ of stored energy. This Safety Note covers the vessel depicted in Figure 1 up to and including the output connections. If required, a separate safety note will cover the remaining parts of full volume imaging detector system less the TCP's.

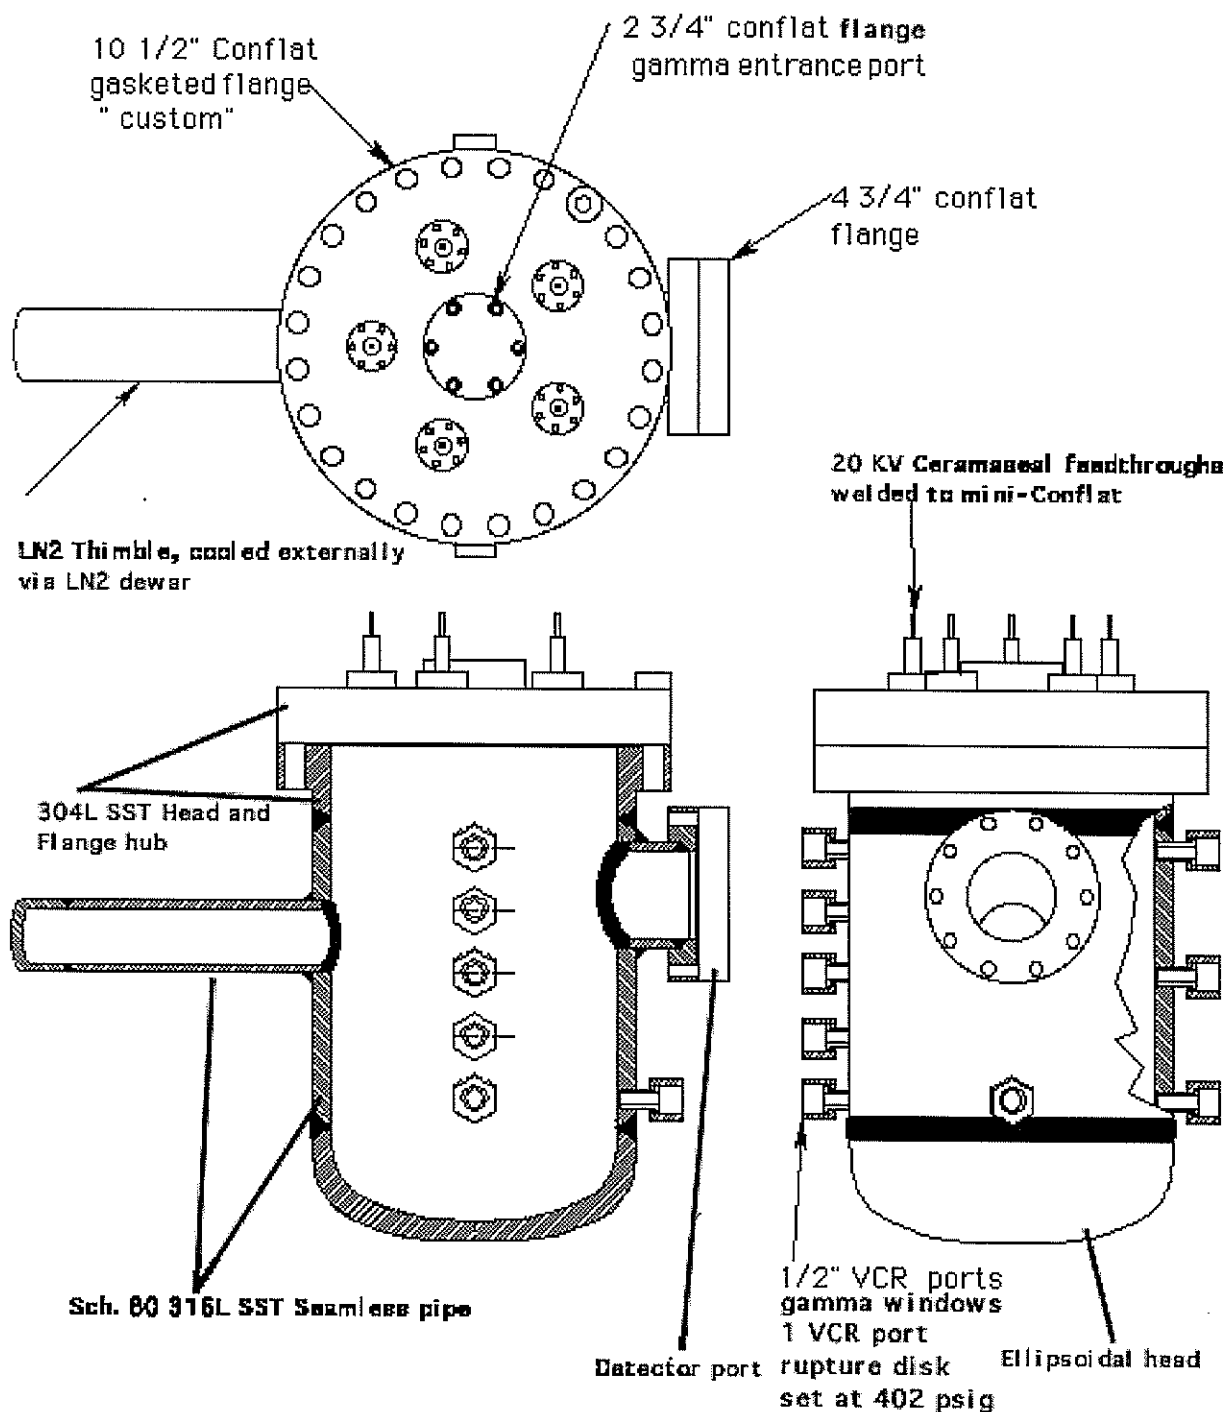


Figure 1 – Diagram of the Time Projection Chambers (TPC)

B. Operational Hazards

Associated hazards are those typical of any high pressure gas system. Failure of a vessel or component could result in either shrapnel or a blast overpressure to the body. Since the gases involved are not air, there is also the potential concern of asphyxiation. Other hazards include physical exposure to the radioactive sealed source and cold temperatures. The hazards other than those associated with the pressure vessel will be addressed by the FSP (if applicable) or separate OSP for this experiment.

C. Procedures

Design safety factors are robust for all intended pressures. The system is adequately protected by a pressure relief device at a VCR port so that components cannot be over-pressurized. This document also specifies shielding requirements for personnel protection from shrapnel in the event of an accident. However, an OSP for this experiment will address associated interlocks and operational steps required during pressurization.

D. Calculations

The following will certify the TPC for this system:

[1] Hardware and Fabrication

The vessel is fabricated using commercially purchased metals. Fabrication and joining techniques are also standard technology. Welding was performed by LLNL ASME certified welders experienced in pressure systems.

[2] Engineered Design

The system design has relief devices at strategic locations (a VCR fitting) to insure that the MAWP's are never exceeded.

An evaluation of high risk pressure components indicated that a Ceramaseal feed-through may fail if improperly handled. Specifically, the weld joint at the Conflat is susceptible to bending and fracture. To minimize this risk, a fragment deflector/stop fixture was designed and will be mounted in front of the head where the Ceramaseal is mounted. A Kevlar drape will also be employed if this device fails to capture all fragments. This stop and Kevlar drape will be interlocked during pressure vessel operation.

[3] Testing

Detailed proof testing procedures at 1.5 times MAWP and at the working temperature, induced by LN2 cooling, have been developed and are enclosed as Appendix A. Successful completion of these procedures by a LLNL pressure inspector will complete the certification of the TPC's. Proof testing is the crux of pressure vessel qualification for fracture critical components and is best stated from literature⁵ as follows:

"The critical flaw size associated with proof test conditions can also be used for life expectance considerations. Specifically, if a pressure vessel survives a given proof test it can be concluded that the largest defect present in the structure is smaller than the critical flaw size at the proof test conditions. Therefore, in the absence of non-destructive inspection, this flaw size can be considered the existing flaw size at the beginning of life at the operating conditions and would, in turn, serve as the basis for further crack growth consideration"⁵ (also see fracture analysis below).

The vessel has been designed to meet ASME Boiler and Pressure Vessel Code design guidelines. Stresses are low enough to eliminate the need for impact testing of the material in the heat effected zones created by the butt welds, UHA-51 (g) (see misc.nb calculations in Appendix C). The ASME Code also exempt austenitic, chromium-nickel stainless steels from impact testing, UHA-51(d)(1)(a). Thus, the base materials 304L and 316L are exempt.

[4] Calculations

Most calculations were done using ASME Pressure Vessel Code, Section VIII, Division 1 guidelines. The TPC has a MAWP of 978 psig when using the C-Ring type head (no openings) and 402 psig for the Conflat type head(s) (with and without openings). A future addendum to this safety note will cover a head (with openings) to be used at 978 psig MAWP. The allowable stresses used in all calculations are based on values found in the ASME Pressure Vessel Code, Section II. *For both 316L and 304L the allowable stress is 16,700 psi which provides a nominal Safety Factor of ~5 in all Pressure Vessel Code calculations (i.e., head thickness, maximum vessel pressure, minimum wall thickness, etc).* The following tables are summaries of the detailed calculations found in Appendix A.

Vessel

The energy in each pressure vessel was calculated to be 55, 852 ft-lb. or 16.4 g TNT at the MAWP of 978 psig. The following table summarizes the analytical results for the main 8 inch schedule 80 pressure vessel, the detector pipe, the VCR "Cajon" fittings/ pipes, and the LN₂ pipe connected to the main vessel. All tubing is 316L. Calculations were made at a MAWP of 978 psig. The last column refers to the ratio of yield stress (37ksi) to Von Mises stress at the test pressure of 1.5 x MAWP. Values must be greater than 1.0 for a safe proof test.

	S1 (psi)	S2 (psi)	S3 (psi)	Von Mises (psi)	Required wall thickness (in)	Actual wall thickness (in)	If ≥ 1.0 stress less than yield for 1.5xMAWP
Main 8" vessel	3499	7976	-978	7755	0.336	0.500	3.2
Detector pipe 2.87 OD	1839	4657	-978	4880	0.102	0.275	5.1

VCR pipe 0.5" OD	1739	4455	-978	4705	0.012	0.050	5.2
LN2 pipe 1.9" OD	1618	4214	-978	4496	0.066	0.200	5.5

Analytical results for welds, area reinforcement, and their related loads that attach the detector pipe, LN₂ pipe, and VCR pipe to the main vessel shell are detailed in the table below at a MAWP of 978 psig. Generally, if the nozzle and fillet weld load paths are greater than the total weld load, then the strengths are sufficient. The total weld load ($W \sim (\text{Area required} - \text{Area available}) * \text{Allowable stress}$) for the VCR pipe is less than 0 because the vessel wall is 0.160" thicker than required creating much more area available than required. Thus, the area available is greater than the area removed and a negative number results.

	Area of mat'l. required (in ²)	Area of mat'l. avail. (in ²)	Total weld load (lb)	Nozzle wall load path (lb)	Fillet weld load path (lb)
Detector pipe	0.780	0.800	8172	13172	12749
LN ₂ pipe	0.504	0.508	5396	6243	6106
VCR pipe	0.134	0.194	< 0	413	402

The butt welds connecting the hub to the main vessel and the ellipsoidal head to the main vessel, the ellipsoidal head on liquid nitrogen pipe, and the hub to the detector pipe, reduced the allowable working pressure in the vessel they are connected to by 'E' (butt weld efficiency). An 'E' of 0.7 was used for these welds which reduced their associated allowable working pressures to 1421 psig, 6979 psig, and 6139 psig for the of the main vessel, LN pipe, and detector pipe respectively. Again, all of these calculated pressures use an allowable stress of 16,700 psi which has a nominal SF = 5.0 so an additional SF of 1.5 (1421 / 978) is obtained. Using a butt weld efficiency of 0.7 allows no radiography to be performed on the welds according to the ASME Boiler and Pressure Codes.

The VCR, LN₂, and detector port openings in the vessel shell are mounted 90° to each other. The radial distance between hole centers is approximately 6.0 inches. ASME Boiler Code requires that all openings be less than the sum of their respective diameters. The maximum sum of the diameters is 3.37 inches between LN₂ and the detector port.

Holes that do not penetrate the vessel shell may be required to horizontally mount the vessel. The depth of tapped 1/4-20 holes and 3/8-16 holes shall be ≤ 0.25 inches. Holes can not be placed near other openings or reinforcements.

Head / Flange Calculations

The following table summarizes the analytical results for the integral flange butt welded to the main access port and the small flange butt welded on the side of the

vessel (detector port). Again, the allowable stress is 16,700 psi for the base material. Also, the ASME allowable hub stress is 1.5 times the allowable stress.

Flange	MOP	Longitudi nal hub stress (psi)	Radial flange stress (psi)	Tangential flange stress (psi)
Main 10.5" OD	850	16973	6327	4173
Main 10.5" OD	350	6388	2381	1571
Detector 4.625" OD	850	13998	2794	7367

The head for operating at 850 psig, uses a C-Ring type metal seal and is made from 304L stainless steel. The (24) required bolts for this flange are Unbrako KS 1216 1/2"-13 SHCS with a tensile strength of 160,000 psi (or 304 Stainless Steel with a 81 ksi tensile strength). The main flange for operating at 350 psig is a Conflat (CF) type (304L), sealed with a soft copper flat gasket to a knife edge. The (24) required bolts for this flange are Unbrako KS 1216 1/2"-13 SHCS with a tensile strength of 160,000 psi (or 304 Stainless Steel with a 81 ksi tensile strength). All other CF flanges (1 1/3 and 2 3/4 inch) shall be bolted to the 350 MOP head using Unbrako KS 1216 psi (or 304 Stainless Steel with a 81 ksi tensile strength), 8-32 or 1/4-28 SHCS as required.

The smaller 4 5/8" CF type flange for the detector port requires 10 bolts, Unbrako KS 1216 5/16"-24 SHCS with a tensile strength of 160,000 psi (or 304 Stainless Steel with a 81 ksi tensile strength) and is made from 304L stainless steel. The following table summarizes the fastener calculations.

Flange	MOP	No. of bolts	Bolt	Torqu e (in- lb)	Flange design bolt load, operating. (lb)	Flange design bolt load, gasket seal. (lb)	Max. allowable bolt load (SF 4 applied)
Main, C-ring 10.5" OD	850	24	1/2-13	1140	58850	96913	134976
Main, CF 10.5" OD	350	24	1/2-13	1140	24677	79827	134976
Detector 4.625" OD	850	10	5/16- 24	347	10144	15452	20760
1 1/3" CF	350	6	#8-32	51	231	230	2936
2 3/4" CF	350	6	1/4-28	152	1015	527	7937

Analytical results for the commercially purchased SA316 ellipsoidal head on main vessel, nominal wall thickness 0.5 inches and the SA316 ellipsoidal head on liquid nitrogen pipe, nominal wall thickness 0.2 inches follows. The head

thickness calculations were done at the MAWP of 978 psig and allow for strength reduction due to the butt weld connecting them to the vessel.

	MOP	Max. pressure (psig)	Required head thickness (in)	Actual head thickness (in)	If ≥ 1.0 stress less than yield for 1.5x MAWP
Main vessel	850	1513	0.320	0.500	1.03
LN ₂ pipe	850	3036	0.063	0.200	2.07

Results of the unstayed flat heads are presented in the table below. Two head types are planned for the main vessel, one CF type for low pressures at 350 MOP that has instrumentation ports, and one C-Ring type for high pressure (850 MOP) for vessel pressure testing and to be modified for a future head design (and subsequently proof tested along with a Safety Note Addendum). Stress concentration factors for the circular holes in a plate with internal pressure were used from empirical data in Wiley². Although not a perfectly matching model to Wiley, the concentration factors used are conservative. The stress concentration factor (2.278) reduced the allowable stress to 7,331 psi from 16,700 psi. Hole reinforcement requirements were also calculated using the ASME Codes. These results confirmed the thickness requirements using Wiley stress concentration factors.

Results of two types of Conflat feedthrough heads mounted to the 10.5 inch CF flange are also presented below. All head thickness calculations use the ASME head equation involving bending with the exception of the 2 3/4 inch CF where both bending and no bending cases were used. This flange was bored out to leave a head depth of 0.125" by 1.5" in diameter. The flange thickness around its mounting holes and under its knife edge remains at the nominal flange thickness of 0.5 inches. Thus, calculations were made for both and summarized below. A minimum thickness for the 1/2 inch VCR plug is calculated. The pressure side of a VCR plug is bored out 1/4 inch in diameter to this minimum thickness to be used as a gamma port.

Flange type	MOP	Required head thickness (in)	Actual head thickness (in)	Required hub thickness (in)	Actual hub thickness (in)
Conflat flange, Cu seal AAA99-104240	350	1.261	1.5	0.624	1.250
C-Ring type metal seal. AAA99-104243	850	1.247	1.980	0.661	1.250
Conflat flange, 4 5/8" Ø, x 0.750" thick. Commercial product	850	0.613	0.750	0.423	0.810

1 1/3" CF	350	0.100	0.300	N/A	N/A
2 3/4" CF	350	0.178 / 0.092	0.5 / 0.125	N/A	N/A
VCR plug	850	0.052	0.052	N/A	N/A

Blind holes in the unstayed flat head were analyzed on the basis of area replacement. If the actual cross-sectional area available was greater than the cross-sectional area required, reinforcement was not required. The following table summarizes the results for the 350 MOP flat head. These calculations can also apply to blind mounting holes of the same dimension for mounting and handling the head with the caveat that hole can not be placed near other openings or reinforcements.

Hole type:	Area available (in ²)	Area required (in ²)
8-32 mini conflat holes	0.195	0.051
8-32 mounting bracket holes (internal)	0.205	0.041
1/4-28 medium conflat holes	0.250	0.125

Conflat (CF) flanges are used as connecting members and instrumentation feedthroughs in this pressure vessel design. Five 1 1/3 inch on a 5.5 inch bolt circle pattern and one 2 3/4 inch centrally located CF flanges are used on the 350 MOP head. A 4 5/8 inch CF flange is used on the detector port (850 MOP).

CF flanges were pressure tested in 1992 under the safety note END 92-072. The 1 1/3 inch nominally sized CF flanges with stainless steel bolts started leaking at ~15,000 psi. The 4 5/8 inch CF flange had no leakage with water as the pressure medium up to 1200 psi and minor (10^{-6} Torr-L/s) leaking with helium from 500 psi to 930 psi. All tests were done without catastrophic failure. Leakage occurred around the copper seal. A blank 2 3/4 inch was not proof tested.

For operation, the mating 1 1/3 inch CF flange to the CF port on the 350 MOP head has a high voltage feedthrough that is not rated by the manufacturer (Ceramaseal) because it is a special order. The manufacturer welded the high voltage feedthrough to an opening in the flange. LLNL has proof tested this component to burst (5850 psi). There is a concern for brittle fracture or weld failure due to cracking by mishandling that is addressed in the Fragment Hazard Mitigation paragraph below. The mating 2 3/4 inch CF flange will be proof tested at 604 psig along with the rest of the head. The mating 4 5/8 inch CF flange will be blanked off for pressure testing and initial operational tests. An addendum to this note will follow at a later date to address the attachment method of the detector to the mating flange. It will then be proof tested at 1467 psig.

Fracture Critical Components

This vessel is considered a Category IV risk according to MEDSS. Its failure has the potential for moderate injury and material testing is recommended.

The material used in this vessel is standard ASTM 304L and 316L stainless steel. Material testing was not done for the following reasons:

- (1) SA316L and SA304L are standard materials with strict manufacturing requirements.
- (2) ASME Boiler and Pressure Vessel Code does not require testing for austenitic stainless steels.
- (3) the large critical crack depths (a_{cr}) and lengths calculated using conservative stress intensity factors (K_{Ic}) from literature.
- (4) the number of cycles to failure were $> 10^5$; far larger than the $\leq 10^2$ cycles expected using crack growth rates⁷ from literature.
- (5) The leak-before-break criterion is satisfied by a factor of ~ 10 or greater (136740 / 13824). Also, the CF type flanges used in the TPC design practically guarantee a leak before failure as demonstrated by earlier proof testing.
- (6) 316 and 304 stainless steel both have excellent toughness properties at cryogenic temperatures. Sharpy V-notch impact test data^{6,8} on 304 stainless steel indicates a slightly lowered toughness from room temperature to -196°C (150 to 124 ft-lb). For 316, the toughness lowered 13% from 141 to 122 ft-lb.

The table below summarizes the fracture toughness calculations in Appendix C.

	K_{Ic} (psi in ^{1/2})	K_I (psi in ^{1/2})	a_{cr} surface flaw (in)	a_{cr} sub-surface flaw (in)	2c length of surface flaw (in)	2c length of sub-surface flaw (in)
Main vessel	136740	10115	77.3	93.6	309.3	374.2
Ellipsoidal head	136740	13824	42.2	51.1	168.9	204.4
Flat head	136740	6528	183.1	221.6	732.5	886.3

The Unbrako bolts recommended above in the Head / Flange Calculations section are rated at their maximum tensile strength at -400°F . The alternative, 304 stainless steel fasteners have the same safe fracture critical properties as the vessel. No fracture critical calculations were performed for fasteners.

A proof test at $1.5 \times \text{MAWP}$ and at the working cryogenic temperature is planned for this vessel. Proof testing is the crux of pressure vessel qualification and is best stated from literature⁵ as follows:

“The critical flaw size associated with proof test conditions can also be used for life expectancy considerations. Specifically, if a pressure vessel survives a given proof test it can be concluded that the largest defect present in the structure is

New Technologies Engineering Division

Mechanical Engineering Safety Note

Time Projection Chamber

MESN99-020-OA

April 26, 1999

Prepared By: _____
Douglas Dobie, Mechanical Engineer, Pressure Consultant

Reviewed By: _____
Robert Patterson, Engineer Technical Associate

Reviewed By: _____
Terry Alger, Mechanical Engineer

Approved By: _____
Satish Kulkarni, NTED Division Leader

Distribution:

T. Alger	L-045	High Pressure Lab	L-384
D. Dobie	L-142	Eng. Records Ctr.	L-118
S. Kulkarni	L-113		
R. Patterson	L-171		
E. See	L-186		
D. Archer	L-188		

Contents

A.	Description.....	3
B.	Operational Hazards	5
C.	Procedures.....	5
D.	Calculations.....	5
	Vessel.....	6
	Head / Flange Calculations	7
	Fracture Critical Components	11
	Fragment Hazard Mitigation.....	12
E.	Testing Requirements	13
F.	Labeling Requirements	13
G.	Associated Procedures.....	15
H.	References and Notes	15
	APPENDIX A: PROOF TESTING PROCEDURE FOR THE TPC	16
	APPENDIX B DRAWINGS	20
	APPENDIX C CALCULATIONS	33

A. Description

This safety note covers the design of time projection chambers (TPC) used in a full volume imaging detector. The chambers are used in building 132N, room 2723. There are three parts to the full volume imaging detector system. The first part is the gas purification subsystem that is used to purify and deliver electronegative free (99.9999999%) gas. This part of the system is being built commercially by Insync Systems. The second part of the system, designed and built at LLNL, includes the time projection chambers (TPC) where the experiments will be performed. Gas, from the purification panel, feeds the TPC's that will nominally operate at 300 psig but are being designed for 350 psig maximum operating pressure (MOP). It will be necessary to work around the TPC's with radioactive sealed sources for testing and calibration; thus this is a manned operation. The third part of the system uses cylinders to reclaim the purified gas. These cylinders have been fabricated by ACME CRYOGENICS INC. and are rated by them at 3000 psig MAWP. Gas will be transferred in the TPC system by thermal cycles, using LN2 to create the temperature gradient inside the chamber via conduction through the walls of the cryogenic thimble. A certain percentage of alcohol may be used in the LN2 bath to move the temperature of the bath above 73K.

The TPC's are the experimental chambers designed at LLNL. These chambers are used for two purposes but were mechanically designed to be identical. The first chamber will be used as an ionization chamber where electron drift will be used as a measure of gas purity. The second chamber is the actual TPC itself, which is used for position sensitive readout of electron clouds and hence gamma ray imaging. Figure 1 depicts a TPC with its associated hardware. In the experimental setup, the chambers are connected together with high pressure tubing. The chambers have been designed to allow a 400 keV gamma ray to penetrate the chamber wall in well-defined places, specifically in the center of the 2 3/4 inch conflat flange and in a linear series of VCR blanks on the side of the chamber. It will be necessary to use radioactive sources in conjunction with these windows to probe the capabilities of the chamber. The 1 3/4 inch conflat flanges has been outfitted with a high voltage (20 kV) ceramic feedthrough from Ceramaseal. Many of the penetrations into the chamber and the internals of the chamber are attached to the conflat gasketed chamber head to allow easy removal from the chamber body. The chambers will be filled with a gas (Ar, Xe, along with at least one the following: CH4, CO2, and P10) using the 135psi gas purification system and then condensed by cooling the chamber using a cryogenic thimble. LN2 will envelope the outside of the thimble creating non-uniform thermal stresses along with membrane stress throughout the vessel.

This ME Safety Note is required because the TPC of the system contains compressed gas at pressures exceeding 150 psig or 100kJ of stored energy. This Safety Note covers the vessel depicted in Figure 1 up to and including the output connections. If required, a separate safety note will cover the remaining parts of full volume imaging detector system less the TCP's.

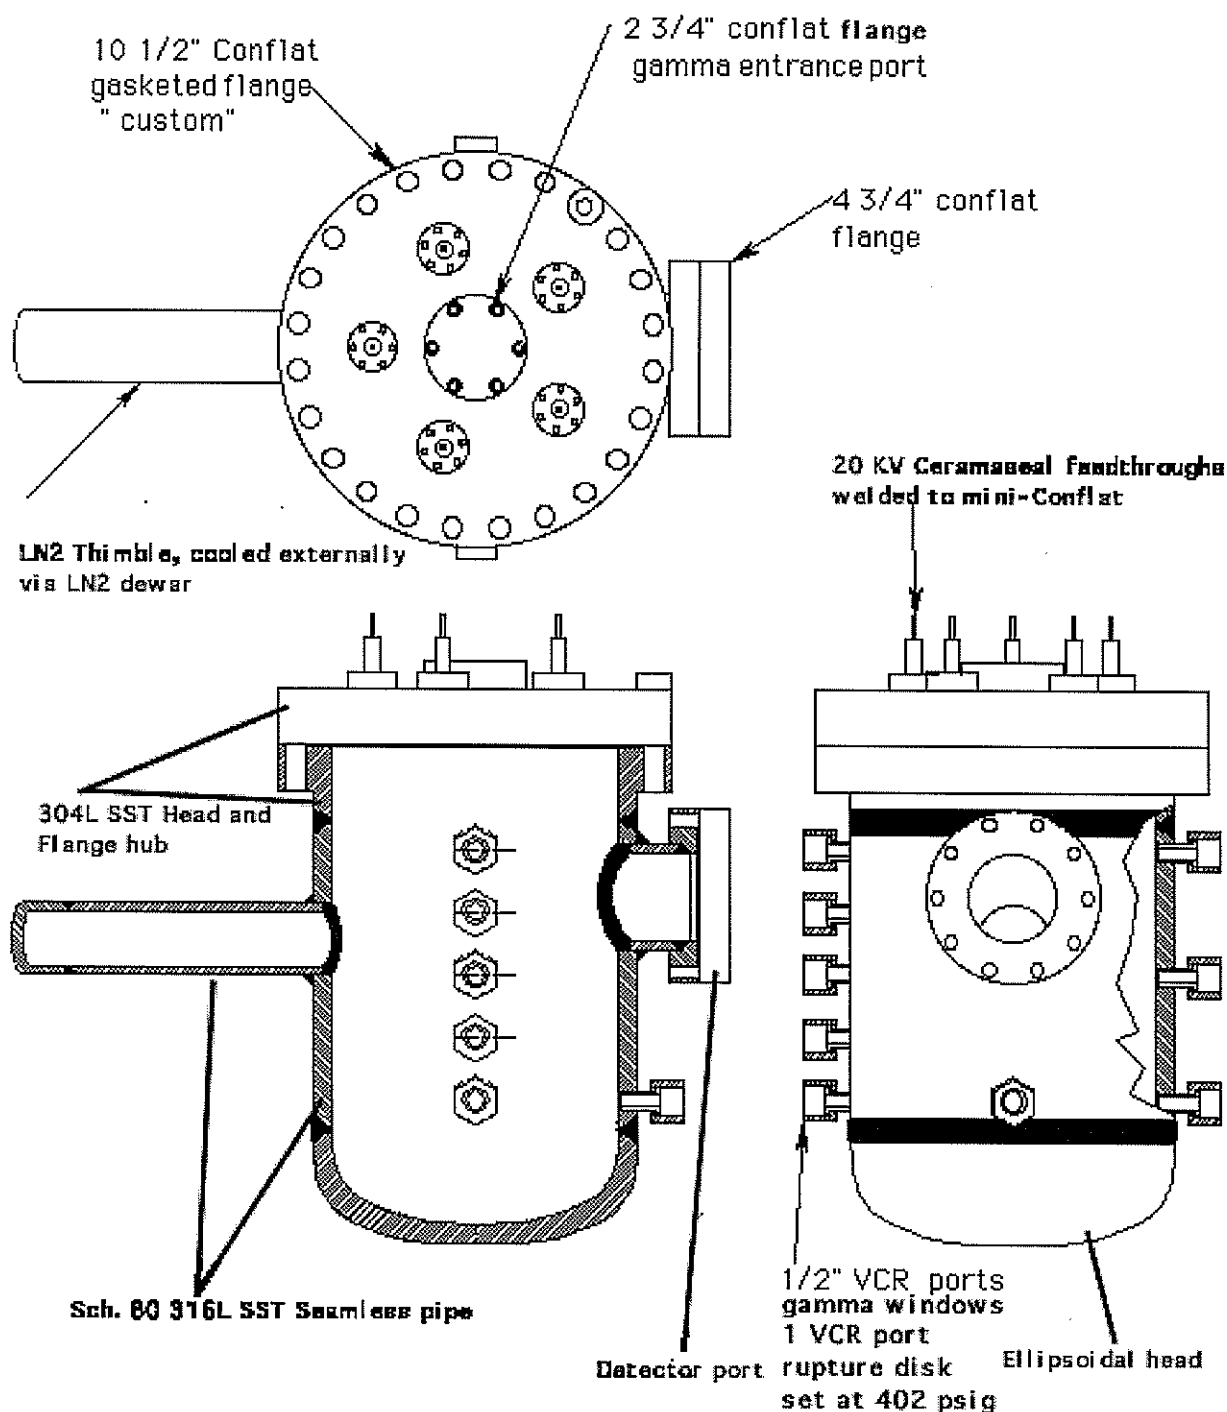


Figure 1 – Diagram of the Time Projection Chambers (TPC)

B. Operational Hazards

Associated hazards are those typical of any high pressure gas system. Failure of a vessel or component could result in either shrapnel or a blast overpressure to the body. Since the gases involved are not air, there is also the potential concern of asphyxiation. Other hazards include physical exposure to the radioactive sealed source and cold temperatures. The hazards other than those associated with the pressure vessel will be addressed by the FSP (if applicable) or separate OSP for this experiment.

C. Procedures

Design safety factors are robust for all intended pressures. The system is adequately protected by a pressure relief device at a VCR port so that components cannot be over-pressurized. This document also specifies shielding requirements for personnel protection from shrapnel in the event of an accident. However, an OSP for this experiment will address associated interlocks and operational steps required during pressurization.

D. Calculations

The following will certify the TPC for this system:

[1] Hardware and Fabrication

The vessel is fabricated using commercially purchased metals. Fabrication and joining techniques are also standard technology. Welding was performed by LLNL ASME certified welders experienced in pressure systems.

[2] Engineered Design

The system design has relief devices at strategic locations (a VCR fitting) to insure that the MAWP's are never exceeded.

An evaluation of high risk pressure components indicated that a Ceramaseal feed-through may fail if improperly handled. Specifically, the weld joint at the Conflat is susceptible to bending and fracture. To minimize this risk, a fragment deflector/stop fixture was designed and will be mounted in front of the head where the Ceramaseal is mounted. A Kevlar drape will also be employed if this device fails to capture all fragments. This stop and Kevlar drape will be interlocked during pressure vessel operation.

[3] Testing

Detailed proof testing procedures at 1.5 times MAWP and at the working temperature, induced by LN2 cooling, have been developed and are enclosed as Appendix A. Successful completion of these procedures by a LLNL pressure inspector will complete the certification of the TPC's. Proof testing is the crux of pressure vessel qualification for fracture critical components and is best stated from literature⁵ as follows:

"The critical flaw size associated with proof test conditions can also be used for life expectancy considerations. Specifically, if a pressure vessel survives a given proof test it can be concluded that the largest defect present in the structure is smaller than the critical flaw size at the proof test conditions. Therefore, in the absence of non-destructive inspection, this flaw size can be considered the existing flaw size at the beginning of life at the operating conditions and would, in turn, serve as the basis for further crack growth consideration"⁵ (also see fracture analysis below).

The vessel has been designed to meet ASME Boiler and Pressure Vessel Code design guidelines. Stresses are low enough to eliminate the need for impact testing of the material in the heat affected zones created by the butt welds, UHA-51 (g) (see misc.nb calculations in Appendix C). The ASME Code also exempt austenitic, chromium-nickel stainless steels from impact testing, UHA-51(d)(1)(a). Thus, the base materials 304L and 316L are exempt.

[4] Calculations

Most calculations were done using ASME Pressure Vessel Code, Section VIII, Division 1 guidelines. The TPC has a MAWP of 978 psig when using the C-Ring type head (no openings) and 402 psig for the Conflat type head(s) (with and without openings). A future addendum to this safety note will cover a head (with openings) to be used at 978 psig MAWP. The allowable stresses used in all calculations are based on values found in the ASME Pressure Vessel Code, Section II. *For both 316L and 304L the allowable stress is 16,700 psi which provides a nominal Safety Factor of ~5 in all Pressure Vessel Code calculations (i.e., head thickness, maximum vessel pressure, minimum wall thickness, etc).* The following tables are summaries of the detailed calculations found in Appendix A.

Vessel

The energy in each pressure vessel was calculated to be 55, 852 ft-lb. or 16.4 g TNT at the MAWP of 978 psig. The following table summarizes the analytical results for the main 8 inch schedule 80 pressure vessel, the detector pipe, the VCR "Cajon" fittings/ pipes, and the LN₂ pipe connected to the main vessel. All tubing is 316L. Calculations were made at a MAWP of 978 psig. The last column refers to the ratio of yield stress (37ksi) to Von Mises stress at the test pressure of 1.5 x MAWP. Values must be greater than 1.0 for a safe proof test.

	S1 (psi)	S2 (psi)	S3 (psi)	Von Mises (psi)	Required wall thickness (in)	Actual wall thickness (in)	If ≥ 1.0 stress less than yield for 1.5xMAWP
Main 8" vessel	3499	7976	-978	7755	0.336	0.500	3.2
Detector pipe 2.87 OD	1839	4657	-978	4880	0.102	0.275	5.1

VCR pipe 0.5" OD	1739	4455	-978	4705	0.012	0.050	5.2
LN ₂ pipe 1.9" OD	1618	4214	-978	4496	0.066	0.200	5.5

Analytical results for welds, area reinforcement, and their related loads that attach the detector pipe, LN₂ pipe, and VCR pipe to the main vessel shell are detailed in the table below at a MAWP of 978 psig. Generally, if the nozzle and fillet weld load paths are greater than the total weld load, then the strengths are sufficient. The total weld load ($W - (\text{Area required} - \text{Area available}) * \text{Allowable stress}$) for the VCR pipe is less than 0 because the vessel wall is 0.160" thicker than required creating much more area available than required. Thus, the area available is greater than the area removed and a negative number results.

	Area of mat'l. required (in ²)	Area of mat'l. avail. (in ²)	Total weld load (lb)	Nozzle wall load path (lb)	Fillet weld load path (lb)
Detector pipe	0.780	0.800	8172	13172	12749
LN ₂ pipe	0.504	0.508	5396	6243	6106
VCR pipe	0.134	0.194	< 0	413	402

The butt welds connecting the hub to the main vessel and the ellipsoidal head to the main vessel, the ellipsoidal head on liquid nitrogen pipe, and the hub to the detector pipe, reduced the allowable working pressure in the vessel they are connected to by 'E' (butt weld efficiency). An 'E' of 0.7 was used for these welds which reduced their associated allowable working pressures to 1421 psig, 6979 psig, and 6139 psig for the of the main vessel, LN pipe, and detector pipe respectively. Again, all of these calculated pressures use an allowable stress of 16,700 psi which has a nominal SF = 5.0 so an additional SF of 1.5 (1421 / 978) is obtained. Using a butt weld efficiency of 0.7 allows no radiography to be performed on the welds according to the ASME Boiler and Pressure Codes.

The VCR, LN₂, and detector port openings in the vessel shell are mounted 90° to each other. The radial distance between hole centers is approximately 6.0 inches. ASME Boiler Code requires that all openings be less than the sum of their respective diameters. The maximum sum of the diameters is 3.37 inches between LN₂ and the detector port.

Holes that do not penetrate the vessel shell may be required to horizontally mount the vessel. The depth of tapped 1/4-20 holes and 3/8-16 holes shall be ≤ 0.25 inches. Holes can not be placed near other openings or reinforcements.

Head / Flange Calculations

The following table summarizes the analytical results for the integral flange butt welded to the main access port and the small flange butt welded on the side of the

vessel (detector port). Again, the allowable stress in 16,700 psi for the base material. Also, the ASME allowable hub stress is 1.5 time the allowable stress.

Flange	MOP	Longitudi nal hub stress (psi)	Radial flange stress (psi)	Tangential flange stress (psi)
Main 10.5" OD	850	16973	6327	4173
Main 10.5" OD	350	6388	2381	1571
Detector 4.625" OD	850	13998	2794	7367

The head for operating at 850 psig, uses a C-Ring type metal seal and is made from 304L stainless steel. The (24) required bolts for this flange are Unbrako KS 1216 1/2"-13 SHCS with a tensile strength of 160,000 psi (or 304 Stainless Steel with a 81 ksi tensile strength). The main flange for operating at 350 psig is a Conflat (CF) type (304L), sealed with a soft copper flat gasket to a knife edge. The (24) required bolts for this flange are Unbrako KS 1216 1/2"-13 SHCS with a tensile strength of 160,000 psi (or 304 Stainless Steel with a 81 ksi tensile strength). All other CF flanges (1 1/3 and 2 3/4 inch) shall be bolted to the 350 MOP head using Unbrako KS 1216 psi (or 304 Stainless Steel with a 81 ksi tensile strength), 8-32 or 1/4-28 SHCS as required.

The smaller 4 5/8" CF type flange for the detector port requires 10 bolts, Unbrako KS 1216 5/16"-24 SHCS with a tensile strength of 160,000 psi (or 304 Stainless Steel with a 81 ksi tensile strength) and is made from 304L stainless steel. The following table summarizes the fastener calculations.

Flange	MOP	No. of bolts	Bolt	Torqu e (in- lb)	Flange design bolt load, operating. (lb)	Flange design bolt load, gasket seal. (lb)	Max. allowable bolt load (SF 4 applied)
Main, C-ring 10.5" OD	850	24	1/2-13	1140	58850	96913	134976
Main, CF 10.5" OD	350	24	1/2-13	1140	24677	79827	134976
Detector 4.625" OD	850	10	5/16- 24	347	10144	15452	20760
1 1/3" CF	350	6	#8-32	51	231	230	2936
2 3/4" CF	350	6	1/4-28	152	1015	527	7937

Analytical results for the commercially purchased SA316 ellipsoidal head on main vessel, nominal wall thickness 0.5 inches and the SA316 ellipsoidal head on liquid nitrogen pipe, nominal wall thickness 0.2 inches follows. The head

thickness calculations were done at the MAWP of 978 psig and allow for strength reduction due to the butt weld connecting them to the vessel.

	MOP	Max. pressure (psig)	Required head thickness (in)	Actual head thickness (in)	If ≥ 1.0 stress less than yield for 1.5x MAWP
Main vessel	850	1513	0.320	0.500	1.03
LN ₂ pipe	850	3036	0.063	0.200	2.07

Results of the unstayed flat heads are presented in the table below. Two head types are planned for the main vessel, one CF type for low pressures at 350 MOP that has instrumentation ports, and one C-Ring type for high pressure (850 MOP) for vessel pressure testing and to be modified for a future head design (and subsequently proof tested along with a Safety Note Addendum). Stress concentration factors for the circular holes in a plate with internal pressure were used from empirical data in Wiley². Although not a perfectly matching model to Wiley, the concentration factors used are conservative. The stress concentration factor (2.278) reduced the allowable stress to 7,331 psi from 16,700 psi. Hole reinforcement requirements were also calculated using the ASME Codes. These results confirmed the thickness requirements using Wiley stress concentration factors.

Results of two types of Conflat feedthrough heads mounted to the 10.5 inch CF flange are also presented below. All head thickness calculations use the ASME head equation involving bending with the exception of the 2 3/4 inch CF where both bending and no bending cases were used. This flange was bored out to leave a head depth of 0.125" by 1.5" in diameter. The flange thickness around its mounting holes and under its knife edge remains at the nominal flange thickness of 0.5 inches. Thus, calculations were made for both and summarized below. A minimum thickness for the 1/2 inch VCR plug is calculated. The pressure side of a VCR plug is bored out 1/4 inch in diameter to this minimum thickness to be used as a gamma port.

Flange type	MOP	Required head thickness (in)	Actual head thickness (in)	Required hub thickness (in)	Actual hub thickness (in)
Conflat flange, Cu seal AAA99-104240	350	1.261	1.5	0.624	1.250
C-Ring type metal seal. AAA99-104243	850	1.247	1.980	0.661	1.250
Conflat flange, 4 5/8" Ø, x 0.750" thick. Commercial product	850	0.613	0.750	0.423	0.810

1 1/3" CF	350	0.100	0.300	N/A	N/A
2 3/4" CF	350	0.178 / 0.092	0.5 / 0.125	N/A	N/A
VCR plug	850	0.052	0.052	N/A	N/A

Blind holes in the unstayed flat head were analyzed on the basis of area replacement. If the actual cross-sectional area available was greater than the cross-sectional area required, reinforcement was not required. The following table summarizes the results for the 350 MOP flat head. These calculations can also apply to blind mounting holes of the same dimension for mounting and handling the head with the caveat that hole can not be placed near other openings or reinforcements.

Hole type:	Area available (in ²)	Area required (in ²)
8-32 mini conflat holes	0.195	0.051
8-32 mounting bracket holes (internal)	0.205	0.041
1/4-28 medium conflat holes	0.250	0.125

Conflat (CF) flanges are used as connecting members and instrumentation feedthroughs in this pressure vessel design. Five 1 1/3 inch on a 5.5 inch bolt circle pattern and one 2 3/4 inch centrally located CF flanges are used on the 350 MOP head. A 4 5/8 inch CF flange is used on the detector port (850 MOP).

CF flanges were pressure tested in 1992 under the safety note END 92-072. The 1 1/3 inch nominally sized CF flanges with stainless steel bolts started leaking at ~15,000 psi. The 4 5/8 inch CF flange had no leakage with water as the pressure medium up to 1200 psi and minor (10^{-6} Torr-L/s) leaking with helium from 500 psi to 930 psi. All tests were done without catastrophic failure. Leakage occurred around the copper seal. A blank 2 3/4 inch was not proof tested.

For operation, the mating 1 1/3 inch CF flange to the CF port on the 350 MOP head has a high voltage feedthrough that is not rated by the manufacturer (Ceramaseal) because it is a special order. The manufacturer welded the high voltage feedthrough to an opening in the flange. LLNL has proof tested this component to burst (5850 psi). There is a concern for brittle fracture or weld failure due to cracking by mishandling that is addressed in the Fragment Hazard Mitigation paragraph below. The mating 2 3/4 inch CF flange will be proof tested at 604 psig along with the rest of the head. The mating 4 5/8 inch CF flange will be blanked off for pressure testing and initial operational tests. An addendum to this note will follow at a later date to address the attachment method of the detector to the mating flange. It will then be proof tested at 1467 psig.

Fracture Critical Components

This vessel is considered a Category IV risk according to MEDSS. Its failure has the potential for moderate injury and material testing is recommended.

The material used in this vessel is standard ASTM 304L and 316L stainless steel. Material testing was not done for the following reasons:

- (1) SA316L and SA304L are standard materials with strict manufacturing requirements.
- (2) ASME Boiler and Pressure Vessel Code does not require testing for austenitic stainless steels.
- (3) the large critical crack depths (a_{cr}) and lengths calculated using conservative stress intensity factors (K_{Ic}) from literature.
- (4) the number of cycles to failure were $> 10^5$; far larger than the $\leq 10^2$ cycles expected using crack growth rates⁷ from literature.
- (5) The leak-before-break criterion is satisfied by a factor of ~ 10 or greater (136740 / 13824). Also, the CF type flanges used in the TPC design practically guarantee a leak before failure as demonstrated by earlier proof testing.
- (6) 316 and 304 stainless steel both have excellent toughness properties at cryogenic temperatures. Sharp V-notch impact test data^{6,8} on 304 stainless steel indicates a slightly lowered toughness from room temperature to -196°C (150 to 124 ft-lb). For 316, the toughness lowered 13% from 141 to 122 ft-lb.

The table below summarizes the fracture toughness calculations in Appendix C.

	K_{Ic} (psi in ^{1/2})	K_I (psi in ^{1/2})	a_{cr} surface flaw (in)	a_{cr} sub-surface flaw (in)	2c length of surface flaw (in)	2c length of sub-surface flaw (in)
Main vessel	136740	10115	77.3	93.6	309.3	374.2
Ellipsoidal head	136740	13824	42.2	51.1	168.9	204.4
Flat head	136740	6528	183.1	221.6	732.5	886.3

The Unbrako bolts recommended above in the Head / Flange Calculations section are rated at their maximum tensile strength at -400°F . The alternative, 304 stainless steel fasteners have the same safe fracture critical properties as the vessel. No fracture critical calculations were performed for fasteners.

A proof test at $1.5 \times \text{MAWP}$ and at the working cryogenic temperature is planned for this vessel. Proof testing is the crux of pressure vessel qualification and is best stated from literature⁵ as follows:


“The critical flaw size associated with proof test conditions can also be used for life expectancy considerations. Specifically, if a pressure vessel survives a given proof test it can be concluded that the largest defect present in the structure is

smaller than the critical flaw size at the proof test conditions. Therefore, in the absence of non-destructive inspection, this flaw size can be considered the existing flaw size at the beginning of life at the operating conditions and would, in turn, serve as the basis for further crack growth consideration”.

A physical inspection of the TPC for cracks is required between every experiment or experimental cycle. Careful handling of the head, vessel and its related hardware is important so that the welds attaching the various components (high voltage feedthroughs, VCR stubs) are not damaged. If any of these components are bent by mishandling, the suspect welds must be radiographically inspected and re-proof tested.

Fragment Hazard Mitigation

A fragment deflector/stop was designed to deflect and capture a potential Ceramaseal feedthrough mishap if it were propelled from head of the vessel. It will be placed as close as practical to the TPC head and still allow operation of the vessel. The basic design is based on ballistic gun range technology where the fragment is deflected from a 45° wall into a sand trap (red arrow shows path in Figure below). All walls are made from 2.5” thick lexan that can stop the projectile if it were propelled normal into it. The opening in the stop (11” x 14”) is sufficiently oversized to the Ceramaseal bolt circle diameter (5.5”) and the sand trap baffle is made from 1/4” lexan to allow fragment passage. This stop will be interlocked during vessel operation. Calculation filename “fragment.nb” in Appendix C details the shielding calculations obtained from MEDSS.

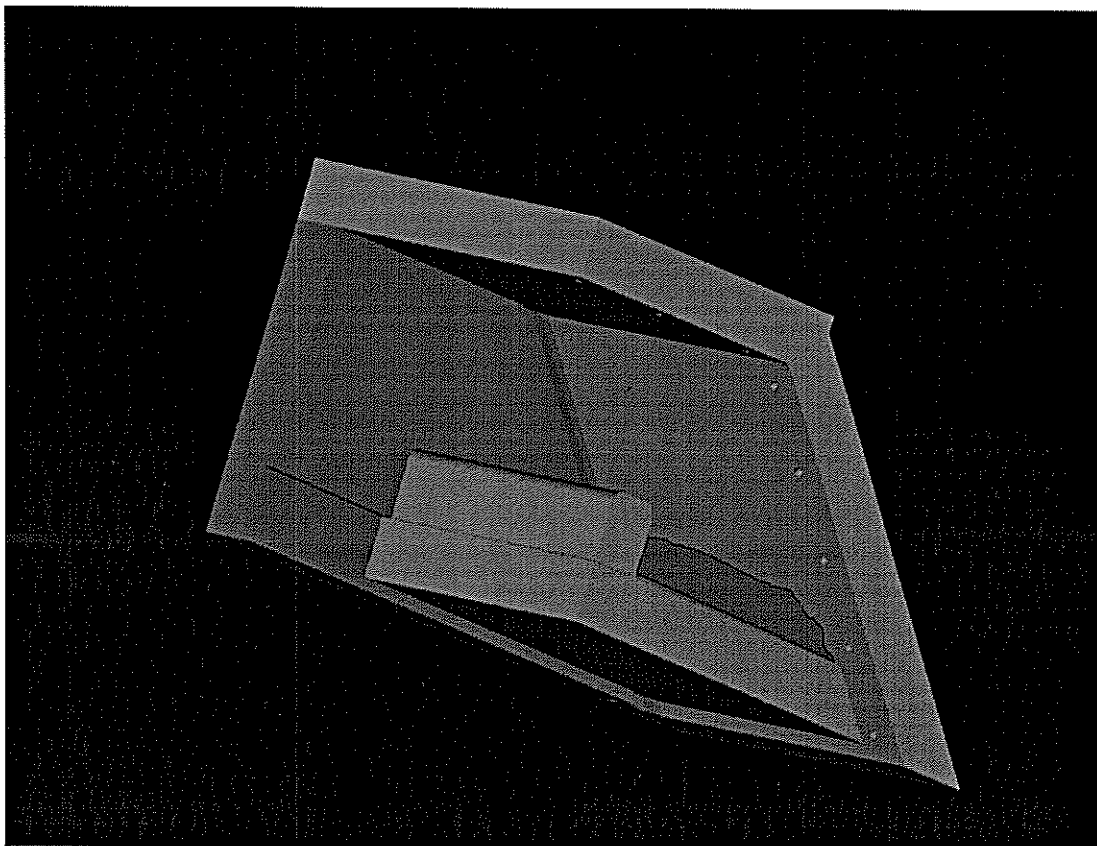

A Kevlar drape will also be employed to shield the operator from a potential stray fragment reflected back out of the catch.

The system pressure requirements are summarized as follows:

Component	Maximum Operating Pressure (psig)	Maximum Allowable Working Pressure (MAWP) (psig)	Pressure Relief Setting (psig)	Proof Test Pressure (psig)
Main Pressure Vessel (sketch) AAA99-104242 (weld flange)	850	978	978	1467
Flat Head, Metal C-Ring: AAA99-104243	850	978	978	1467
Conflat flange, 4 5/8" Ø, x 0.750" thick. commercial CF flange (blank)	850	978	978	1467
VCR Plug, 1/2" Ø, modified commercial	850	978	978	1467
Flat Head Conflat Type: AAA99-104240	350	402	402	604
Conflat flange, 2 3/4" Ø, x 0.500" thick. modified commercial CF flange	350	402	402	604
Ceramaseal: 19543-04-CF; 1 1/3" Ø, x 0.300" thick. modified commercial CF flange	350	402	402	604

E. Testing Requirements

Detailed testing procedures have been developed and are enclosed as Appendices B. The proof test criterion for each system is 150% of MAWP.

F. Labeling Requirements

Upon completion of the testing procedures, the LLNL pressure inspector will certify the inspection of this system by completion of an LLNL Pressure Test/Inspection Record, Form LL3586, and by attaching an LLNL Pressure Tested Label, properly filled out to the individual components identified below. Appropriate additional information will be inserted as required.

LLNL PRESSURE TESTED	
FOR MANNED AREA	
ASSY.	Pressure vessel
SAFETY NOTE	MESN99-020-OA
M.A.W.P.	978 PSIG.
FLUID	He, Xe, Ar, CH ₄ , CO ₂ , P10
TEMP.	-320 TO ambient °F
REMARKS	Main Pressure Vessel (AAA99-104242, weld flange)
TEST NO.	T.R.
EXPIRATION DATE	
BY	DATE

LLNL PRESSURE TESTED	
FOR MANNED AREA	
ASSY.	AAA98-104240
SAFETY NOTE	MESN99-020-OA
M.A.W.P.	402 PSIG.
FLUID	He, Xe, Ar, CH ₄ , CO ₂ , P10
TEMP.	-320 TO ambient °F
REMARKS	350 MOP CF type head
TEST NO.	T.R.
EXPIRATION DATE	
BY	DATE

LLNL PRESSURE TESTED	
FOR MANNED AREA	
ASSY.	AAA99-104243-00
SAFETY NOTE	MESN99-020-OA
M.A.W.P.	978 PSIG.
FLUID	He, Xe, Ar, CH ₄ , CO ₂ , P10
TEMP.	-320 TO ambient °F
REMARKS	850 MOP C-Ring Head
TEST NO.	T.R.
EXPIRATION DATE	
BY	DATE

LLNL PRESSURE TESTED	
FOR MANNED AREA	
ASSY.	AAA99-104241-00
SAFETY NOTE	MESN99-020-OA
M.A.W.P.	402 PSIG.
FLUID	He, Xe, Ar, CH ₄ , CO ₂ , P10
TEMP.	-320 TO ambient °F
REMARKS	350 MOP CF Type Head
TEST NO.	T.R.
EXPIRATION DATE	
BY	DATE

G. Associated Procedures

The concerns are asphyxiation, cold temperature and radiation exposure of personnel. Responsibility for an OSP resides with the user.

H. References and Notes

1. The defining drawings are as follows:

<u>Drawing Title</u>	<u>LLNL</u>
Pressure Chamber Lid Blank	AAA98-1104241
Pressure Chamber Lid	AAA98-1104240
Pressure Chamber Lid Blank C Ring 850 MOP	AAA98-1104243
Pressure Chamber Weld Flange 850 MOP	AAA98-1104242
Xenon Chamber Model 8" (sketch)	N/A
Xenon Chamber Model 8" associated sketches	N/A

2. 1995 ASME Boiler and Pressure Vessel Code, Section VIII, Division I.
3. Design of Piping Systems, John Wiley & Sons, Inc. 1974.
4. Degraded Piping Program - Phase II, Sixth Program Report, Oct. 1986 – September 1987, USNRC
5. Fracture 1969, Chapman and Hall Ltd. IBN 412094703
6. Handbook of Stainless Steels, D. Peckner, I. Bernstein, McGraw-Hill, 1977
7. Metal Fatigue in Engineering, H. Fuchs, R. Stephens, John Wiley & Sons, Inc. 1980.
8. Austenetic Steels at Low Temperatures, R.P. Reed, T Horiuchi, Plenum Press, 1982.

APPENDIX A: PROOF

TESTING PROCEDURE FOR

THE TPC

A.1 General

This procedure is for proof testing the TPC shown in Figure 1. Initial pressure and leak tests of the system will be conducted in Building 343 because it provides an adequate barricade for conducting the test and keeps personnel exposure to a minimum. Final leak testing of joints made up after installation and retest of the systems in the future will be conducted at the B132 facility.

A.2 Hazards

The Health and Safety Manual Supplement 32.05, Section 2 – “Standard Procedure for Pressure Testing with Gas” applies.

A.3 Pretest Procedure

Use the system indicated in Figure A1 as the test source. Support the chamber horizontally. Cool the chambers' LN2 pipe and surrounding metal with an LN2 filled dewar supplied by the experimenter to simulate the thermal stresses during actual operation. Let the metal 'soak' for 20-30 minutes before proof testing.

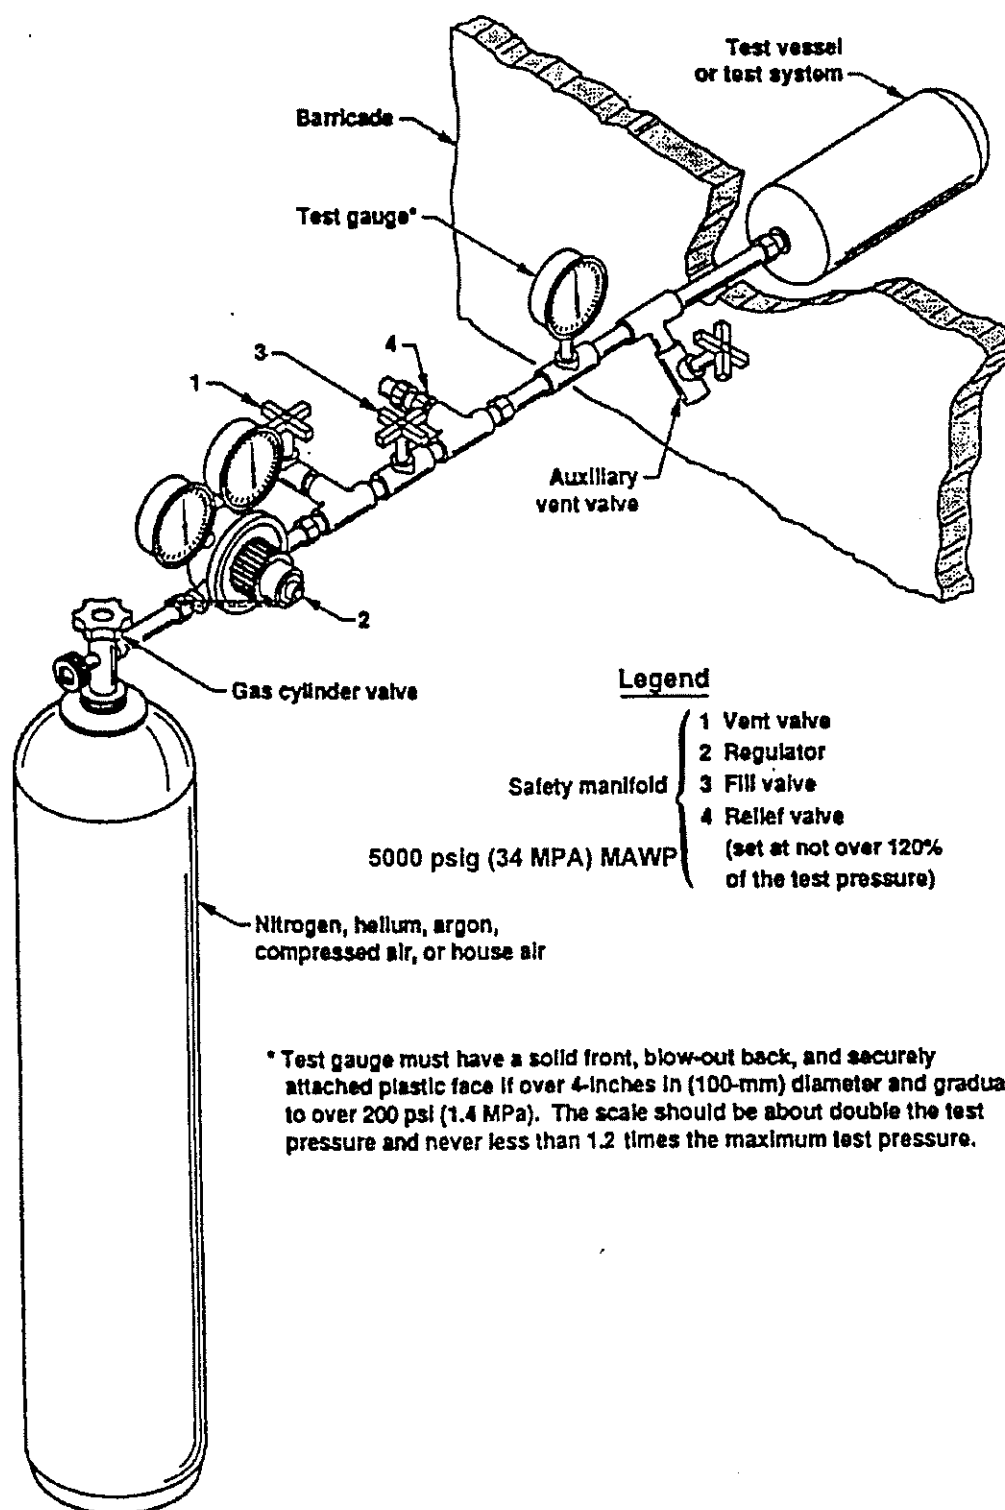


Figure A1 – Gas Test System

A.4 Test Procedure

Refer to Figure 1 and Appendix A for component designations.

A.4.1 High Pressure (1467 psig) Helium System Pressure Test

The two TPC's will first be tested to $1.5 \times \text{MAWP}$, or $1.5 \times 978 = 1467$ psig using the following components:

Vessel (2 ea., requires 2 separate proof tests)
C-Ring type lid (AAA99-104243)
4 3/4" CF blank for the detector port
Modified VCR plug(s) at the VCR ports

1. Install the hardware described above for the 1467psig proof test.
2. Apply 1467psig test pressure to one of the VCR ports.
3. Hold test pressure at 1467psig for 15 minutes.
4. Vent system down to 150 psig and leak check all joints under pressure with Snoop.
5. Vent helium to atmospheric pressure.

A.4.2 Moderate Pressure (604 psig) Helium System Pressure Test

A single TPC will also be tested to $1.5 \times \text{MAWP}$, or $1.5 \times 402 = 604$ psig using the following components. Two tests are required to qualify both heads.

Vessel
CF type lid (AAA99-104240, AAA99-104241)
2 3/4" CF modified blank for the x-ray port
1 1/3" CF flanges with high voltage feedthroughs
4 3/4" CF blank for the detector port
Modified VCR plug at the VCR ports

1. Install the hardware described above for the 604 psig proof test.
2. Apply 604 psig test pressure to one of the VCR ports.
3. Hold test pressure at 604 psig for 15 minutes.
4. Vent system down to 150 psig and leak check all joints under pressure with Snoop.
5. Vent helium to atmospheric pressure.




A.4.3 Documentation

Test records shall include an LLNL Pressure test/inspection record for the separate pieces of the vessel. The pressure inspector will send the original copies of the test reports to LLNL Pressure Safety (L-384).

APPENDIX B


DRAWINGS

Xenon Chamber 3 view Model 8"
Date: 2/24/89
Drawn By: Bob Patterson
Material: All flr. coated. 80
316L SS
Rings: confiat type 304 SS
Custom made
flr esp 316L
Bolts: 1/2-20 grade 8
24 each

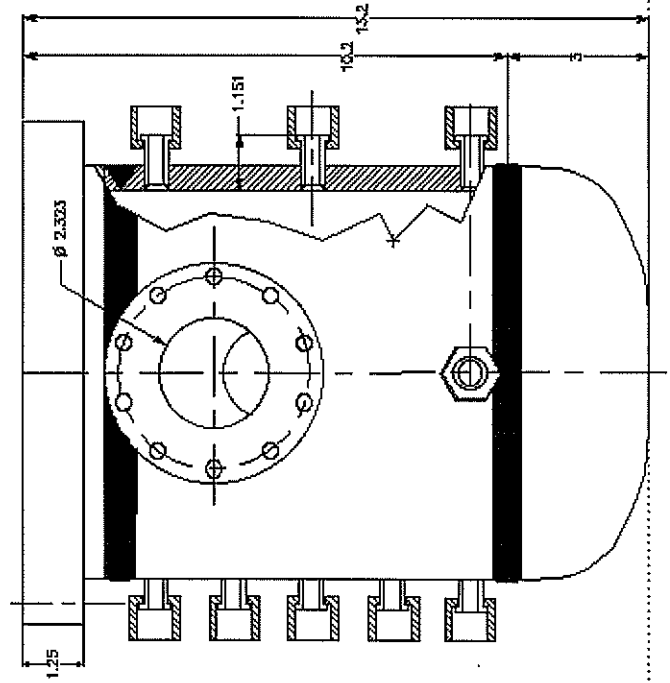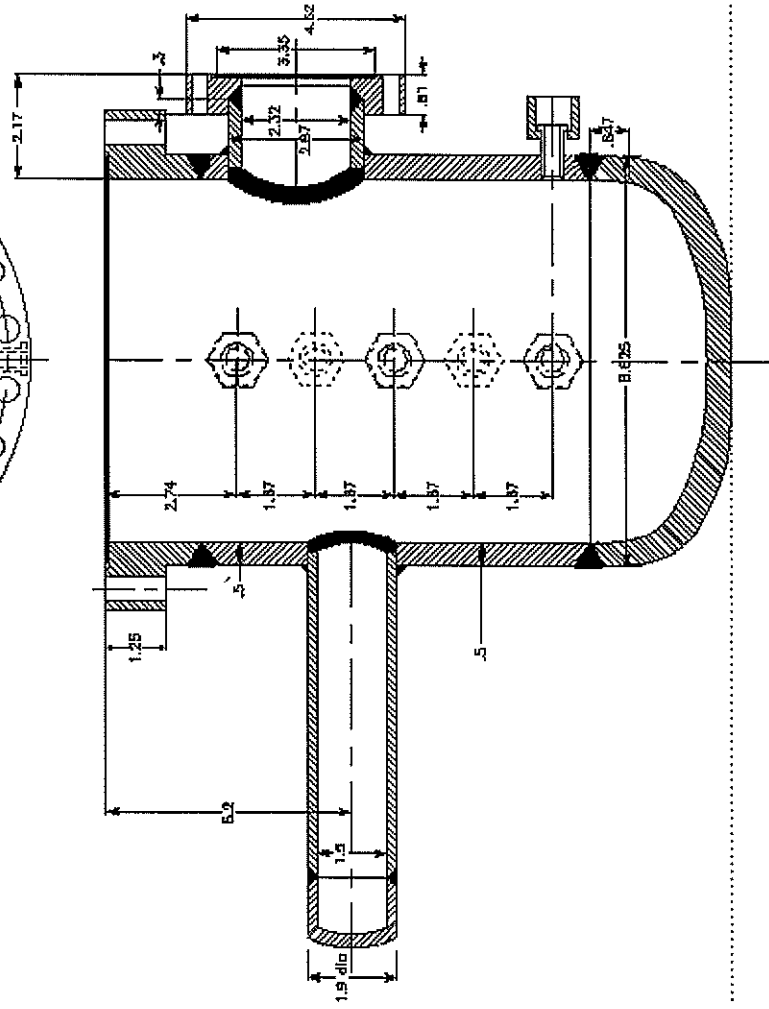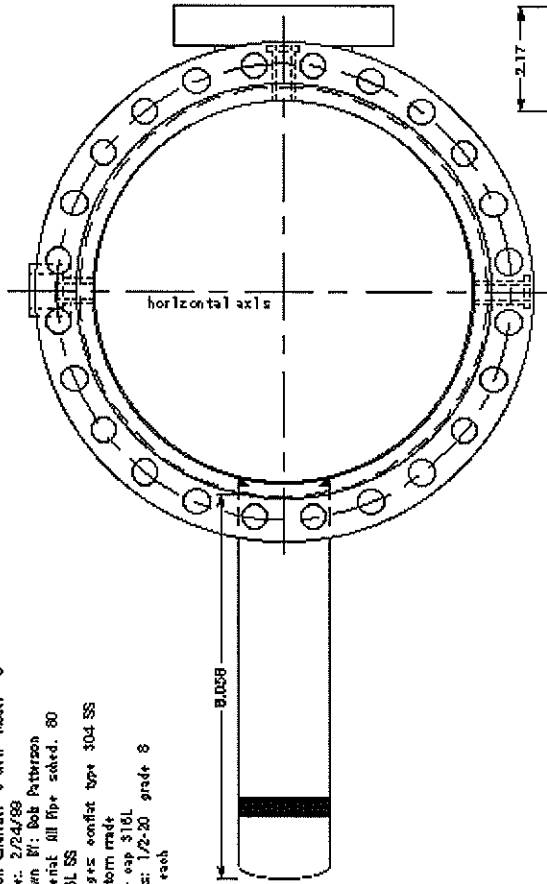


Detector Port
Date: 2/24/99
Drawn By: Bob Patterson
Material: Pipe 2 1/2 IPS sched. 80
316L SS
2 ea. required

Flange MDC 4 5/8" OD
F458000 conflat blank or
equivalent bored to fit
2 1/2" IPS

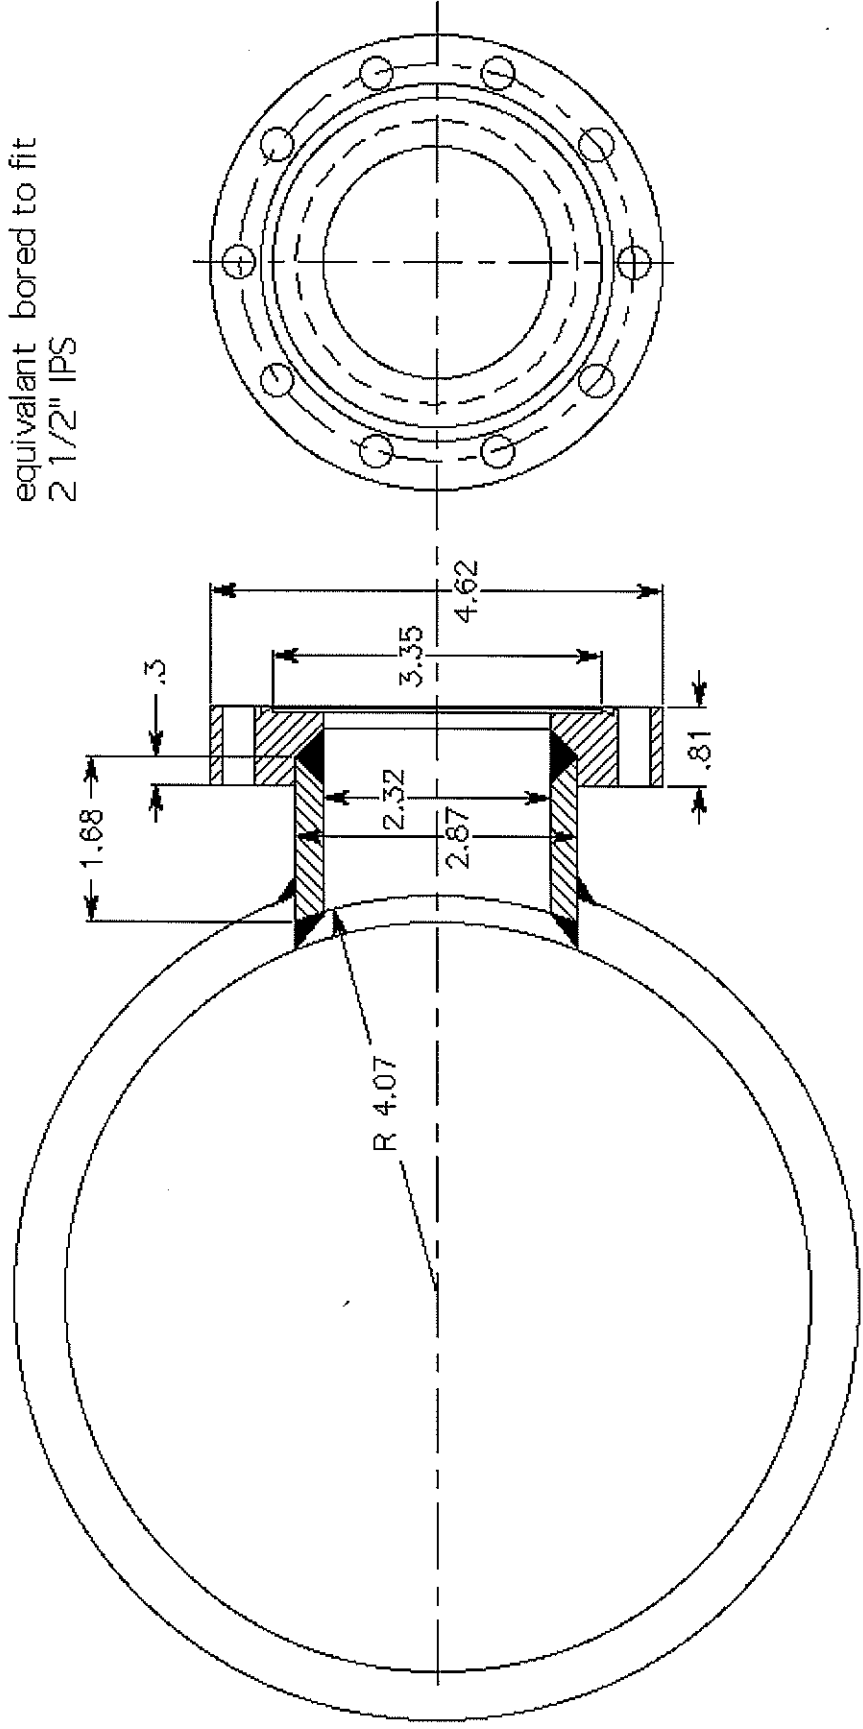


Xenon Chamber Welding Drawing
Date: 3/3/99
Drawn BY: Bob Patterson
Material: All Pipe sched. 80
316L SS
Flanges: conflat type 304 SS
Custom made
Pipe cap 316L

Welds must meet ASME Boiler and Pressure vessel
Code, Section VIII Division 1, Part UW requirements for
cleaning, heat treating and welding process.

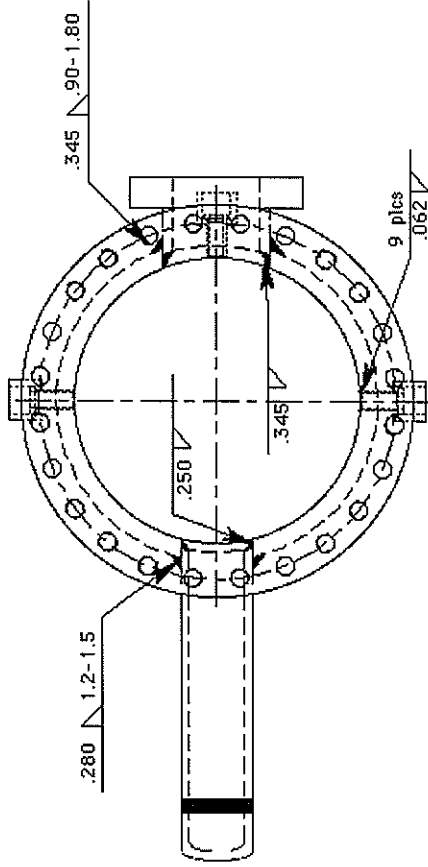


Category B, Type 1 butt weld
obtained by double welding.



Category A, Type 1 Butt weld. Butt weld
obtained by double welding

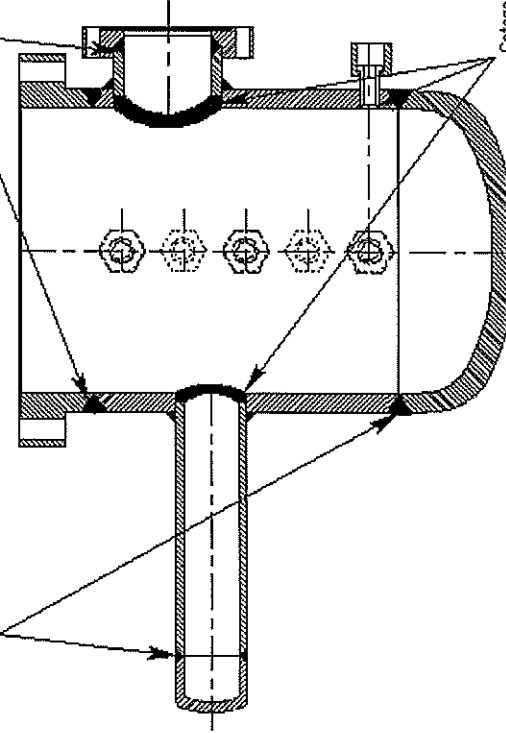


Category D, fillet weld. Refer to
Fig. UW-16.1 (v-1) 11 pics.

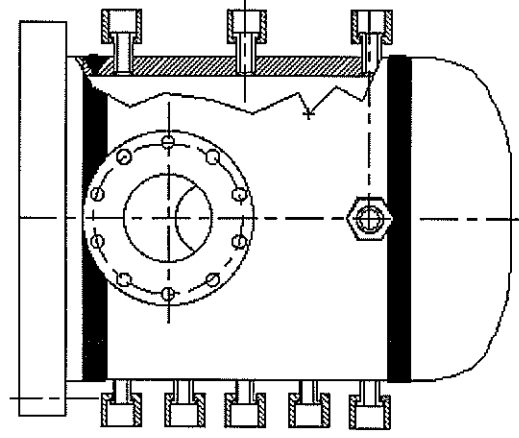



Xenon Chamber Model 8"
Main body 1 ea.
Date: 2/19/99
Drawn BY: Bob Patterson
Material: Pipe 8 IPS sched. 80
316L SS

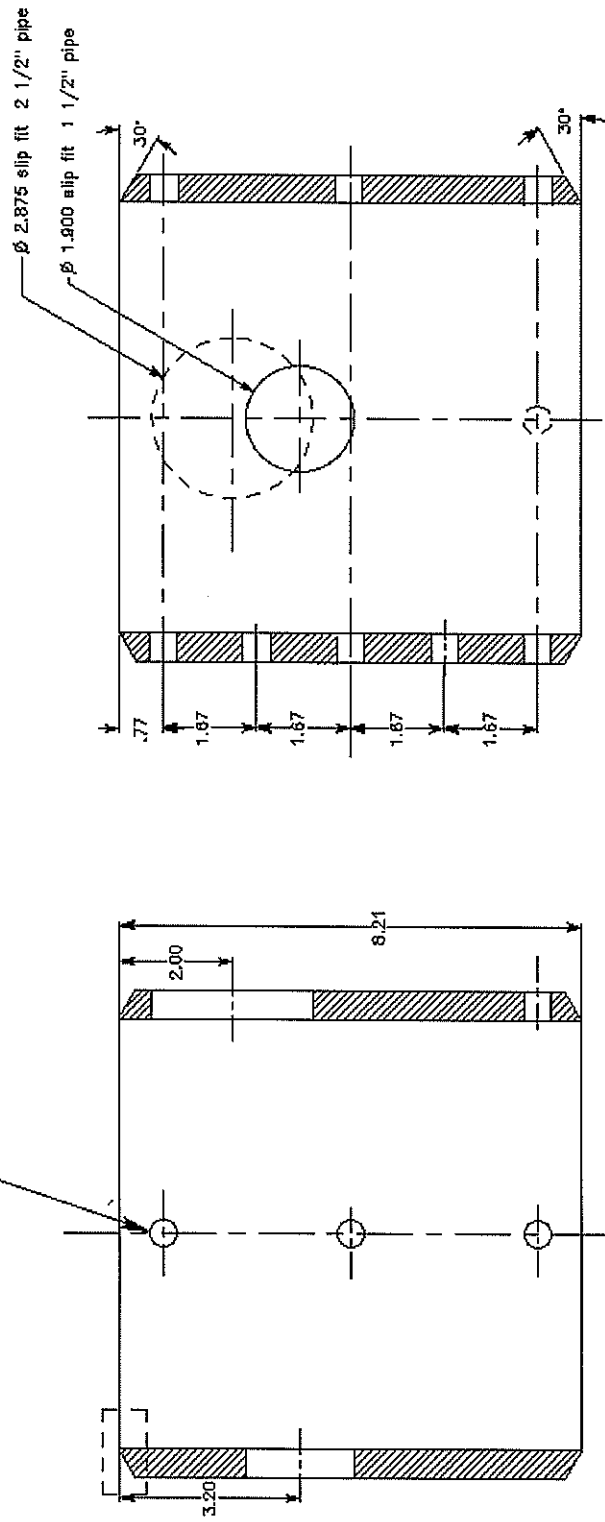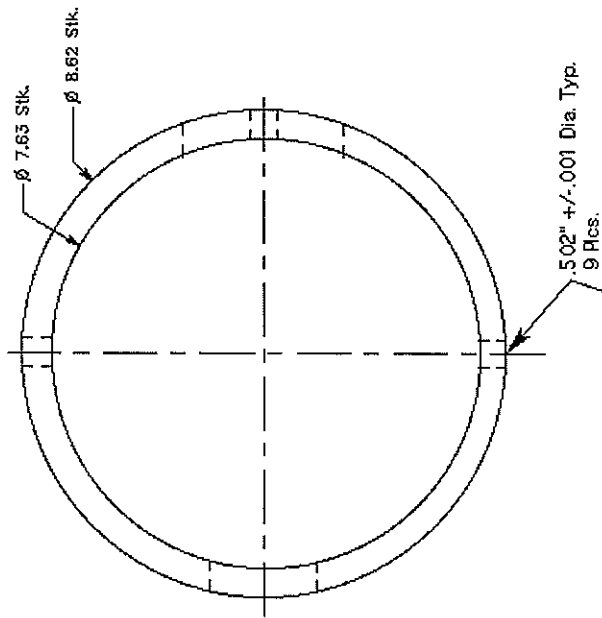

Xenon Chamber Model 8"
Mainbody Mirror Image 1ea
Date: 2/19/99
Drawn BY: Bob Patterson
Material: Pipe 8 IPS sched. 80
316L SS

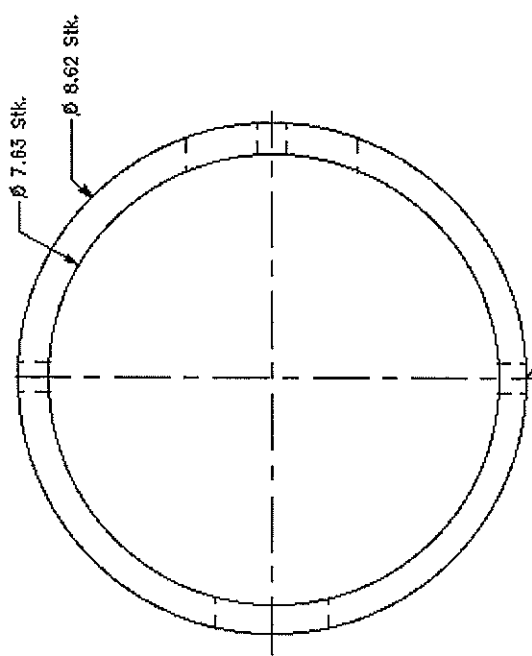

.502" \pm .001 Dia. Typ.
9 Plcs.

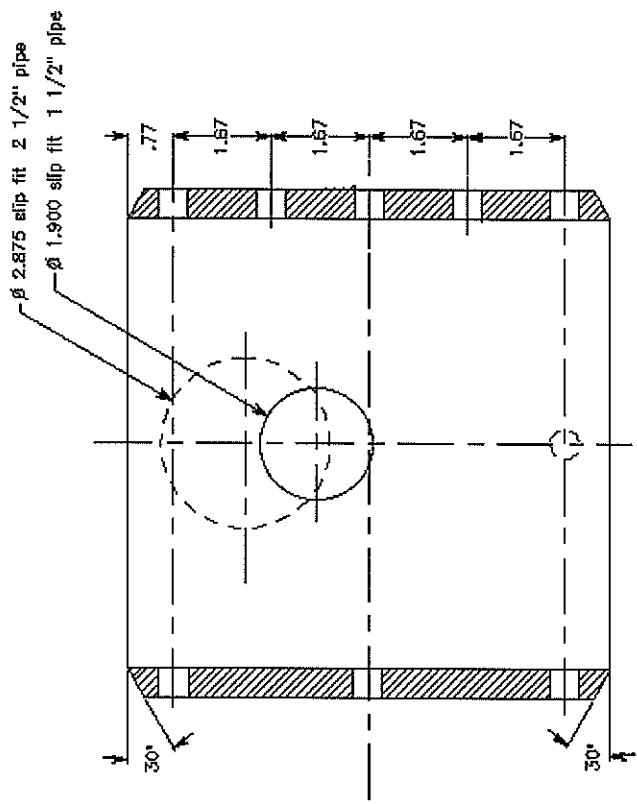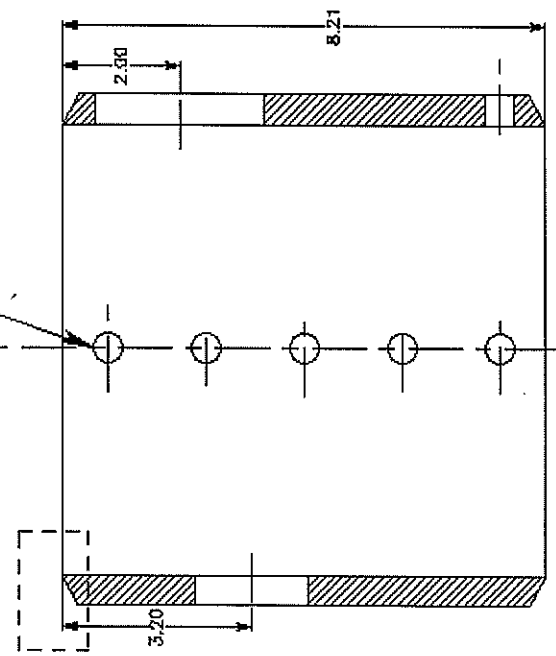

Checked by	Date	Drawing #


Gamma window
VCR Plug Modified
P/N SS-8-VCR-P
Quantity: 12 ea
MAWP 850

Note: Modify existing VCR Male Plug
Remachine top surface
Part supplied by requestor

All Dims. in inches



Date Drawn 4/23/99	Lawrence Livermore National Laboratory	
Scale 1 to 1	Drawn by Robert Patterson Employee no 686200	
Acct. No. 8960-04	Building 132 S Room 1170 L-171 Phone 422-7599	

Pumping Tubulation
Date: 2/25/99
Drawn By: Bob Patterson
Material: Pipe 1 1/2 IPS sched. 80
316L SS
2 ea. required

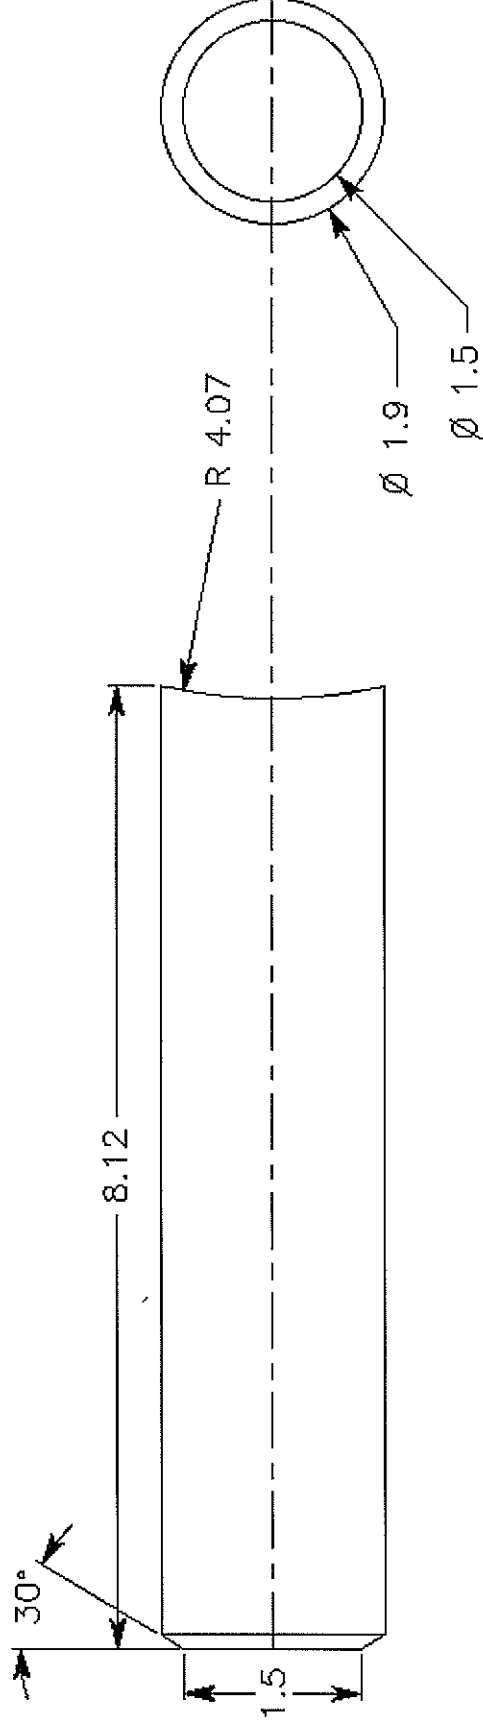

Detail	A	X +/- .002	Y +/- .002
1			
2			
3		8.540	8.750


STAMP DRAWING NUMBER

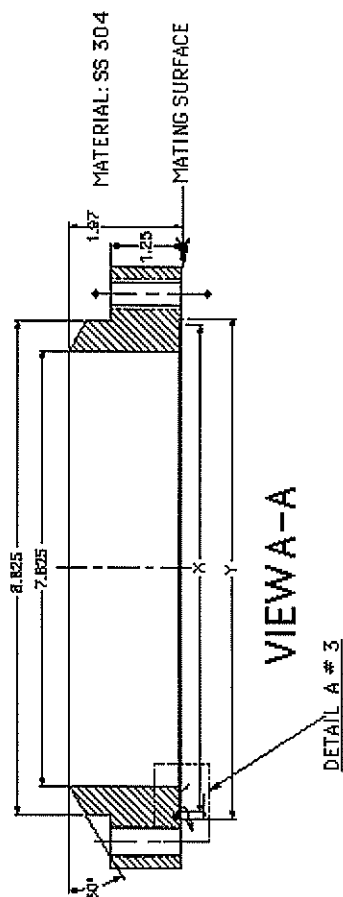
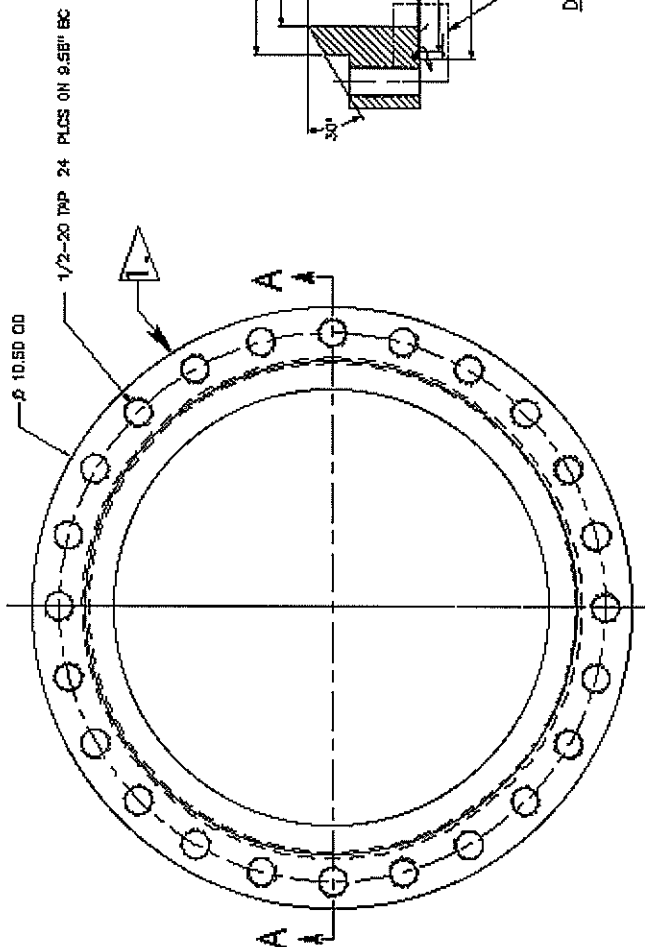


LEVEL 1 DRAWING

PressureChamber
Weld Flange 850 MOP
AAA99-104242-00

Detail A	X +/- .002	Y +/- .002
1	-----	-----
2	-----	-----
3	8.540	8.750

 STAMP DRAWING NUMBER

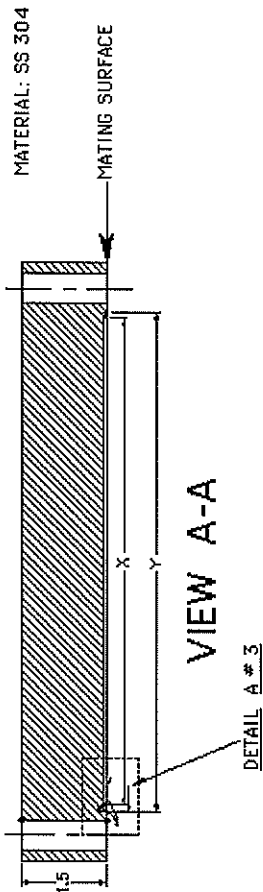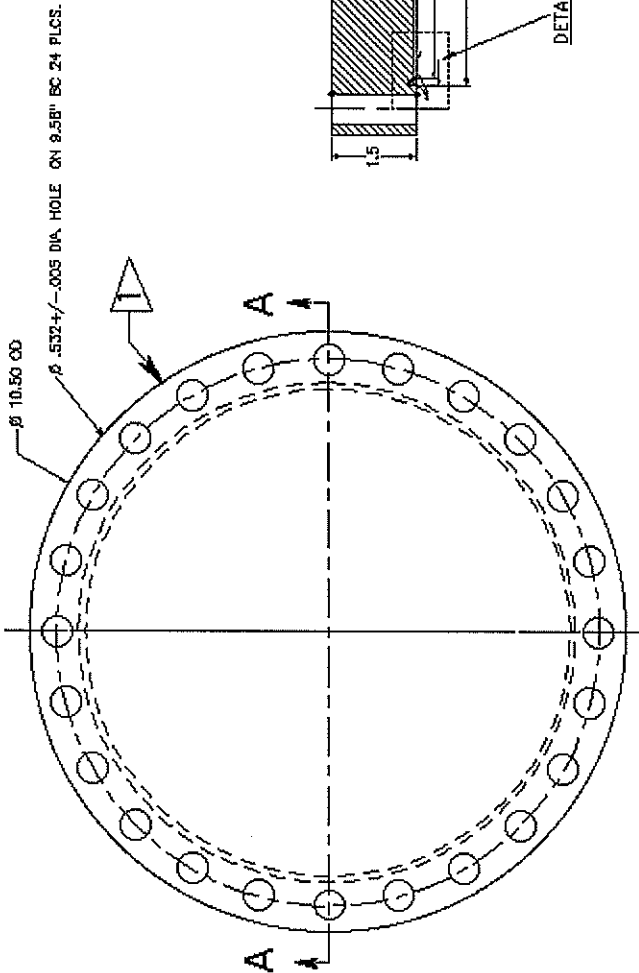



LEVEL 1 DRAWING

Pressure Chamber Lid
Blank 350 MOP

AAA99-104241-00

Detail A	X	+/- .002	Y	+/- .002
1		.720		.840
2		1.650		1.902
3		8.540		8.750

1 STAMP DRAWING NUMBER

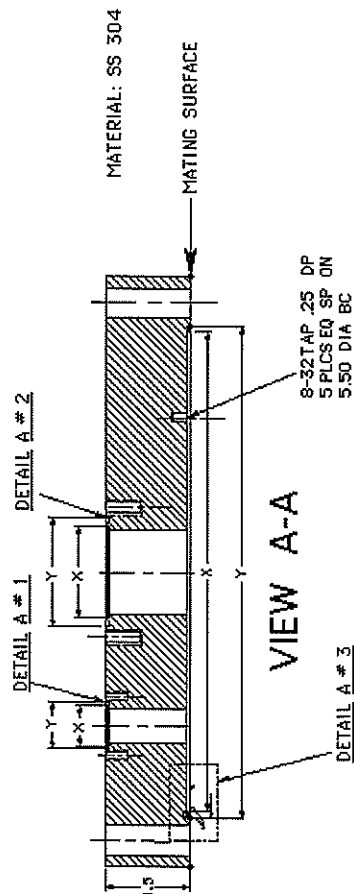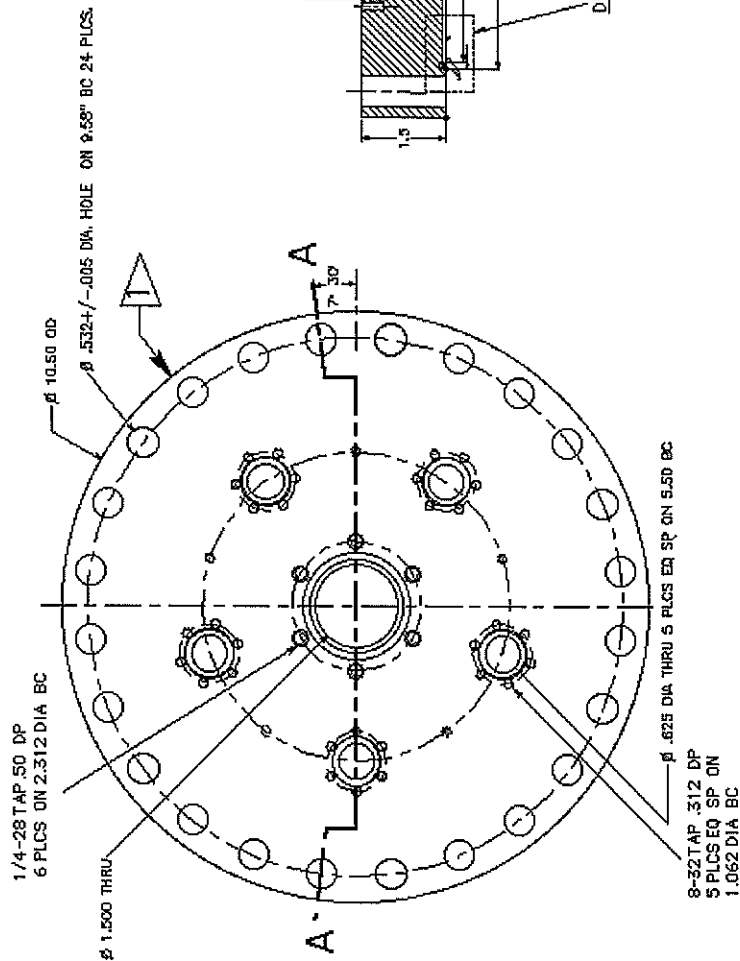

LEVEL 1 DRAWING

Pressure Chamber Lid
C F Mini 350 MOP

AAA99-104240-00


Checked by	Date	Drawing #

Gamma Window
2 3/4" Conflat Flange
MAWP 350 psig
Quantity 2 ea.

Note: Reworked Flange
304 SS

All Dims. in inches

Date Drawn: 4/23/99	Lawrence Livermore National Laboratory	
Scale 1 to 1	Drawn by Robert Patterson	Employee no 686200
Acct. No 8960-04.	Building 132 S Room 1170 L-171 Phone 422-7599	

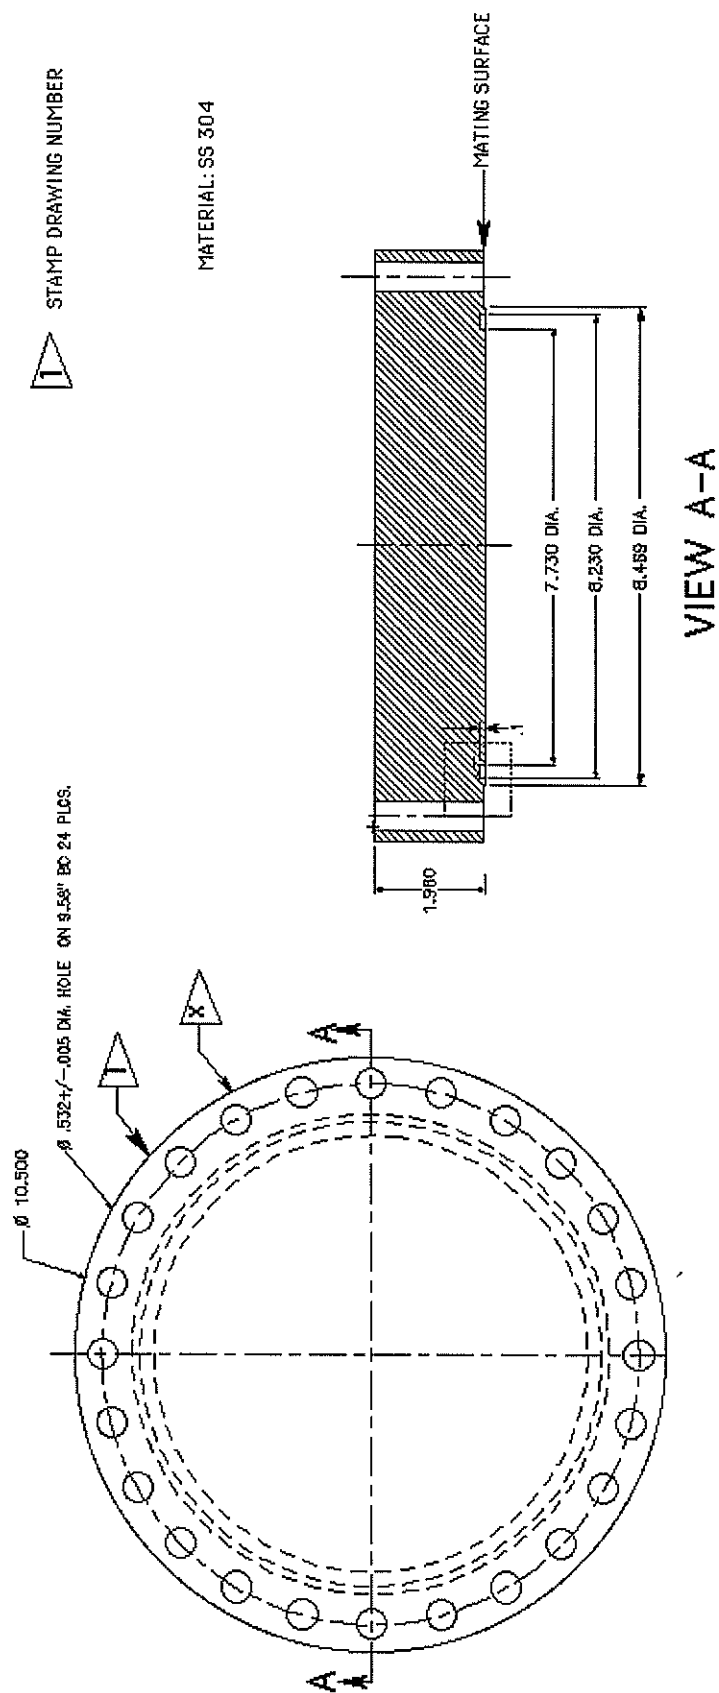

APPENDIX C

CALCULATIONS

<u>File name</u>	<u>Calculations performed</u>
Energy_vessel.nb	energy calculations, peak and static overpressure
Vessel_stress2.nb	main vessel stress calculations, wall thickness, maximum pressure, proof test stress
Ellipsoidal_head_stress.nb	main vessel head thickness, max. pressure, proof test stress
Ellipsoidal_head_stress_LN2..nb	LN2 head thickness, max. pressure, proof test stress
Flange_stress_hub_978.nb	main vessel C-Ring head bolt load, moment, stresses
Flange_stress_hub_small_978.nb	detector port bolt load, moment, stresses
Flange_stress_hub_403.nb	main vessel CF head bolt load, moment, stresses
Xe_vessel_det.nb	detector pipe stress calculations, wall thickness, maximum pressure, proof test stress
Detector_shell.nb	detector pipe weld reinforcement, area required, area available
Weld_load_stress.nb	detector pipe weld load allowable, strength of connecting elements (welds)
Xe_vessel_VCR.nb	VCR pipe stress calculations, wall thickness, maximum pressure, proof test stress
VCR_shell.nb	VCR pipe weld reinforcement, area required, area available
Weld_load_stress_VCR.nb	VCR pipe weld load allowable, strength of connecting elements (welds)
VCR_gamma_port.nb	VCR minimum head thickness calculation
Xe_vessel_LN2.nb	LN2 pipe stress calculations, wall thickness, maximum pressure, proof test stress
LN2_shell.nb	LN2 pipe weld reinforcement, area required, area available
Weld_load_stress_LN2.nb	LN2 pipe weld load allowable, strength of connecting elements (welds)
Head_350_K_openings2.nb	main vessel CF type flat head: stress concentration factor, thickness, distance between hole centers
Head_850_no_openings2.nb	main vessel C-ring type flat head: head thickness, hub thickness
Head_850_4.625_no_openings2.nb	detector port CF type flat head: head thickness, hub thickness
Bolt_load_1.33CF_350.nb	1.33 CF flange bolt load, head thickness
Bolt_load_2.75CF_350.nb	2.75 CF flange bolt load, head thickness
Misc.nb	main vessel: distance between openings, blind mounting hole depth, reinforcement of blind holes on CF flanges mounted on 10.5" Ø CF flange, impact testing
Fracture_critical_mat'l.nb	K_{ic} , K_I , critical crack lengths, Life cycles
Fragmant.nb	shielding calculations

(* Energy in Xenon Pressure Vessel *)

]

MAWP = 978

P₁ = MAWP

P₂ = 14.7

K = 1.66

R₁ = 3.8125

D2 = 1.5

D3 = 2.32

$$V_1 = \frac{\pi (2 R_1)^2}{4} (12.2 - 0.5) (* \text{ in}^3 *)$$

$$V_2 = \frac{\pi (D2)^2}{4} (8.058 - 0.2) (* \text{ in}^3 *)$$

$$V_3 = \frac{\pi (D3)^2}{4} 2.17 (* \text{ in}^3 *)$$

$$V_T = V_1 + V_2 + V_3 (* \text{ in}^3 *)$$

$$\text{Energy} = \frac{P_1 V_T}{12 (K - 1)} \left(1 - \left(\frac{P_2}{P_1} \right)^{\frac{K-1}{K}} \right) (* \text{ ft-lb} *)$$

$$\text{Energy}_{\text{TNT}} = \frac{\text{Energy}}{3414.1} (* \text{ g TNT} *)$$

$$\text{Energy}_{\text{lb}} = \text{Energy}_{\text{TNT}} * 0.002200 (* \text{ lb. TNT} *)$$

978

978

14.7

1.66

3.8125

1.5

2.32

534.263

13.8862

9.1733

557.323

55852.

16.3592

0.0359903

(* From MEDSS, 30 psi is the threshold for fatalities. 0.2 to 15 psi cause physiological damage (ear, lung, etc.) However, the detailed calculation that follow (and proof tests of Conflat heads) show this vessel will leak before catastrophic failure. *)

(* The following is an analysis of the static overpressure in the confined room *)

$$P_{sov} = 1.15 \times 10^4 \frac{\text{Energy}_{1b}}{20 \times 30 \times 10} (* \text{ psig} *)$$


0.0689813

(* The peak overpressure is simply 6X static *)

$$P_{pov} = 6 \times P_{sov} (* \text{ psig} *)$$

0.413888

(*Xenon Pressure Vessel Stress Calculations*)

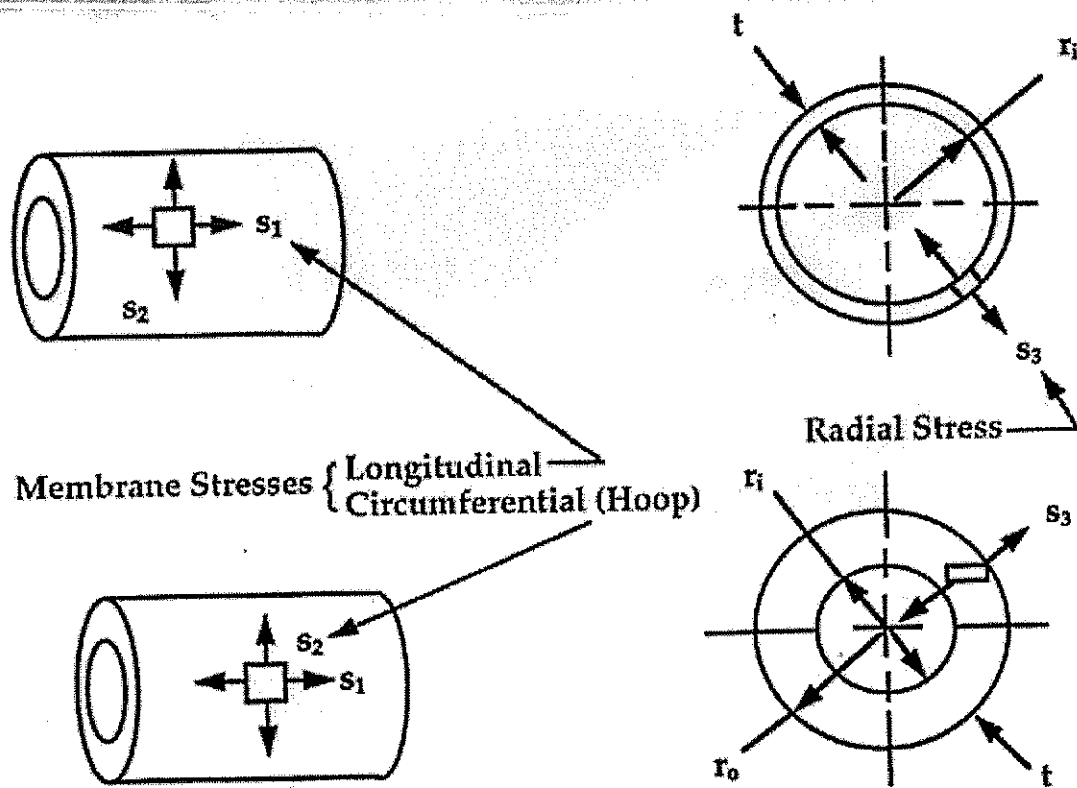


```
In[12]:=
  MAWP = 978
   $\sigma_a$  = 16700 (*allowable stress for 316L SST*)
   $\sigma_y$  = 37000
   $R_i$  = 3.8125
   $R_o$  = 4.3125
   $t = R_o - R_i$ 
  Ratio =  $\frac{R_o}{R_i}$ 
  If [1.1 < Ratio < 1.5, medium wall]
  If [Ratio < 1.1, thin wall]
  If [Ratio > 1.5, thick wall]

Out[12]= 978

Out[13]= 16700

Out[14]= 37000

Out[15]= 3.8125

Out[16]= 4.3125

Out[17]= 0.5

Out[18]= 1.13115

Out[19]= medium wall
```

```
In[22]:=
```

```
(*Longitudinal Stress, S1*)
```

$$S_1 = \frac{(\text{MAWP } R_i^2)}{(R_o^2 - R_i^2)}$$

```
(*Circumferential Stress, S2*)
```

$$S_2 = \frac{\text{MAWP } (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

```
(*Radial Stress, S3*)
```

$$S_3 = -\text{MAWP}$$

```
(*Von Mises Stress*)
```

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

```
Out[22]= 3499.17
```

```
Out[23]= 7976.34
```

```
Out[24]= -978
```

```
Out[25]= 7754.69
```

```

(*wall thickness, in., max. pressure, psi*)

(*Circumferential / Longitudinal Stress: wall thickness, in., max. pressure, psi*)

Ef = 0.7
(*butt weld efficiency based on no inspection, Table UW-12*)
(*Circumferential butt welds connecting
  ellipsoidal head and hub to cylinder are Catagory A/B, Type 1 welds*)

p = 1.67 (* in., longitudinal pitch of tube holes *)
d = 0.5 (* in., diamnter of tube hole*)
Ef11g =  $\frac{p - d}{p}$  (* UG-53, Ligaments *)
If [Ef < Ef11g, Ef = Ef, Ef = Ef11g]

tc =  $\frac{(MAWP R_i)}{(\sigma_a E_f - 0.6 MAWP)}$  (*UG27 c 1*)

Pc =  $\frac{(\sigma_a E_f t)}{(R_i + 0.6 t)}$  (*UG27 c 1*)
SFuc =  $\frac{P_c}{MAWP}$  (* Pc uses allowable stress so SF ~5 is also included*)

t1 =  $\frac{(MAWP R_i)}{(2 \sigma_a E_f + 0.4 MAWP)}$  (*UG27 c 2*)

P1 =  $\frac{(2 \sigma_a E_f t)}{(R_i - 0.4 t)}$  (*UG27 c 2*)
SFu1 =  $\frac{P_1}{MAWP}$  (* P1 uses allowable stress so SF ~5 is also included*)

If[Pc < P1, "circumferential stress applies", "longitudinal stress applies"]
If[tc > t1, "circumferential stress applies", "longitudinal stress applies"]

Out[15]= 0.7
Out[16]= 1.67
Out[17]= 0.5
Out[18]= 0.700599
Out[19]= 0.7
Out[20]= 0.335815
Out[21]= 1421.28
Out[22]= 1.45325
Out[23]= 0.156855

```

Out[189]= 3235.99

Out[190]= 13.2351

Out[191]= circumferential stress applies

Out[192]= circumferential stress applies

(*Check of Von Mises stress at $1.5 \times \text{MAWP}$ for pressure test*)
 $\text{MAWP} = 1.5 \times 978$

(*Longitudinal Stress, S_1 *)

$$S_1 = \frac{(\text{MAWP } R_i^2)}{(R_o^2 - R_i^2)}$$

(*Circumferential Stress, S_2 *)

$$S_2 = \frac{\text{MAWP } (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

(*Radial Stress, S_3 *)

$$S_3 = -\text{MAWP}$$

(*Von Mises Stress*)

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

$$N_x = \frac{\sigma_y}{\sigma_m}$$

If[$N_x > 1$, "vessel OK at $1.5 \times \text{MAWP}$ during pressure test"]

1467.

5248.76

11964.5

-1467.

11632.

3.18087

vessel OK at $1.5 \times \text{MAWP}$ during pressure test

(*Xenon Pressure Vessel Stress Calculations*)
 (*Ellipsoidal Head*)

In[704]:=

MAWP = 978
 $\sigma_a = 16700$ (*allowable stress for 304 SST*)
 $\sigma_y = 32000$
 $D_i = 7.625$
 $t_w = 0.5$
 (*Circumferential butt welds connecting
 ellipsoidal head and hub to cylinder are Catagory A, Type 1 welds*)
 $E_f = 0.7$ (*butt weld efficiency based on no inspection, Table UW-12*)

Out[704]= 978

Out[705]= 16700

Out[706]= 32000

Out[707]= 7.625

Out[708]= 0.5

Out[709]= 0.7

In[710]:= (*Wall thickness, in., max. pressure, psi*)

(*Circumferential Stress: wall thickness, in., max. pressure, psi*)

$$t_h = \frac{(MAWP D_i)}{(2 \sigma_a E_f - 0.2 MAWP)} \quad (*UG32 (d)*)$$

$$P_m = \frac{(2 \sigma_a E_f t_w)}{(D_i + 0.2 t_w)} \quad (*UG32 (d)*)$$

$$SF_{uc} = \frac{P_m 4}{MAWP}$$

Out[710]= 0.321649

Out[711]= 1513.27

Out[712]= 6.18924

In[713]:=

(*Check of stress at 1.5 x MAWP for pressure test*)
 MAWP = 1.5 x 978

$$\text{Solve}\left[\text{MAWP} == \frac{(2 \sigma E_f t_w)}{(D_i + 0.2 t_w)}, \sigma\right]$$

$$SF_y = \frac{\sigma_y}{\sigma}$$

Out[713]= 1467.

Out[714]= {{σ → 16189.4}}

Out[715]= $\frac{32000}{\sigma}$

16,700

16,189.4

> 1.0

✓ ✓

(*Xenon Pressure Vessel Stress Calculations*)
 (*Ellipsoidal Head, LN2 Trap*)

In[716]:=

MAWP = 978
 $\sigma_a = 16700$ (*allowable stress for 304 SST*)
 $\sigma_y = 32000$
 $D_i = 1.5$
 $t_w = 0.2$
 (*Circumferential butt welds connecting
 ellipsoidal head and hub to cylinder are Catagory A, Type 1 welds*)
 $E_f = 0.7$ (*butt weld efficiency based on no inspection, Table UW-12*)

Out[716]= 978

Out[717]= 16700

Out[718]= 32000

Out[719]= 1.5

Out[720]= 0.2

Out[721]= 0.7

In[722]:= (*Wall thickness, in., max. pressure, psi*)

(*Circumferential Stress: wall thickness, in., max. pressure, psi*)

$$t_h = \frac{(MAWP D_i)}{(2 \sigma_a E_f - 0.2 MAWP)} \quad (*UG32 (d) *)$$

$$P_m = \frac{(2 \sigma_a E_f t_w)}{(D_i + 0.2 t_w)} \quad (*UG32 (d) *)$$

$$SF_{uc} = \frac{P_m 4}{MAWP}$$

Out[722]= 0.0632753

Out[723]= 3036.36

Out[724]= 12.4187

In[725]:=

(*Check of stress at 1.5 x MAWP for pressure test*)

MAWP = 1.5 x 978

Solve[MAWP == $\frac{(2 \sigma E_f t_w)}{(D_i + 0.2 t_w)}$, σ]

SF_y = $\frac{\sigma_y}{\sigma}$


Out[725]= 1467.

Out[726]= {{ $\sigma \rightarrow 8068.5$ }}


Out[727]= $\frac{32000}{\sigma}$

$$\frac{161700}{8068.5} \approx 1$$

(2.07)

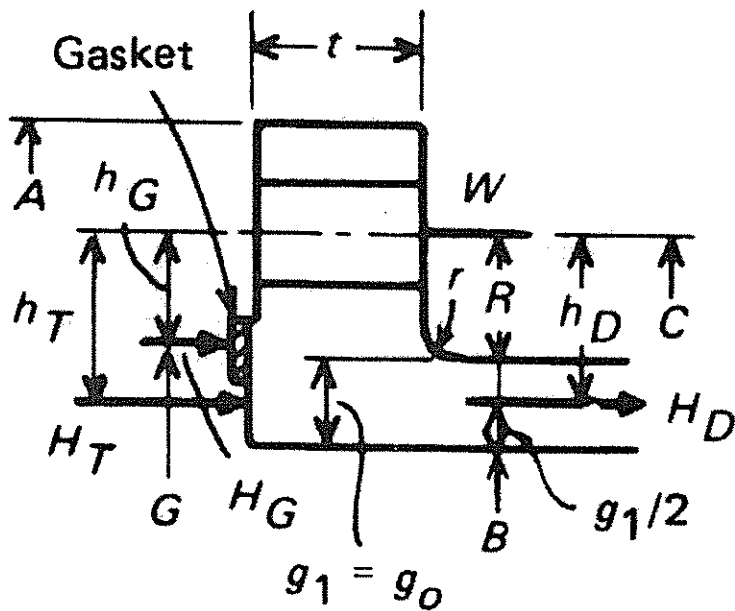

(5)

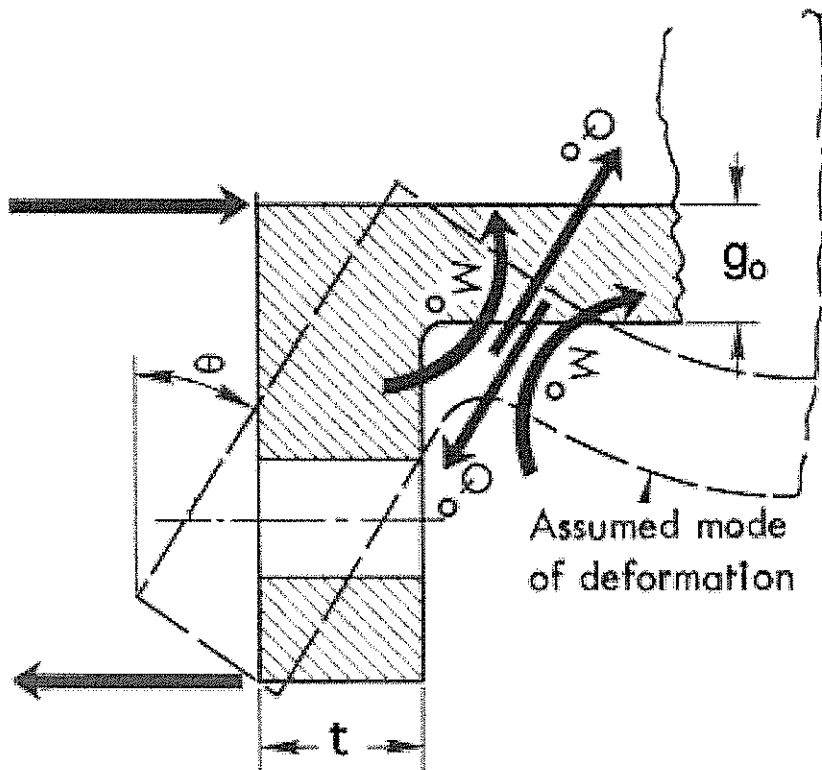

- (* Bolted Flange Connections with Ring Type Joint *)
- (* Integral Flange Type, Appendix 2, Figure 2-4 (5) shown above *)
- (* 850 psia MOP, custom flange, ring type joint, metal seal *)

```
In[1]:= (* Bolt Load at operating conditions *)

G = 7.980 (* Diameter, in. at gasket load location *)
P = 978 (* MAWP, internal design pressure *)
m = 6.5 (* gasket factor ring joint, Table 2-4.1 *)
Ng = 0.25 (* width of ring type gasket *)
bo =  $\frac{N_g}{8}$  (* Table 2-5.2 (6) *)
If[bo <= 0.25, b = bo, b = .5  $\sqrt{b_o}$ ]
y = 26000 (* psi, design seating stress for metal seal, Table 2-5.1 *)
H = 0.785 G2 P (* lb., Total hydrostatic end force *)
Hp = 2 b × π G m P (* lb., Total joint-contact surface compression load *)
Wm1 = H + Hp (* Minimum required bolt load, for operating *)
Wm2 = π G b y (* Minimum required bolt load, for gasket seating *)

Out[1]= 7.98

Out[2]= 978

Out[3]= 6.5

Out[4]= 0.25

Out[5]= 0.03125

Out[6]= 0.03125

Out[7]= 26000

Out[8]= 48889.4

Out[9]= 9960.59

Out[10]= 58849.9

Out[11]= 20369.3
```

```

(* Flange Design Bolt Load*)
Ab = 0.1406 × 24 (*cross sectional area of 1/2-13 screw*)
SF = 4 (* MEDSS *)
ST = 81000
(*Unbrako - KS 1216 1/2-13 SHCS, 160, ksi tensile strength; T = -400 °F to 1200 °F
OR ASTM-A493-95 Grade S30430; 81 ksi tensile strength *)
Sa = ST ÷ SF
Lb = Sa × Ab (* lb., Max allowable bolt load *)
Am1 = Wm1 / Sa (* in2, cross-sectional area of bolts under operating condition *)
Am2 = Wm2 / Sa (* in2, cross-sectional area of bolts for gasket seating *)
If[Am1 > Am2, Am = Am1, Am = Am2]
(* in2, total required cross-sectional area of bolts *)

Wo = Wm1 (* lb., Flange design bolt load, for operating *)
Wg =  $\frac{(A_m + A_b) S_a}{2}$  (* lb., Flange design bolt load, for gasket seating *)

```

Out[12]= 3.3744

Out[13]= 4

Out[14]= 81000

Out[15]= 20250

Out[16]= 68331.6

Out[17]= 2.90617

Out[18]= 1.00589

Out[19]= 2.90617

Out[20]= 58849.9

Out[21]= 63590.8

```

In[22]:=
(* Flange Moment *)
(* Table 2-6, integral flange *)
Cb = 9.58 (* in., bolt circle diameter *)
g1 = 0.5 (* in., hub flange thickness *)
B = 7.625 (* in., inside diameter of flange *)
test = 20 g1
R =  $\frac{(C_b - B)}{2} - g_1$ 
hD =
R + 0.5 g1 (* in., radial distance from bolt circle to the circle on which hD acts *)
hG =  $\frac{(C_b - G)}{2}$ 
hT =  $\frac{(R + g_1 + h_G)}{2}$ 
HD = 0.785 B2 P (* lb., total hydrostatic force on area inside of flange *)
MD = HD hD

HT = H - HD
(* lb., difference, total hydrostatic end force less HD *)
MT = HT hT

HG = Wo - H (* lb., gasket load *)
MG = HG hG

Mo = MD + MT + MG (* in-lb., total flange moment due to operating conditions *)

My = Wo  $\frac{(C_b - G)}{2}$  (* in-lb., total flange moment due to gasket seating *)
If[Mo > My, "operating conditions control", "gasket seating conditions control"]
If[Mo > My, Mo = Mo, Mo = My]

```

Out[22]= 9.58

Out[23]= 0.5

Out[24]= 7.625

Out[25]= 10.

Out[26]= 0.4775

Out[27]= 0.7275

Out[28]= 0.8

Out[29]= 0.88875

Out[30]= 44636.3

Out[31]= 32472.9

Out[32]= 4253.05

Out[33]= 3779.9

```

Out[120]= 9960.59

Out[121]= 7968.47

Out[122]= 44221.3

Out[123]= 47080.

Out[124]= gasket seating conditions control

Out[125]= 47080.

In[126]:= (*Flange Stress *)

e = 1 (*hub stress correction factor*)
t = 1.25 (* in., flange thickness *)
h = 0.125 (* in., hub length *)
te = 2 g1
A = 10.5 (* in., OD of flange *)
K = A / B


$$T = \frac{K^2 (1 + 8.55246 \log[10, K]) - 1}{(1.04720 + 1.9448 K^2) (K - 1)} \quad (* \text{ factor, Fig. 2-7.1*})$$



$$U = \frac{K^2 (1 + 8.55246 \log[10, K]) - 1}{1.36136 (K^2 - 1) (K - 1)} \quad (* \text{ factor, Fig. 2-7.1*})$$



$$Y = \frac{1}{K - 1} \left( 0.66845 + 5.71690 \frac{K^2 \log[10, K]}{(K^2 - 1)} \right) \quad (* \text{ factor, Fig. 2-7.1*})$$



$$Z = \frac{K^2 + 1}{K^2 - 1} \quad (* \text{ factor, Fig. 2-7.1*})$$


g0 = g1
g1 / g0
h0 =  $\sqrt{B g_0}$ 
h / h0
V = 0.550103 (* Fig. 2-7.3 Integral flange factor *)


$$d_f = \frac{U}{V} h_0 g_0^2$$



$$L = \frac{t_e + 1}{T} + \frac{t^3}{d_f}$$



$$S_R = \frac{e M_0}{L g_1^2 B} \quad (* \text{ psi, Longitudinal hub stress *})$$



$$S_R = \frac{(1.33 t_e + 1) M_0}{L t^2 B} \quad (* \text{ psi, Radial flange stress *})$$


(* psi, Tangential flange stress *)


$$S_T = \frac{Y M_0}{t^2 B} - Z S_R$$


Out[126]= 1

Out[127]= 1.25

Out[128]= 0.125

Out[129]= 1.

Out[130]= 10.5

```

```

Out[131]= 1.37705

Out[132]= 1.7642

Out[133]= 6.84641

Out[134]= 6.23025

Out[135]= 3.23148

Out[136]= 0.5

Out[137]= 1.

Out[138]= 1.95256

Out[139]= 0.0640184

Out[140]= 0.550103

Out[141]= 6.07525

Out[142]= 1.45515

Out[143]= 16972.6

Out[144]= 6327.39

Out[145]= 4172.77

In[146]:=
  (* Allowable Flange Stress *)

  Sf = 16700 (* allowable stress for 316L -20 to 100 °F, Table 1A, Section II *)
  If[SH < 1.5 Sf, "hub stress OK", "hub stress too large"]
  If[SR < Sf, "radial stress OK", "radial stress too large"]
  If[ST < Sf, "tangential stress OK", "tangential stress too large"]
  If[ $\frac{S_H + S_R}{2}$  < Sf, "average stress1 OK", "average stress1 too large"]
  If[ $\frac{S_H + S_T}{2}$  < Sf, "average stress2 OK", "average stress2 too large"]

Out[146]= 16700

Out[147]= hub stress OK


Out[148]= radial stress OK

Out[149]= tangential stress OK


Out[150]= average stress1 OK

Out[151]= average stress2 OK

```

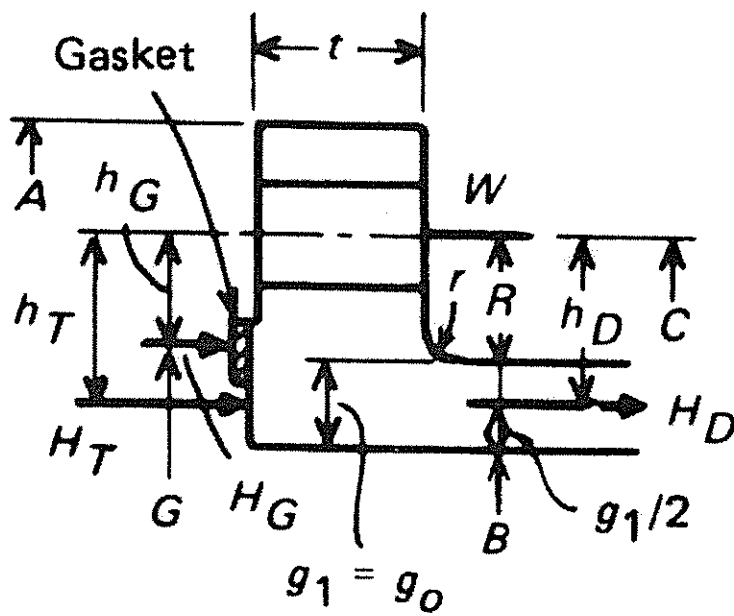

(5)

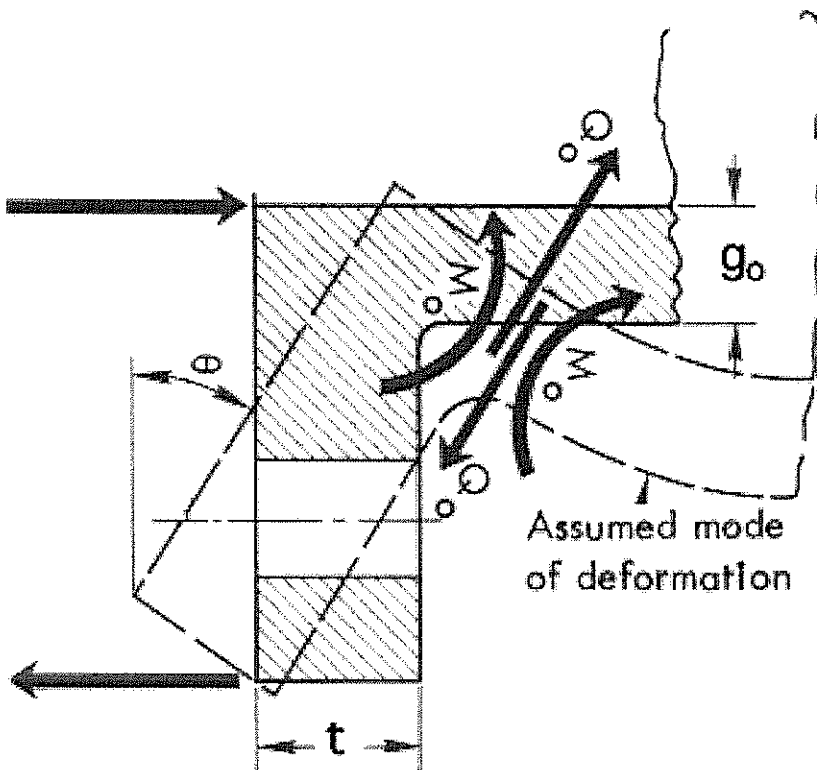

(* Bolted Flange Connections

with flat metal Copper Gasket, Xe chamber Detector Port *)

(* Integral Flange Type, Appendix 2, Figure 2-4 (5) shown above *)

(* 850 psia MOP, conflat type head *)

```

In[249]:= (* Bolt Load at operating conditions *)

G = 3.35 (* Diameter, in. at gasket load location *)
P = 978 (* MAWP, internal design pressure *)
m = 4.75 (* gasket factor flat Cu gasket, Table 2-4.1 *)
Ng = 0.5 (* width of Cu gasket *)
bo =  $\frac{N_g}{32}$  (* N/4 for multiple serrations Table 2-5.2 (5),
    assume N/32 given a single knife edge serration as used in Conflats *)
If[bo <= 0.25, b = bo, b = .5 √ bo]
y = 13000 (* psi, design seating stress for soft copper, Table 2-5.1 *)
H = 0.785 G2 P (* lb., Total hydrostatic end force *)
Hp = 2 b × π G m P (* lb., Total joint-contact surface compression load *)
Wm1 = H + Hp (* Minimum required bolt load, for operating *)
Wm2 = π G b y (* Minimum required bolt load, for gasket seating *)

Out[249]= 3.35

Out[250]= 978

Out[251]= 4.75

Out[252]= 0.5

Out[253]= 0.015625

Out[254]= 0.015625

Out[255]= 13000

Out[256]= 8615.85

Out[257]= 1527.84

Out[258]= 10143.7

Out[259]= 2137.76

```



```

In[12]:= (* Flange Design Bolt Load*)
Ab = 0.0519 × 10 (*cross sectional area of 5/16-24 screw*)
SF = 4 (* MEDSS *)
ST = 81000
(*Unbrako - KS 1216 5/16-24 SHCS, 160, ksi tensile strength; T = -400 °F to 1200 °F
OR ASTM-A493-95 Grade S30430; 81 ksi tensile strength *)
Sa = ST + SF
Lb = Sa × Ab (* lb., Max allowable bolt load *)
Am1 = Wm1 / Sa (* in2, cross-sectional area of bolts under operating condition *)
Am2 = Wm2 / Sa (* in2, cross-sectional area of bolts for gasket seating *)
If[Am1 > Am2, Am = Am1, Am = Am2]
(* in2, total required cross-sectional area of bolts *)

Wo = Wm1 (* lb., Flange design bolt load, for operating *)
Wg =  $\frac{(A_m + A_b) S_a}{2}$  (* lb., Flange design bolt load, for gasket seating *)

Out[12]= 0.519
Out[13]= 4
Out[14]= 81000
Out[15]= 20250
Out[16]= 10509.7
Out[17]= 0.500923
Out[18]= 0.105568
Out[19]= 0.500923
Out[20]= 10143.7
Out[21]= 10326.7

```

```

In[332]:=
(* Flange Moment *)
(* Table 2-6, integral flange *)
Cb = 4.030 (* in., bolt circle diameter *)
g1 = 0.275 (* in., hub flange thickness *)
B = 2.32 (* in., inside diameter of flange *)
test = 20 g1 (* Refer to Appx 2, 2-3 notations, for design options *)
R =  $\frac{(C_b - B)}{2} - g_1$ 
hD =
  R + 0.5 g1 (* in., radial distance from bolt circle to the circle on which hD acts *)
hG =  $\frac{(C_b - G)}{2}$ 
hT =  $\frac{(R + g_1 + h_G)}{2}$ 
HD = 0.785 B2 P (* lb., total hydrostatic force on area inside of flange *)
MD = HD hD
HT = H - HD
(* lb., difference, total hydrostatic end force less HD *)
MT = HT hT
HG = W0 - H (* lb., gasket load *)
MG = HG hG
MO = MD + MT + MG (* in-lb., total flange moment due to operating conditions *)
MG = W0  $\frac{(C_b - G)}{2}$  (* in-lb., total flange moment due to gasket seating *)
If[MO > MG, "operating conditions control", "gasket seating conditions control"]
If[MO > MG, MO = MG, MO = MG]

```

```
Out[332]= 4.03
```

```
Out[333]= 0.275
```

```
Out[334]= 2.32
```

```
Out[335]= 5.5
```

```
Out[336]= 0.58
```

```
Out[337]= 0.7175
```

```
Out[338]= 0.34
```

```
Out[339]= 0.5975
```

```
Out[340]= 4132.23
```

```
Out[341]= 2964.87
```

```
Out[342]= 4483.62
```

```
Out[343]= 2678.96
```

Out[185]= 1527.84

Out[186]= 519.465

Out[187]= 6163.3

Out[188]= 3448.85

Out[189]= operating conditions control

Out[190]= 6163.3

In[191]:= (*Flange Stress *)

$\epsilon = 1$ (*hub stress correction factor*)

$t = 0.81$ (* in., flange thickness *)

$h = 0.0$ (* in., hub length *)

$t_o = 2 g_1$

$A = 4.63$ (* in., OD of flange *)

$K = A/B$

$T = \frac{K^2 (1 + 8.55246 \log[10, K]) - 1}{(1.04720 + 1.9448 K^2) (K - 1)}$ (* factor, Fig. 2-7.1*)

$U = \frac{K^2 (1 + 8.55246 \log[10, K]) - 1}{1.36136 (K^2 - 1) (K - 1)}$ (* factor, Fig. 2-7.1*)

$Y = \frac{1}{K - 1} \left(0.66845 + 5.71690 \frac{K^2 \log[10, K]}{(K^2 - 1)} \right)$ (* factor, Fig. 2-7.1*)

$Z = \frac{K^2 + 1}{K^2 - 1}$ (* factor, Fig. 2-7.1*)

$g_o = g_1$

g_1 / g_o

$h_o = \sqrt{B g_o}$

h / h_o

$V = 0.550103$ (* Fig. 2-7.3 Integral flange factor *)

$d_f = \frac{U}{V} h_o g_o^2$

$L = \frac{t_o + 1}{T} + \frac{t^3}{d_f}$

$S_B = \frac{\epsilon M_o}{L g_1^2 B}$ (* psi, Longitudinal hub stress *)

$S_R = \frac{(1.33 t_o + 1) M_o}{L t^2 B}$ (* psi, Radial flange stress *)

(* psi, Tangential flange stress *)

$S_T = \frac{Y M_o}{t^2 B} - Z S_R$

Out[191]= 1

Out[192]= 0.81

Out[193]= 0.

Out[194]= 0.55

Out[195]= 4.63

```


Out[196]= 1.99569
Out[197]= 1.50825
Out[198]= 3.26596
Out[199]= 2.97203
Out[200]= 1.67052
Out[201]= 0.275
Out[202]= 1.
Out[203]= 0.798749
Out[204]= 0.
Out[205]= 0.550103
Out[206]= 0.358627
Out[207]= 2.50956
Out[208]= 13997.9
Out[209]= 2793.7
Out[210]= 7367.04

In[211]:=
(* Allowable Flange Stress *)


Sf = 16700 (* allowable stress for 304 L -20 to 100 °F, Table 1A, Section II *)
If[SH < 1.5 Sf, "hub stress OK", "hub stress too large"]
If[SR < Sf, "radial stress OK", "radial stress too large"]
If[ST < Sf, "tangential stress OK", "tangential stress too large"]
If[ $\frac{S_H + S_R}{2}$  < Sf, "average stress1 OK", "average stress1 too large"]
If[ $\frac{S_H + S_R}{2}$  < Sf, "average stress2 OK", "average stress2 too large"]

Out[211]= 16700
Out[212]= hub stress OK
Out[213]= radial stress OK
Out[214]= tangential stress OK
Out[215]= average stress1 OK
Out[216]= average stress2 OK

```

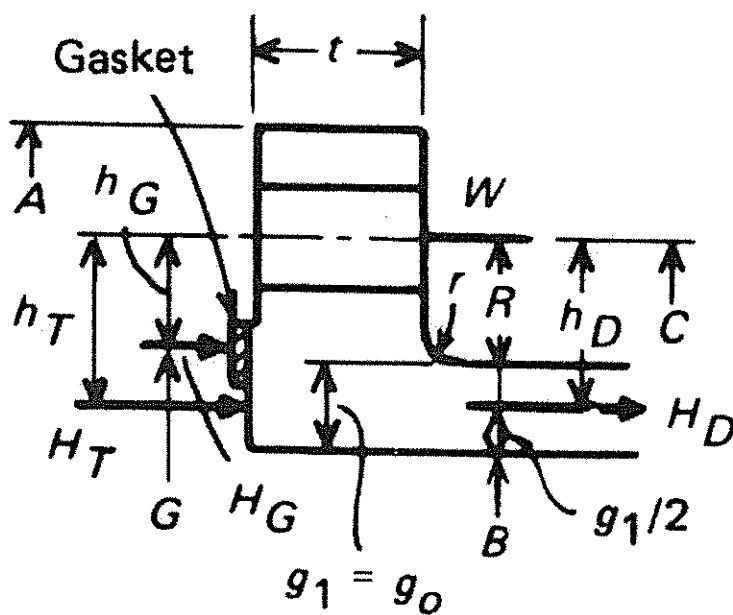

(5)

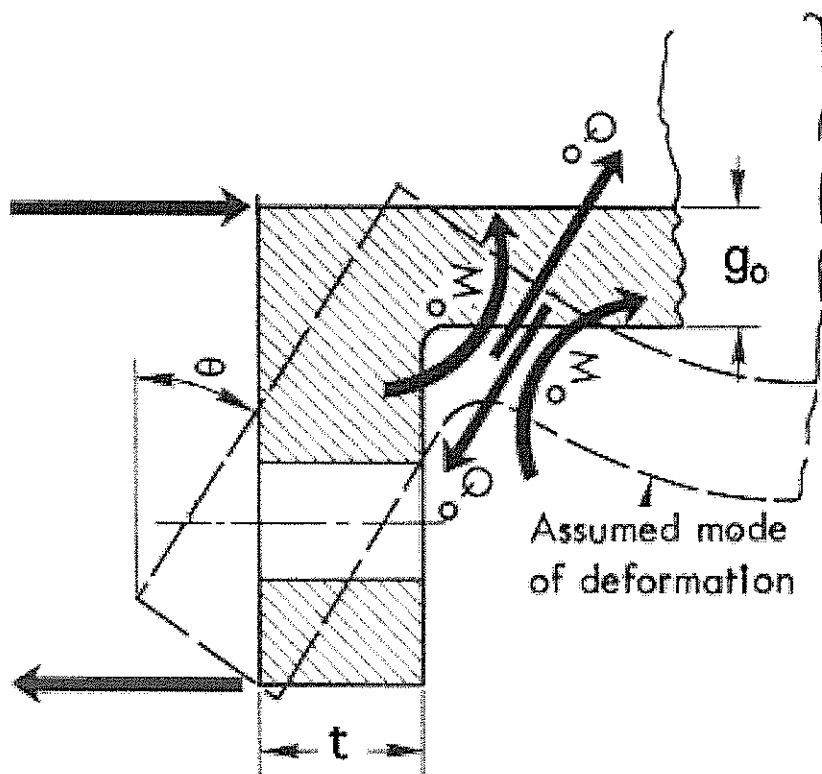

- (* Bolted Flange Connections with flat metal Copper Gasket *)
- (* Integral Flange Type, Appendix 2, Figure 2-4 (5) shown above *)
- (* 350 psia MOP, conflat type head *)

```
In[184]:= (* Bolt Load at operating conditions *)

G = 8.54 (* Diameter, in. at gasket load location *)
P = 403 (* MAWP, internal design pressure *)
m = 4.75 (* gasket factor flat Cu gasket, Table 2-4.1 *)
Ng = 0.5 (* width of Cu gasket *)
bo =  $\frac{N_g}{32}$  (* N/4 for multiple serrations Table 2-5.2 (5),
  assume N/32 given a single knife edge serration as used in Conflats *)
b = bo
Y = 13000 (* psi, design seating stress for soft copper, Table 2-5.1 *)
H = 0.785 G2 P (* lb., Total hydrostatic end force *)
Hp = 2 b × π G m P (* lb., Total joint-contact surface compression load *)
Wm1 = H + Hp (* Minimum required bolt load, for operating *)
Wm2 = π G b Y (* Minimum required bolt load, for gasket seating *)

Out[184]= 8.54

Out[185]= 403

Out[186]= 4.75

Out[187]= 0.5

Out[188]= 0.015625

Out[189]= 0.015625

Out[190]= 13000

Out[191]= 23072.3

Out[192]= 1604.93

Out[193]= 24677.2

Out[194]= 5449.68
```

```

In[33]:= (* Flange Design Bolt Load*)
Ab = 0.1406 × 24 (*cross sectional area of 1/2-13 screw*)
SF = 4 (* MEDSS *)
ST = 81000
(*Unbrako - KS 1216 1/2-13 SHCS, 160, ksi tensile strength; T = -400 °F to 1200 °F
OR ASTM-A493-95 Grade S30430; 81 ksi tensile strength *)
Sa = ST / SF
Lb = Sa × Ab (* lb., Max allowable bolt load *)
Am1 = Wm1 / Sa (* in2, cross-sectional area of bolts under operating condition *)
Am2 = Wm2 / Sa (* in2, cross-sectional area of bolts for gasket seating *)
If[Am1 > Am2, Am = Am1, Am = Am2]
(* in2, total required cross-sectional area of bolts *)

Wo = Wm1 (* lb., Flange design bolt load, for operating *)
Wg =  $\frac{(A_m + A_b) S_a}{2}$  (* lb., Flange design bolt load, for gasket seating *)

Out[33]= 3.3744

Out[34]= 4

Out[35]= 81000

Out[36]= 20250

Out[37]= 68331.6

Out[38]= 1.21863

Out[39]= 0.26912

Out[40]= 1.21863

Out[41]= 24677.2

Out[42]= 46504.4

```

In[205]:=

```
(* Flange Moment *)
(* Table 2-6, integral flange *)
Cb = 9.58 (* in., bolt circle diameter *)
g1 = 0.5 (* in., hub flange thickness *)
B = 7.625 (* in., inside diameter of flange *)
test = 20 g1
R =  $\frac{(C_b - B)}{2} - g_1$ 
hD =
  R + 0.5 g1 (* in., radial distance from bolt circle to the circle on which hD acts *)
hG =  $\frac{(C_b - G)}{2}$ 
hT =  $\frac{(R + g_1 + h_G)}{2}$ 
HD = 0.785 B2 P (* lb., total hydrostatic force on area inside of flange *)
MD = HD hD
HT = H - HD
(* lb., difference, total hydrostatic end force less HD *)
MT = HT hT
HG = W0 - H (* lb., gasket load *)
MG = HG hG
MO = MD + MT + MG (* in-lb., total flange moment due to operating conditions *)
MG = W0  $\frac{(C_b - G)}{2}$  (* in-lb., total flange moment due to gasket seating *)
If[MO > MG, "operating conditions control", "gasket seating conditions control"]
If[MO > MG, MO = MG, MO = MG]
```

Out[205]= 9.58

Out[206]= 0.5

Out[207]= 7.625

Out[208]= 10.

Out[209]= 0.4775

Out[210]= 0.7275

Out[211]= 0.52

Out[212]= 0.74875

Out[213]= 18393.1

Out[214]= 13381.

Out[215]= 4679.2

Out[216]= 3503.55


```

Out[250]= 1604.93

Out[251]= 834.564

Out[252]= 17719.1

Out[253]= 12832.1

Out[254]= operating conditions control

Out[255]= 17719.1

In[256]:= (*Flange Stress *)

e = 1 (*hub stress correction factor*)
t = 1.25 (* in., flange thickness *)
h = 0.125 (* in., hub length *)
to = 2 g1
A = 10.5 (* in., OD of flange *)
K = A / B


$$T = \frac{K^2 (1 + 8.55246 \log[10, K]) - 1}{(1.04720 + 1.9448 K^2) (K - 1)} \quad (* \text{ factor, Fig. 2-7.1*})$$



$$U = \frac{K^2 (1 + 8.55246 \log[10, K]) - 1}{1.36136 (K^2 - 1) (K - 1)} \quad (* \text{ factor, Fig. 2-7.1*})$$



$$Y = \frac{1}{K - 1} \left( 0.66845 + 5.71690 \frac{K^2 \log[10, K]}{(K^2 - 1)} \right) \quad (* \text{ factor, Fig. 2-7.1*})$$



$$Z = \frac{K^2 + 1}{K^2 - 1} \quad (* \text{ factor, Fig. 2-7.1*})$$


go = g1
g1 / go
ho =  $\sqrt{B g_o}$ 
h / ho
V = 0.550103 (* Fig. 2-7.3 Integral flange factor *)


$$d_f = \frac{U}{V} h_o g_o^2$$



$$L = \frac{t_o + 1}{T} + \frac{t^3}{d_f}$$



$$S_H = \frac{e M_o}{L g_1^2 B} \quad (* \text{ psi, Longitudinal hub stress *})$$



$$S_R = \frac{(1.33 t_o + 1) M_o}{L t^2 B} \quad (* \text{ psi, Radial flange stress *})$$


(* psi, Tangential flange stress *)


$$S_T = \frac{Y M_o}{t^2 B} - Z S_R$$


Out[256]= 1

Out[257]= 1.25

Out[258]= 0.125

Out[259]= 1.

Out[260]= 10.5

```

```

Out[261]= 1.37705

Out[262]= 1.7642

Out[263]= 6.84641

Out[264]= 6.23025

Out[265]= 3.23148

Out[266]= 0.5

Out[267]= 1.

Out[268]= 1.95256

Out[269]= 0.0640184

Out[270]= 0.550103

Out[271]= 6.07525

Out[272]= 1.45515

Out[273]= 6387.84

Out[274]= 2381.39

Out[275]= 1570.47

In[276]:=
  (* Allowable Flange Stress *)

  Sf = 16700 (* allowable stress for 316L -20 to 100 °F, Table 1A, Section II *)
  If[SH < 1.5 Sf, "hub stress OK", "hub stress too large"]
  If[SR < Sf, "radial stress OK", "radial stress too large"]
  If[ST < Sf, "tangential stress OK", "tangential stress too large"]
  If[ $\frac{S_H + S_R}{2}$  < Sf, "average stress1 OK", "average stress1 too large"]
  If[ $\frac{S_H + S_T}{2}$  < Sf, "average stress2 OK", "average stress2 too large"]

Out[276]= 16700

Out[277]= hub stress OK

Out[278]= radial stress OK


Out[279]= tangential stress OK

Out[280]= average stress1 OK

Out[281]= average stress2 OK

```

(*Xenon Pressure Vessel Stress Calculations - Detector Port*)

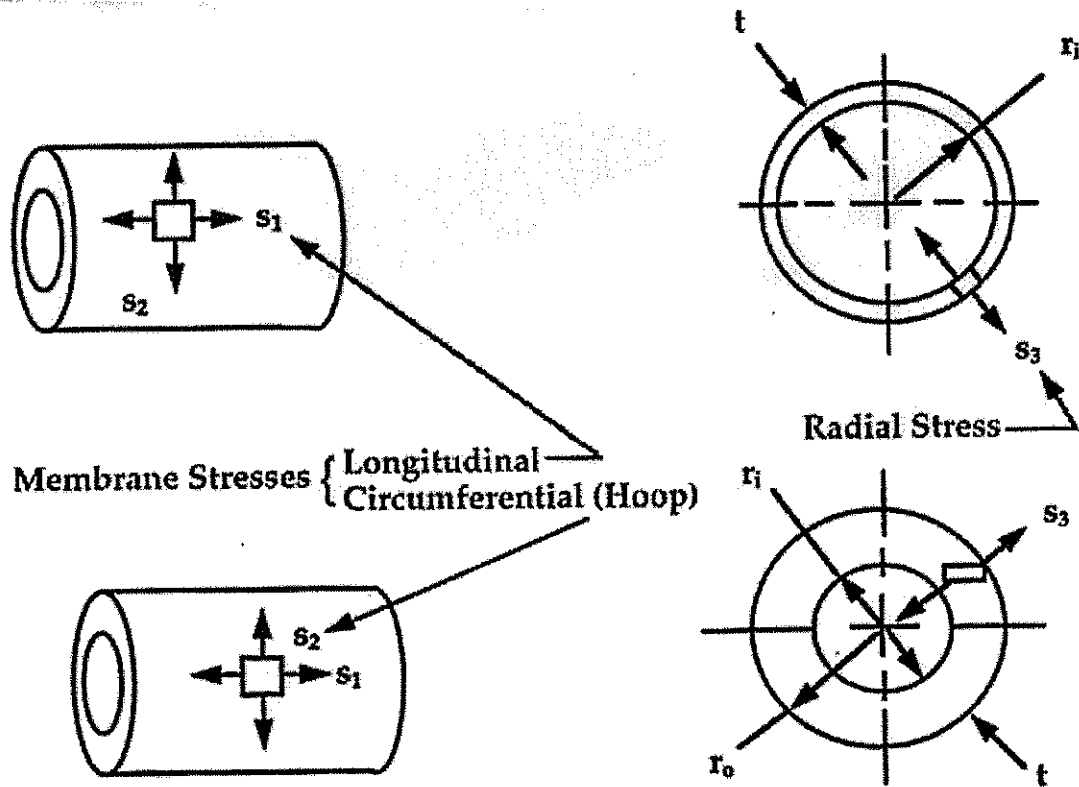

```
In[376]:=
  MAWP = 978
   $\sigma_a$  = 16700 (*allowable stress for 316 L SST*)
   $\sigma_y$  = 37000
   $R_i$  = 1.1615
   $R_o$  = 1.4375
   $t = R_o - R_i$ 
  Ratio =  $\frac{R_o}{R_i}$ 
  If [1.1 < Ratio < 1.5, medium wall]
  If [Ratio < 1.1, thin wall]
  If [Ratio > 1.5, thick wall]

Out[376]= 978

Out[377]= 16700

Out[378]= 37000

Out[379]= 1.1615

Out[380]= 1.4375

Out[381]= 0.276

Out[382]= 1.23762

Out[383]= medium wall
```

```
In[386]:=
```

```
(*Longitudinal Stress, S1*)
```

$$S_1 = \frac{(MAWP R_i^2)}{(R_o^2 - R_i^2)}$$

```
(*Circumferential Stress, S2*)
```

$$S_2 = \frac{MAWP (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

```
(*Radial Stress, S3*)
```

$$S_3 = -MAWP$$

```
(*Von Mises Stress*)
```

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

```
Out[386]= 1839.34
```

```
Out[387]= 4656.68
```

```
Out[388]= -978
```

```
Out[389]= 4879.78
```

```

In[42]:=
(*wall thickness, in., max. pressure, psi*)

(*Circumferential Stress: wall thickness, in., max. pressure, psi*)

Ef = 0.7 (*butt weld efficiency based on no inspection, Table UW-12*)


$$t_c = \frac{(MAWP R_i)}{(\sigma_a E_f - 0.6 MAWP)} \quad (*UG27 \text{ c } 1*)$$



$$P_c = \frac{(\sigma_a E_f t)}{(R_i + 0.6 t)} \quad (*UG27 \text{ c } 1*)$$



$$SF_{uc} = \frac{P_c}{MAWP} \quad (* P_c \text{ uses allowable stress so SF } \sim 5 \text{ is also included}*)$$


(*Longitudinal Stress: wall thickness, in., max. pressure, psi*)
(*Circumferential butt welds connecting
ellipsoidal head and hub to cylinder are Category A, Type 1 welds*)

Ef = 0.7 (*butt weld efficiency based on no inspection, Table UW-12*)


$$t_l = \frac{(MAWP R_i)}{(2 \sigma_a E_f + 0.4 MAWP)} \quad (*UG27 \text{ c } 2*)$$



$$P_l = \frac{(2 \sigma_a E_f t)}{(R_i - 0.4 t)} \quad (*UG27 \text{ c } 2*)$$



$$SF_{ul} = \frac{P_l}{MAWP} \quad (* P_l \text{ uses allowable stress so SF } \sim 5 \text{ is also included}*)$$


If[Pc < Pl, "circumferential stress applies", "longitudinal stress applies"]
If[tc > tl, "circumferential stress applies", "longitudinal stress applies"]

Out[42]= 0.7

Out[43]= 0.102308

Out[44]= 2431.2

Out[45]= 2.48589

Out[46]= 0.7

Out[47]= 0.0477867

Out[48]= 6139.17

Out[49]= 6.27727

Out[50]= circumferential stress applies

Out[51]= circumferential stress applies

```

In[400]:=

(*Check of Von Mises stress at 1.5 × MAWP for pressure test*)
MAWP = 1.5 × 978

(*Longitudinal Stress, S_1 *)

$$S_1 = \frac{(\text{MAWP } R_i^2)}{(R_o^2 - R_i^2)}$$

(*Circumferential Stress, S_2 *)

$$S_2 = \frac{\text{MAWP } (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

(*Radial Stress, S_3 *)

$$S_3 = -\text{MAWP}$$

(*Von Mises Stress*)

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

$$N_r = \frac{\sigma_y}{\sigma_m}$$

If [$N_r > 1$, "vessel OK at 1.5 × MAWP during pressure test"]

Out[400]= 1467.

Out[401]= 2759.01

Out[402]= 6985.02

Out[403]= -1467.

Out[404]= 7319.66

Out[405]= 5.05488


Out[406]= vessel OK at 1.5 × MAWP during pressure test

PART UG — GENERAL REQUIREMENTS

Fig. UG-37.1

GENERAL NOTE:

Includes consideration of these areas if $S_n/S_v < 1.0$ (both sides of ϕ)

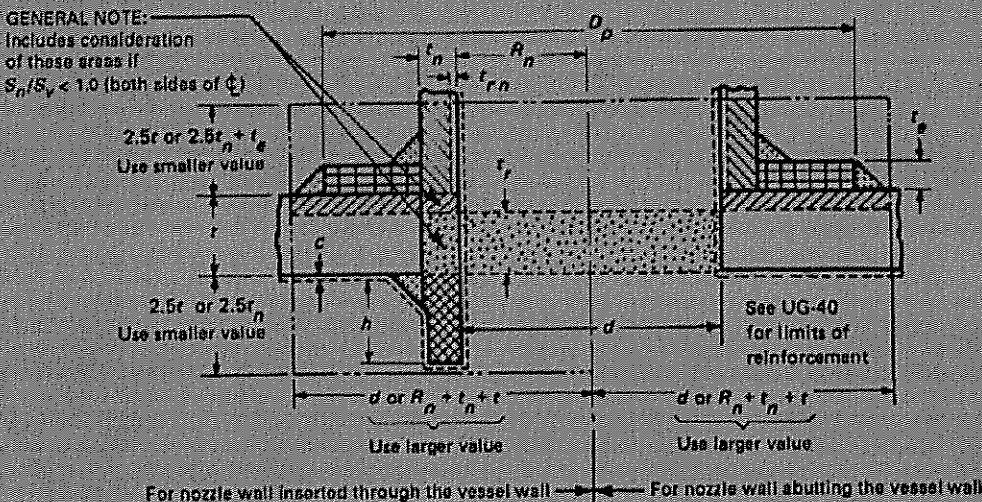

Without Reinforcing Element



$$= A = d t_r F + 2 t_n t_r F (1 - f_{r1})$$

Area required



$$= A_1 \begin{cases} = d(E_1 t - F t_r) - 2 t_n (E_1 t - F t_r) (1 - f_{r1}) \\ = 2(t + t_n)(E_1 t - F t_r) - 2 t_n (E_1 t - F t_r) (1 - f_{r1}) \end{cases}$$

Area available in shell; use larger value



$$= A_2 \begin{cases} = 5(t_n - t_m) f_{r2} t \\ = 8(t_n - t_m) f_{r2} t_n \end{cases}$$

Area available in nozzle projecting outward; use smaller value



$$= A_3 = 2(t_n - c) f_{r2} h$$

Area available in inward nozzle



$$= A_{41} = \text{outward nozzle weld} = (\text{leg})^2 f_{r2}$$

Area available in outward weld



$$= A_{43} = \text{inward nozzle weld} = (\text{leg})^2 f_{r2}$$

Area available in inward weld

$$\text{If } A_1 + A_2 + A_3 + A_{41} + A_{43} \geq A$$

Opening is adequately reinforced

$$\text{If } A_1 + A_2 + A_3 + A_{41} + A_{43} < A$$

Opening is not adequately reinforced so reinforcing elements must be added and/or thicknesses must be increased

With Reinforcing Element Added

$$A = \text{same as } A, \text{ above}$$

Area required

$$A_1 = \text{same as } A_1, \text{ above}$$

Area available

$$A_2 \begin{cases} = 5(t_n - t_m) f_{r2} t \\ = 2(t_n - t_m) (2.5 t_n + t_e) f_{r2} \end{cases}$$

Area available in nozzle projecting outward; use smaller area

$$A_3 = \text{same as } A_3, \text{ above}$$

Area available in inward nozzle



$$= A_{41} = \text{outward nozzle weld} = (\text{leg})^2 f_{r3}$$

Area available in outward weld



$$= A_{42} = \text{outer element weld} = (\text{leg})^2 f_{r4}$$

Area available in outer weld



$$= A_{43} = \text{inward nozzle weld} = (\text{leg})^2 f_{r2}$$

Area available in inward weld



$$= A_5 = (D_p - d - 2 t_n) t_e f_{r4} \quad [\text{Note (1)}]$$

Area available in element

$$\text{If } A_1 + A_2 + A_3 + A_{41} + A_{42} + A_{43} + A_5 \geq A$$

Opening is adequately reinforced

NOTE:

(1) This formula is applicable for a rectangular cross-sectional element that falls within the limits of reinforcement.

FIG. UG-37.1 NOMENCLATURE AND FORMULAS FOR REINFORCED OPENINGS

(This Figure Illustrates a Common Nozzle Configuration and Is Not Intended to Prohibit Other Configurations Permitted by the Code.)


```
(*Opening reinforcement calculations*)
(* Detector pipe to shell wall*)
(* A3 = 0, A5 = 0, A42 = 0 *)

(* Sch 80 Pipe, 3 " Ø *)
Tx = 2.875 (*OD*)
d = 2.323 (*ID min*)
tn = (Tx - d) / 2 (*nozzel wall thickness*)
te = 1.25 * tn (*weld leg height*)

Out[445]= 2.875

Out[446]= 2.323

Out[447]= 0.276

Out[448]= 0.345

In[473]:= F = 1 (*correction factor*)
tr = 0.335815 (*minimum shell thickness, Vessel_stress2.nb*)
fr1 = 1 (*strength reduction factor*)
t = 0.5 (*shell wall thickness*)
E1 = 1 (*joint efficiency*)
A = d tr F + 2 tn tr F (1 - fr1)
A1a = d (E1 t - F tr) - 2 tn (E1 t - F tr) (1 - fr1)
A1b = 2 (t + tn) (E1 t - F tr) - 2 tn (E1 t - F tr) (1 - fr1)
If[A1a > A1b, A1 = A1a, A1 = A1b]

Out[473]= 1

Out[474]= 0.335815

Out[475]= 1

Out[476]= 0.5

Out[477]= 1

Out[478]= 0.780098

Out[479]= 0.381402

Out[480]= 0.254815

Out[481]= 0.381402
```

```

In[482]:= fr2 = 1 (*strength reduction factor*)
          trn = 0.10230807 (*required nozzle thickness, Xe_vessel_det.nb*)
          A2a = 5 (tn - trn) fr2 t
          A2b = 5 (tn - trn) fr2 tn
          If[A2a < A2b, A2 = A2a, A2 = A2b]

Out[482]= 1

Out[483]= 0.10230807

Out[484]= 0.43423

Out[485]= 0.239695

Out[486]= 0.239695

          fr3 = 1 (*strength reduction factor*)
          A43 = te2 fr3
          A41 =  $\frac{te^2 fr3}{2}$  (* 1/2 the area, skip weld on outside*)

Out[492]= 1

Out[493]= 0.119025

Out[494]= 0.0595125

In[498]:= (A1 + A2 + A43 + A41)
          A
          (A1 + A2 + A43 + A41) >= A
          (*If actual area > area required, then no additional reinforcement required *)

Out[498]= 0.799634


Out[499]= 0.780098

Out[500]= True

```

Fig. UG-41.1

1995 SECTION VIII — DIVISION 1

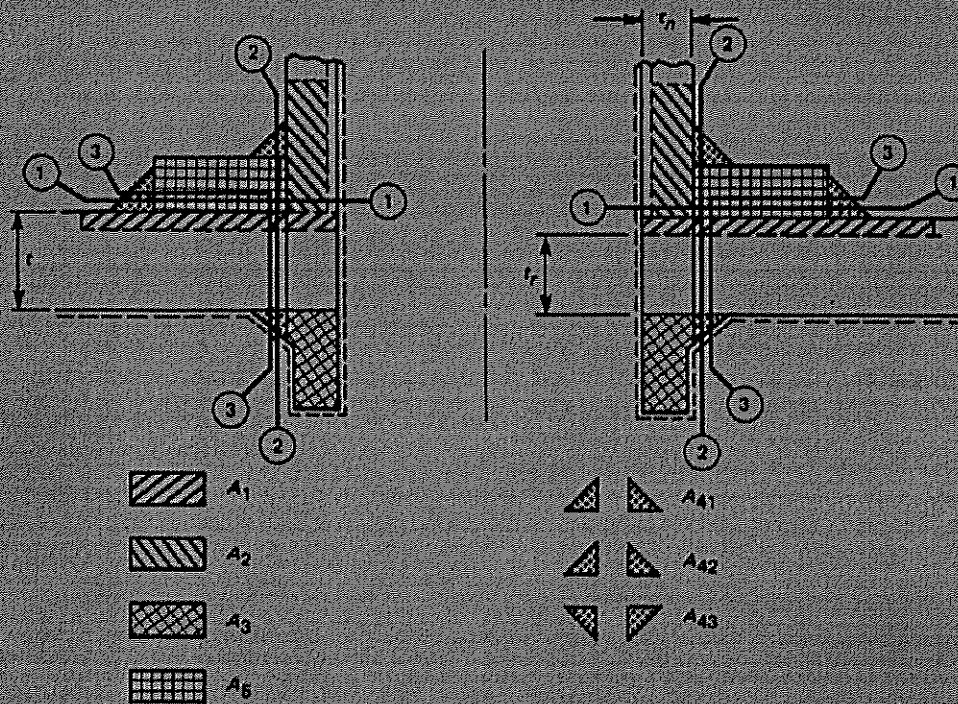

$$\begin{aligned}
 W &= \text{total weld load [UG-41(b)(2)]} \\
 &= [A - A_1 + 2t_n/r_1(E_1t - Fr)]S_v \\
 W_{1-1} &= \text{weld load for strength path 1-1 [UG-41(b)(1)]} \\
 &= [A_2 + A_5 + A_{41} + A_{42}]S_v \\
 W_{2-2} &= \text{weld load for strength path 2-2 [UG-41(b)(1)]} \\
 &= [A_2 + A_3 + A_{41} + A_{43} + 2t_n/r_1]S_v \\
 W_{3-3} &= \text{weld load for strength path 3-3 [UG-41(b)(1)]} \\
 &= [A_2 + A_3 + A_5 + A_{41} + A_{42} + A_{43} + 2t_n/r_1]S_v
 \end{aligned}$$

GENERAL NOTES:

- (a) Areas A_1 , A_2 , A_3 , A_5 , and A_{41} are modified by f_{rx} factors.
 (b) Nomenclature is the same as in UG-37 and Fig. UG-37.1.

(a) Depicts Typical Nozzle Detail With Neck Inserted Through the Vessel Wall

FIG. UG-41.1 NOZZLE ATTACHMENT WELD LOADS AND WELD STRENGTH PATHS TO BE CONSIDERED

(*must run "detector_shell.nb" file first to save variables defined below into memory*)

In[523]:= (*Load / Stress Carried by Welds*)

A
A1
A2
A3 = 0
A5 = 0
A41
A42 = 0
A43

Out[523]= 0.780098

Out[524]= 0.381402

Out[525]= 0.239695

Out[526]= 0

Out[527]= 0

Out[528]= 0.0595125

Out[529]= 0

Out[530]= 0.119025

In[533]:= Sv = 16700 (* allowable stress*)

W = (A - A1 + 2 tn fr1 (E1 t - F tr)) Sv

Out[533]= 16700

Out[534]= 8171.75

In[535]:=

W₁₋₁ = (A2 + A5 + A41 + A42) Sv

Out[535]= 4996.76

In[536]:= W₂₋₂ = (A2 + A3 + A41 + A43 + 2 tn t fr1) Sv

Out[536]= 11593.7

In[537]:=

W₃₋₃ = (A2 + A3 + A5 + A41 + A42 + A43 + 2 tn t fr1) Sv

Out[537]= 11593.7

(* W (total weld load) << W₁₋₁, W₂₋₂, W₃₋₃, (weld load available)*)

In[539]:= (*Allowable Unit Stresses*)

(*Fillet Weld Shear, UW 15 c*)

$\sigma_{fw} = 0.49 (Sv)$

Out[539]= 8183.

```
In[540]:= (*Nozzel Wall Shear, UG 45 c*)
           $\sigma_{nw} = 0.7 (Sv)$ 
```

```
Out[540]= 11690.
```

```
In[541]:= (*Strength of Connection Elements*)
          (*Fillet Weld Shear*)
```

$$W_{fw} = \frac{\pi}{2} T x t e \sigma_{fw}$$

```
Out[541]= 12749.4
```

```
In[542]:= (*Strength of Connection Elements*)
          (*Nozzel Wall Shear*)
```

$$W_{nw} = \frac{\pi}{2} \frac{(Tx + d)}{2} t n \sigma_{nw}$$

```
Out[542]= 13171.9
```


```
In[543]:= WS1-1 = Wnw
          WS2-2 = Wfw
```

```
Out[543]= 13171.9
```

```
Out[544]= 12749.4
```

(*All Paths WS₁₋₁, WS₂₋₂, are stronger than the required strength W*)

(*Xenon Pressure Vessel Stress Calculations - VCR Port*)

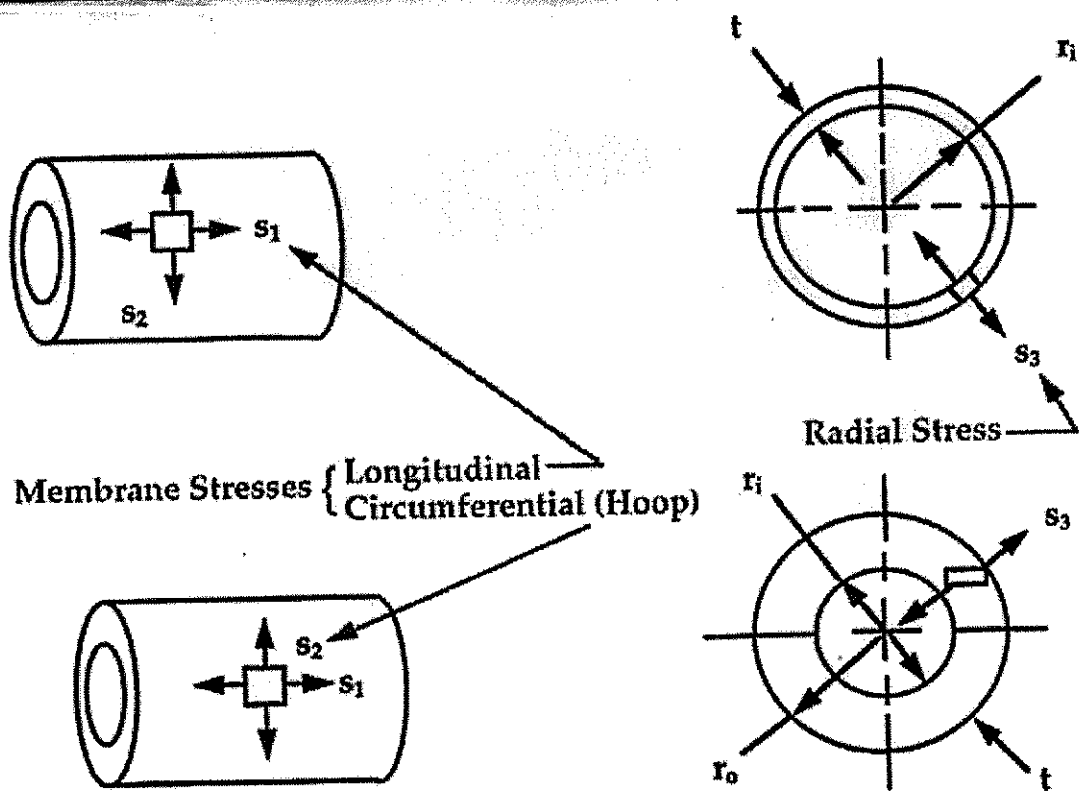

```
In[545]:=
MAWP = 978
 $\sigma_a$  = 16700 (*allowable stress for 316 L SST*)
 $\sigma_y$  = 37000
 $R_i$  = 0.40 / 2.
 $R_o$  = 0.5 / 2.
t =  $R_o$  -  $R_i$ 
Ratio =  $\frac{R_o}{R_i}$ 
If [1.1 < Ratio < 1.5, medium wall]
If [Ratio < 1.1, thin wall]
If [Ratio > 1.5, thick wall]
```

```
Out[545]= 978
```

```
Out[546]= 16700
```

```
Out[547]= 37000
```

```
Out[548]= 0.2
```

```
Out[549]= 0.25
```

```
Out[550]= 0.05
```

```
Out[551]= 1.25
```

```
Out[552]= medium wall
```

In[555]:=

(*Longitudinal Stress, S_1 *)

$$S_1 = \frac{(MAWP R_i^2)}{(R_o^2 - R_i^2)}$$

(*Circumferential Stress, S_2 *)

$$S_2 = \frac{MAWP (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

(*Radial Stress, S_3 *)

$$S_3 = -MAWP$$

(*Von Mises Stress*)

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

Out[555]= 1738.67

Out[556]= 4455.33

Out[557]= -978

Out[558]= 4705.4


```

In[73]:=
(*wall thickness, in., max. pressure, psi*)

(*Circumferential Stress: wall thickness, in., max. pressure, psi*)

Ef = 1.0 (*efficiency*)


$$t_c = \frac{(MAWP R_i)}{(\sigma_a E_f - 0.6 MAWP)} \quad (*UG27 \text{ c } 1*)$$



$$P_c = \frac{(\sigma_a E_f t)}{(R_i + 0.6 t)} \quad (*UG27 \text{ c } 1*)$$



$$SF_{uc} = \frac{P_c}{MAWP} \quad (* P_c \text{ uses allowable stress so SF } \sim 5 \text{ is also included}*)$$


(*Longitudinal Stress: wall thickness, in., max. pressure, psi*)
(*Circumferential butt welds connecting
  ellipsoidal head and hub to cylinder are Catagory A, Type 1 welds*)

Ef = 1.0 (*efficiency*)


$$t_l = \frac{(MAWP R_i)}{(2 \sigma_a E_f + 0.4 MAWP)} \quad (*UG27 \text{ c } 2*)$$



$$P_l = \frac{(2 \sigma_a E_f t)}{(R_i - 0.4 t)} \quad (*UG27 \text{ c } 2*)$$



$$SF_{ul} = \frac{P_l}{MAWP} \quad (* P_l \text{ uses allowable stress so SF } \sim 5 \text{ is also included}*)$$


If[Pc < Pl, "circumferential stress applies", "longitudinal stress applies"]
If[tc > tl, "circumferential stress applies", "longitudinal stress applies"]

Out[73]= 1.

Out[74]= 0.0121391

Out[75]= 3630.43

Out[76]= 3.7121

Out[77]= 1.

Out[78]= 0.00578849

Out[79]= 9277.78

Out[80]= 9.48648

Out[81]= circumferential stress applies

Out[82]= circumferential stress applies

```

In[569]:=

(*Check of Von Mises stress at 1.5 x MAWP for pressure test*)
MAWP = 1.5 x 978

(*Longitudinal Stress, S_1 *)

$$S_1 = \frac{(MAWP R_i^2)}{(R_o^2 - R_i^2)}$$

(*Circumferential Stress, S_2 *)

$$S_2 = \frac{MAWP (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

(*Radial Stress, S_3 *)

$$S_3 = -MAWP$$

(*Von Mises Stress*)

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

$$N_r = \frac{\sigma_y}{\sigma_m}$$

If[$N_r > 1$, "vessel OK at 1.5 x MAWP during pressure test"]

Out[569]= 1467.

Out[570]= 2608.

Out[571]= 6683.

Out[572]= -1467.

Out[573]= 7058.11

Out[574]= 5.2422


Out[575]= vessel OK at 1.5 x MAWP during pressure test

PART UG — GENERAL REQUIREMENTS

Fig. UG-37.1

GENERAL NOTE:

Includes consideration of these areas if $S_n/S_v < 1.0$ (both sides of ϕ)

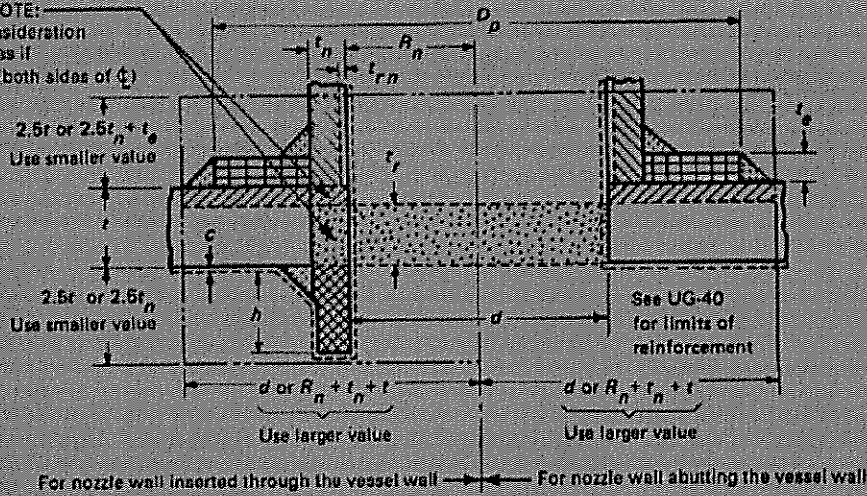

Without Reinforcing Element

	$A = d t_r F + 2 t_n t_r F (1 - f_{r1})$	Area required
	$A_1 = \begin{cases} d(E_1 t - F t_r) - 2 t_n (E_1 t - F t_r) (1 - f_{r1}) \\ 2(t + t_n)(E_1 t - F t_r) - 2 t_n (E_1 t - F t_r) (1 - f_{r1}) \end{cases}$	Area available in shell; use larger value
	$A_2 = \begin{cases} 5(t_n - t_{rn}) f_{r2} t \\ 5(t_n - t_{rn}) f_{r2} t_n \end{cases}$	Area available in nozzle projecting outward; use smaller value
	$A_3 = 2(f_n - c) f_{r2} h$	Area available in inward nozzle
	$A_{41} = \text{outward nozzle weld} = (\text{leg})^2 f_{r2}$	Area available in outward weld
	$A_{43} = \text{inward nozzle weld} = (\text{leg})^2 f_{r2}$	Area available in inward weld
If $A_1 + A_2 + A_3 + A_{41} + A_{43} \geq A$		Opening is adequately reinforced
If $A_1 + A_2 + A_3 + A_{41} + A_{43} < A$		Opening is not adequately reinforced so reinforcing elements must be added and/or thicknesses must be increased

With Reinforcing Element Added

A	= same as A , above	Area required
A_1	= same as A_1 , above	Area available
A_2	$A_2 = \begin{cases} 5(t_n - t_{rn}) f_{r2} t \\ 2(t_n - t_{rn}) f_{r2} (2.5t_n + t_e) \end{cases}$	Area available in nozzle projecting outward; use smaller area
A_3	= same as A_3 , above	Area available in inward nozzle
	$A_{41} = \text{outward nozzle weld} = (\text{leg})^2 f_{r3}$	Area available in outward weld
	$A_{42} = \text{outer element weld} = (\text{leg})^2 f_{r4}$	Area available in outer weld
	$A_{43} = \text{inward nozzle weld} = (\text{leg})^2 f_{r2}$	Area available in inward weld
	$A_5 = (D_p - d - 2t_n) t_e f_{r4}$ [Note (1)]	Area available in element
If $A_1 + A_2 + A_3 + A_{41} + A_{42} + A_{43} + A_5 \geq A$		Opening is adequately reinforced

NOTE:

(1) This formula is applicable for a rectangular cross-sectional element that falls within the limits of reinforcement.

FIG. UG-37.1 NOMENCLATURE AND FORMULAS FOR REINFORCED OPENINGS

(This Figure Illustrates a Common Nozzle Configuration and Is Not Intended to Prohibit Other Configurations Permitted by the Code.)

```
In[576]:= (* Opening Reinforcement Calculations*)
(* VCR Gland to shell wall*)
(* A3 = 0, A5 = 0, A43 = 0, A42 = 0 *)

(* VCR, 0.5 " Ø *)
Tx = .5 (*OD*)
d = 0.40 (*ID min*)
tn = (Tx - d) / 2 (*nozzel wall thickness*)
te = 1.25 * tn (*weld leg height*)

Out[576]= 0.5

Out[577]= 0.4

Out[578]= 0.05

Out[579]= 0.0625

In[580]:= F = 1 (*correction factor*)
tr = 0.335815 (*minimum shell thickness, Vessel_stress2.nb*)
fr1 = 1 (*strength reduction factor*)
t = 0.5 (*shell wall thickness*)
E1 = 1 (*joint efficiency*)
A = d tr F + 2 tn tr F (1 - fr1)
A1a = d (E1 t - F tr) - 2 tn (E1 t - F tr) (1 - fr1)
A1b = 2 (t + tn) (E1 t - F tr) - 2 tn (E1 t - F tr) (1 - fr1)
If[A1a > A1b, A1 = A1a, A1 = A1b]

Out[580]= 1

Out[581]= 0.335815

Out[582]= 1

Out[583]= 0.5

Out[584]= 1

Out[585]= 0.134326

Out[586]= 0.065674

Out[587]= 0.180604

Out[588]= 0.180604
```

```
In[589]:= fr2 = 1 (*strength reduction factor*)
          trn = 0.0121391(*required nozzle thickness, Xe_vessel_VCR.nb*)
          A2a = 5 (tn - trn) fr2 t
          A2b = 5 (tn - trn) fr2 tn
          If[A2a < A2b, A2 = A2a, A2 = A2b]

Out[589]= 1

Out[590]= 0.0121391

Out[591]= 0.0946522

Out[592]= 0.00946522

Out[593]= 0.00946522

In[594]:= fr3 = 1 (*strength reduction factor*)
          A43 = te2 fr3

Out[594]= 1

Out[595]= 0.00390625

In[596]:= (A1 + A2 + A43)
          A
          (A1 + A2 + A43) >= A
          (*If actual area > area required, then no additional reinforcement required *)


Out[596]= 0.193975

Out[597]= 0.134326

Out[598]= True
```

Fig. UG-41.1

1995 SECTION VIII — DIVISION 1

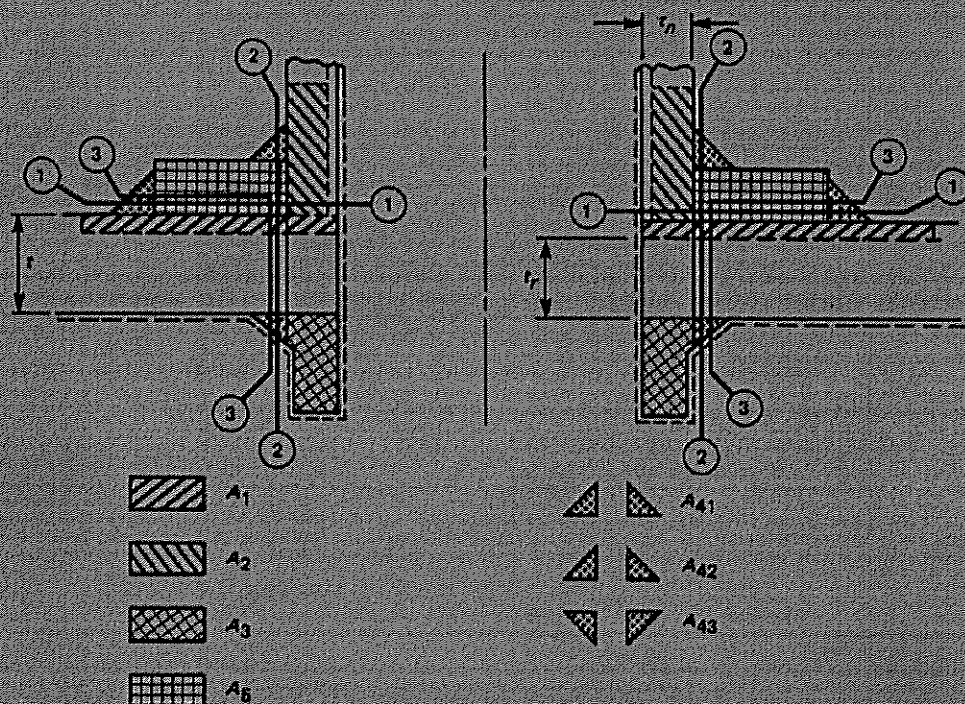

$$\begin{aligned}
 W &= \text{total weld load [UG-41(b)(2)]} \\
 &= (A - A_1 + 2t_n f_{t1} (E_1 t - F_{t1})) S_v \\
 W_{1-1} &= \text{weld load for strength path 1-1 [UG-41(b)(1)]} \\
 &= (A_2 + A_3 + A_{41} + A_{42}) S_v \\
 W_{2-2} &= \text{weld load for strength path 2-2 [UG-41(b)(1)]} \\
 &= (A_2 + A_3 + A_{41} + A_{43} + 2t_n f_{t1}) S_v \\
 W_{3-3} &= \text{weld load for strength path 3-3 [UG-41(b)(1)]} \\
 &= (A_2 + A_3 + A_5 + A_{41} + A_{42} + A_{43} + 2t_n f_{t1}) S_v
 \end{aligned}$$

GENERAL NOTES:

- (a) Areas A_1 , A_2 , A_3 , A_5 , and A_{41} are modified by f_{rx} factors.
 (b) Nomenclature is the same as in UG-37 and Fig. UG-37.1.

(a) Depicts Typical Nozzle Detail With Neck Inserted Through the Vessel Wall

FIG. UG-41.1 NOZZLE ATTACHMENT WELD LOADS AND WELD STRENGTH PATHS TO BE CONSIDERED

(*must run "VCR_shell.nb" file first to save variables defined below into memory*)

```

In[599]:= (*Load / Stress Carried by Welds*)
A
A1
A2
A3 = 0
A5 = 0
A41 = 0
A42 = 0
A43

Out[599]= 0.134326

Out[600]= 0.180604

Out[601]= 0.00946522

Out[602]= 0

Out[603]= 0

Out[604]= 0

Out[605]= 0

Out[606]= 0.00390625

In[607]:= Sv = 16700
W = (A - A1 + 2 tn fr1 (E1 t - F tr)) Sv

Out[607]= 16700

Out[608]= -498.645

In[610]:=
W1-1 = (A2 + A5 + A41 + A42) Sv

Out[610]= 158.069

In[611]:= W2-2 = (A2 + A3 + A41 + A43 + 2 tn t fr1) Sv

Out[611]= 1058.3

In[612]:= W3-3 = (A2 + A3 + A5 + A41 + A42 + A43 + 2 tnt fr1) Sv

Out[612]= 1058.3

(* W (total weld load) << W1-1, W2-2, W3-3, (weld load available)*)

In[613]:= (*Allowable Unit Stresses*)
(*Fillet Weld Shear, UW 15 c*)
 $\sigma_{fw} = 0.49 (Sv)$ 

Out[613]= 8183.

```

```
In[614]:= (*Nozzel Wall Shear, UG 45 c*)
           $\sigma_{nw} = 0.7 (Sv)$ 
```

```
Out[614]= 11690.
```

```
In[615]:= (*Strength of Connection Elements*)
          (*Fillet Weld Shear*)
```

$$W_{fw} = \frac{\pi}{2} T x t e \sigma_{fw}$$

```
Out[615]= 401.682
```

```
In[616]:= (*Strength of Connection Elements*)
          (*Nozzel Wall Shear*)
```

$$W_{nw} = \frac{\pi}{2} \frac{(Tx + d)}{2} t n \sigma_{nw}$$

```
Out[616]= 413.159
```

```
In[617]:= WS1-1 = Wnw
          WS2-2 = Wfw
```

```
Out[617]= 413.159
```

```
Out[618]= 401.682
```

```
(*All Paths WS1-1, WS2-2, are stronger than the required strength W*)
```



```
(* VCR Port Xe chamber gamma ray feedthru *)
(* 850 psia MOP,
   stainless steel VCR plug with 0.250 " Ø counterbore. Determine head thickness: *)
```

```
In[24]:= (* Load at operating conditions *)
G = 0.250 (* Diameter, in. at gasket load location *)
P = 850*1.15 (* MAWP, internal design pressure *)
H = 0.785 G2 P (* lb., Total hydrostatic end force *)
```

```
Out[24]= 0.25
```

```
Out[25]= 977.5
```

```
Out[26]= 47.9586
```

```
In[27]:=
Ca = 0.75 (*Head attachment constant, UG-34 (r)*)
Ef = 1.0 (*Efficiency Factor *)
dga = G (*in. hole cross-sectional diameter*)
σu = 77000.0 (*psi, 316 L ultimate strength*)
σa = 16700 (*psi, 316 L allowable strength*)

th = dga √  $\frac{C_a \times P}{\sigma_a \times E_f}$  (* in., required head thickness, no bending moment *)
```

```
Out[27]= 0.75
```

```
Out[28]= 1.
```


```
Out[29]= 0.25
```

```
Out[30]= 77000.
```

```
Out[31]= 16700
```

```
Out[32]= 0.0523806
```

(*Xenon Pressure Vessel Stress Calculations - LN2 Port*)

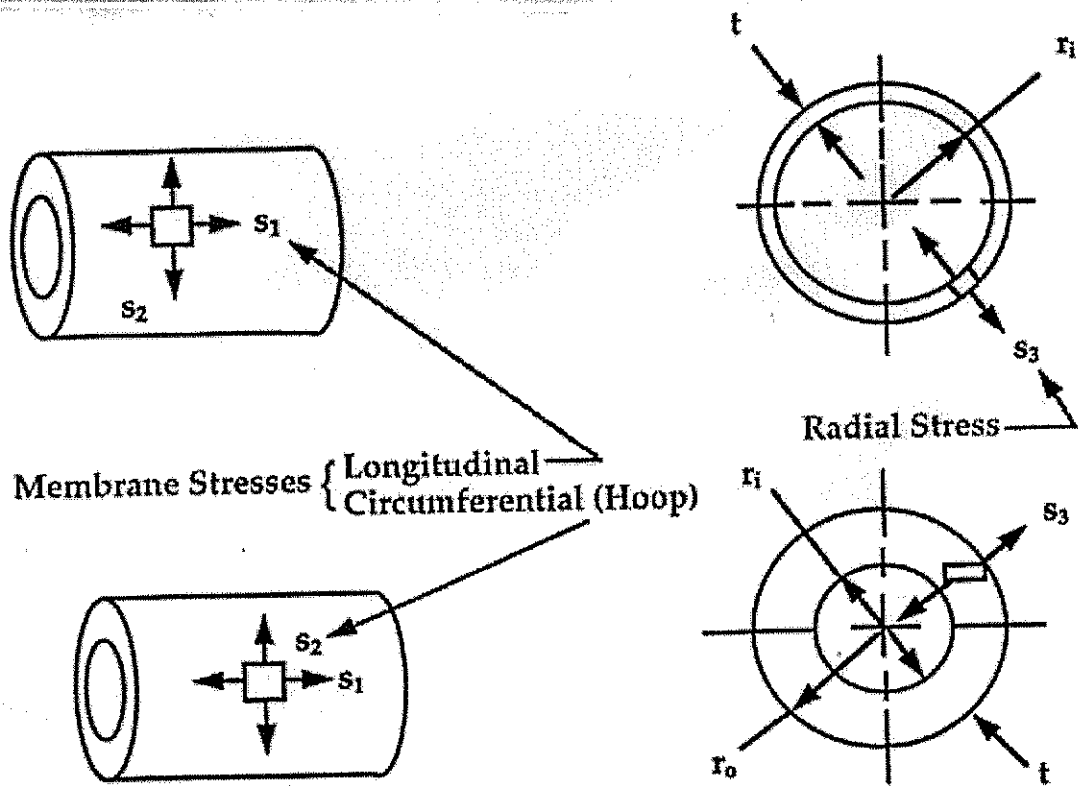

```
In[619]:=
  MAWP = 978
   $\sigma_a$  = 16700 (*allowable stress for 316 L SST*)
   $\sigma_y$  = 37000
   $R_i$  = 1.5 / 2.
   $R_o$  = 1.9 / 2.
   $t = R_o - R_i$ 
  Ratio =  $\frac{R_o}{R_i}$ 
  If [1.1 < Ratio < 1.5, medium wall]
  If [Ratio < 1.1, thin wall]
  If [Ratio > 1.5, thick wall]

Out[619]= 978

Out[620]= 16700

Out[621]= 37000

Out[622]= 0.75

Out[623]= 0.95

Out[624]= 0.2

Out[625]= 1.26667

Out[626]= medium wall
```

In[629]:=

(*Longitudinal Stress, S_1 *)

$$S_1 = \frac{(\text{MAWP } R_i^2)}{(R_o^2 - R_i^2)}$$

(*Circumferential Stress, S_2 *)

$$S_2 = \frac{\text{MAWP } (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

(*Radial Stress, S_3 *)

$$S_3 = -\text{MAWP}$$

(*Von Mises Stress*)

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$

Out[629]= 1618.01

Out[630]= 4214.03

Out[631]= -978

Out[632]= 4496.43

```

In[104]:=
  (*wall thickness, in., max. pressure, psi*)

  (*Circumferential Stress: wall thickness, in., max. pressure, psi*)

  Ef = 0.7 (*butt weld efficiency based on no inspection, Table UW-12*)

  tc =  $\frac{(MAWP R_i)}{(\sigma_a E_f - 0.6 MAWP)}$  (*UG27 c 1*)

  Pc =  $\frac{(\sigma_a E_f t)}{(R_i + 0.6 t)}$  (*UG27 c 1*)
  SFuc =  $\frac{P_c}{MAWP}$  (* Pc uses allowable stress so SF ~5 is also included*)

  (*Longitudinal Stress: wall thickness, in., max. pressure, psi*)
  (*Circumferential butt welds connecting
    ellipsoidal head and hub to cylinder are Catagory A, Type 1 welds*)

  Ef = 0.7 (*butt weld efficiency based on no inspection, Table UW-12*)

  t1 =  $\frac{(MAWP R_i)}{(2 \sigma_a E_f + 0.4 MAWP)}$  (*UG27 c 2*)

  P1 =  $\frac{(2 \sigma_a E_f t)}{(R_i - 0.4 t)}$  (*UG27 c 2*)
  SFul =  $\frac{P_1}{MAWP}$  (* P1 uses allowable stress so SF ~5 is also included*)

  If[Pc < P1, "circumferential stress applies", "longitudinal stress applies"]
  If[tc > t1, "circumferential stress applies", "longitudinal stress applies"]

Out[104]= 0.7

Out[105]= 0.066062

Out[106]= 2687.36

Out[107]= 2.74781

Out[108]= 0.7

Out[109]= 0.0308567

Out[110]= 6979.1

Out[111]= 7.1361

Out[112]= circumferential stress applies

Out[113]= circumferential stress applies

```

```

In[643]:=
(*Check of Von Mises stress at 1.5 x MAWP for pressure test*)
MAWP = 1.5 x 978

(*Longitudinal Stress, S1*)

$$S_1 = \frac{(MAWP R_i^2)}{(R_o^2 - R_i^2)}$$


(*Circumferential Stress, S2*)

$$S_2 = \frac{MAWP (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$


(*Radial Stress, S3*)
S3 = -MAWP

(*Von Mises Stress*)

$$\sigma_m = \sqrt{0.5 ((S_1 - S_2)^2 + (S_2 - S_3)^2 + (S_3 - S_1)^2)}$$


Nr =  $\frac{\sigma_y}{\sigma_m}$ 
If[Nr > 1, "vessel OK at 1.5 x MAWP during pressure test"]

Out[643]= 1467.
Out[644]= 2427.02
Out[645]= 6321.04
Out[646]= -1467.
Out[647]= 6744.64
Out[648]= 5.48583
Out[649]= vessel OK at 1.5 x MAWP during pressure test


```

PART UG — GENERAL REQUIREMENTS

Fig. UG-37.1

GENERAL NOTE:

includes consideration of these areas if $S_n/S_v < 1.0$ (both sides of ϕ)

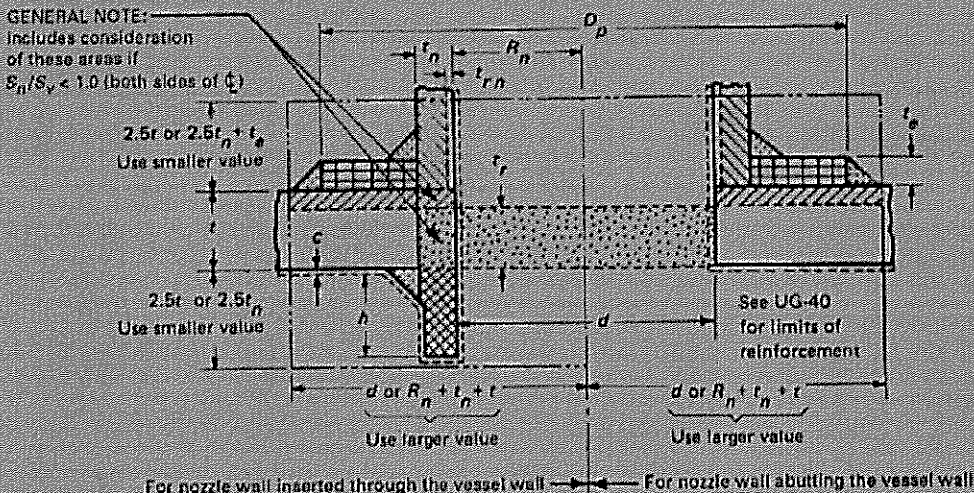

Without Reinforcing Element

	$A = d t_r F + 2 t_n t_r F (1 - f_{r1})$	Area required
	$A_1 = \begin{cases} d(E_1 t - F t_r) - 2 t_n (E_1 t - F t_r) (1 - f_{r1}) \\ 2(t + t_n)(E_1 t - F t_r) - 2 t_n (E_1 t - F t_r) (1 - f_{r1}) \end{cases}$	Area available in shell; use larger value
	$A_2 = \begin{cases} 5(t_n - t_{rn}) f_{r2} t \\ 5(t_n - t_{rn}) f_{r2} t_n \end{cases}$	Area available in nozzle projecting outward; use smaller value
	$A_3 = 2(t_n - c) f_{r2} h$	Area available in inward nozzle
	$A_{41} = \text{outward nozzle weld} = (\text{leg})^2 f_{r2}$	Area available in outward weld
	$A_{43} = \text{inward nozzle weld} = (\text{leg})^2 f_{r2}$	Area available in inward weld
If $A_1 + A_2 + A_3 + A_{41} + A_{43} \geq A$		Opening is adequately reinforced
If $A_1 + A_2 + A_3 + A_{41} + A_{43} < A$		Opening is not adequately reinforced so reinforcing elements must be added and/or thicknesses must be increased

With Reinforcing Element Added

A	= same as A , above	Area required
A_1	= same as A_1 , above	Area available
A_2	$A_2 = \begin{cases} 5(t_n - t_{rn}) f_{r2} t \\ 2(t_n - t_{rn}) f_{r2} (2.5 t_n + t_e) \end{cases}$	Area available in nozzle projecting outward; use smaller area
A_3	= same as A_3 , above	Area available in inward nozzle
	$A_{41} = \text{outward nozzle weld} = (\text{leg})^2 f_{r3}$	Area available in outward weld
	$A_{42} = \text{outer element weld} = (\text{leg})^2 f_{r4}$	Area available in outer weld
	$A_{43} = \text{inward nozzle weld} = (\text{leg})^2 f_{r2}$	Area available in inward weld
	$A_5 = (D_p - d - 2 t_n) t_e f_{r4}$ [Note (1)]	Area available in element
If $A_1 + A_2 + A_3 + A_{41} + A_{42} + A_{43} + A_5 \geq A$		Opening is adequately reinforced

NOTE:

(1) This formula is applicable for a rectangular cross-sectional element that falls within the limits of reinforcement.

FIG. UG-37.1 NOMENCLATURE AND FORMULAS FOR REINFORCED OPENINGS

(This Figure Illustrates a Common Nozzle Configuration and Is Not Intended to Prohibit Other Configurations Permitted by the Code.)

```
In[4]:= (* Opening Reinforcement Calculations*)
(* LN2 Trap to shell wall*)
(* A3 = 0, A5 = 0, A42 = 0 *)

(* Pipe Sch. 80 1.5 " Ø *)
Tx = 1.9 (*OD*)
d = 1.5 (*ID min*)
tn = (Tx - d) / 2 (*nozzel wall thickness*)
te = 1.25 * tn (*weld leg height*)

Out[4]= 1.9

Out[5]= 1.5

Out[6]= 0.2

Out[7]= 0.25

In[8]:= F = 1 (*correction factor*)
tr = 0.335815 (*minimum shell thickness, Vessel_stress2.nb*)
fr1 = 1 (*strength reduction factor*)
t = 0.5 (*shell wall thickness*)
E1 = 1 (*joint efficiency*)
A = d tr F + 2 tn tr F (1 - fr1)
A1a = d (E1 t - F tr) - 2 tn (E1 t - F tr) (1 - fr1)
A1b = 2 (t + tn) (E1 t - F tr) - 2 tn (E1 t - F tr) (1 - fr1)
If[A1a > A1b, A1 = A1a, A1 = A1b]

Out[8]= 1

Out[9]= 0.335815

Out[10]= 1

Out[11]= 0.5

Out[12]= 1

Out[13]= 0.503722

Out[14]= 0.246278

Out[15]= 0.229859

Out[16]= 0.246278
```



```

In[17]:= fr2 = 1 (*strength reduction factor*)
          trn = 0.066062 (*required nozzle thickness, Xe_vessel_LN2.nb*)
          A2a = 5 (tn - trn) fr2 t
          A2b = 5 (tn - trn) fr2 tn
          If[A2a < A2b, A2 = A2a, A2 = A2b]

Out[17]= 1

Out[18]= 0.066062

Out[19]= 0.334845

Out[20]= 0.133938

Out[21]= 0.133938

In[72]:= fr3 = 1 (*strength reduction factor*)
          A43 = te2 fr3
          teo = 1.4 tn
          A41 =  $\frac{te_o^2 fr3}{1.2}$  (* 80 % the area, skip weld on outside*)

Out[72]= 1

Out[73]= 0.0625

Out[74]= 0.28

Out[75]= 0.0653333

In[76]:= (A1 + A2 + A43 + A41)
          A
          (A1 + A2 + A43 + A41) >= A
          (*If actual area > area required, then no additional reinforcement required *)

Out[76]= 0.508049


Out[77]= 0.503722

Out[78]= True

```

Fig. UG-41.1

1995 SECTION VIII — DIVISION 1

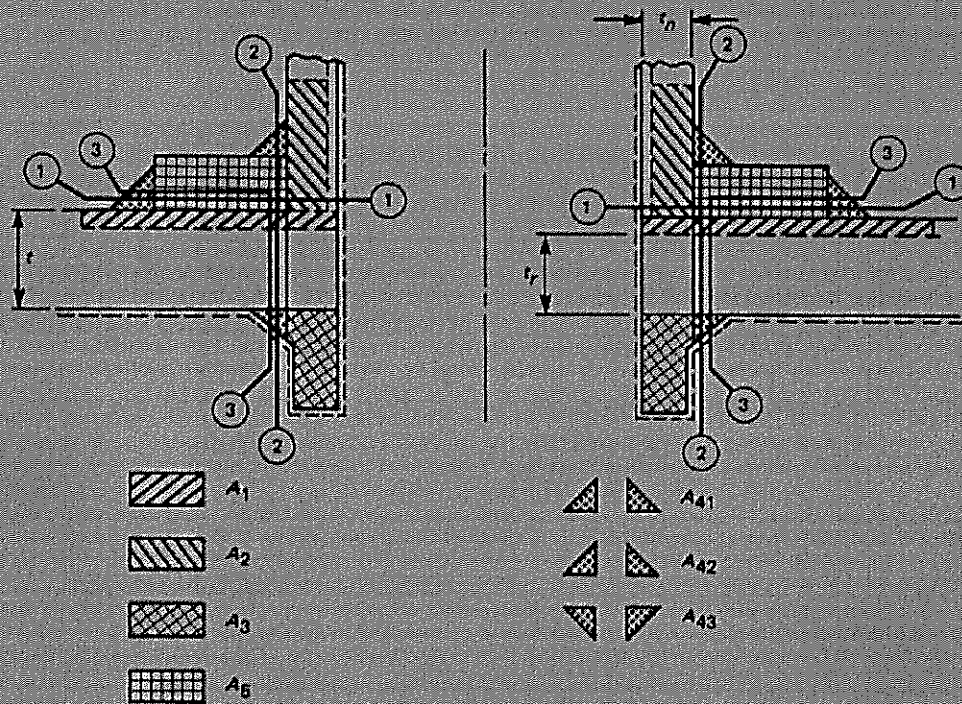

$$\begin{aligned}
 W &= \text{total weld load [UG-41(b)(2)]} \\
 &= [A - A_1 + 2t_n f_{r1} (E_1 t - F_{r1})] S_v \\
 W_{1-1} &= \text{weld load for strength path 1-1 [UG-41(b)(1)]} \\
 &= [A_2 + A_5 + A_{41} + A_{42}] S_v \\
 W_{2-2} &= \text{weld load for strength path 2-2 [UG-41(b)(1)]} \\
 &= [A_2 + A_3 + A_{41} + A_{43} + 2t_n f_{r1}] S_v \\
 W_{3-3} &= \text{weld load for strength path 3-3 [UG-41(b)(1)]} \\
 &= [A_2 + A_3 + A_5 + A_{41} + A_{42} + A_{43} + 2t_n f_{r1}] S_v
 \end{aligned}$$

GENERAL NOTES:

- (a) Areas A_1 , A_2 , A_3 , A_5 , and A_{41} are modified by f_{rx} factors.
 (b) Nomenclature is the same as in UG-37 and Fig. UG-37.1.

(a) Depicts Typical Nozzle Detail With Neck Inserted Through the Vessel Wall

FIG. UG-41.1 NOZZLE ATTACHMENT WELD LOADS AND WELD STRENGTH PATHS TO BE CONSIDERED

(*must run "LN2_shell.nb" file first to save variables defined below into memory*)

In[79]:= (*Load / Stress Carried by Welds*)

A

A1

A2

A3 = 0

A5 = 0

A41

A42 = 0

A43

Out[79]= 0.503722

Out[80]= 0.246278

Out[81]= 0.133938

Out[82]= 0

Out[83]= 0

Out[84]= 0.0653333

Out[85]= 0

Out[86]= 0.0625

In[87]:= Sv = 16700

W = (A - A1 + 2 tn fr1 (E1 t - F tr)) Sv

Out[87]= 16700

Out[88]= 5396.09

In[89]:=

W₁₋₁ = (A2 + A5 + A41 + A42) Sv

Out[89]= 3327.83

In[90]:= W₂₋₂ = (A2 + A3 + A41 + A43 + 2 tn t fr1) Sv

Out[90]= 7711.58

W₃₋₃ = (A2 + A3 + A5 + A41 + A42 + A43 + 2 tn t fr1) Sv

7664.26

(* W (total weld load) << W₁₋₁, W₂₋₂, W₃₋₃, (weld load available)*)

In[91]:= (*Allowable Unit Stresses*)

(*Fillet Weld Shear, UW 15 c*)

$\sigma_{fw} = 0.49$ (Sv)

Out[91]= 8183.

```
In[92]:= (*Nozzel Wall Shear, UG 45 c*)
 $\sigma_{nw} = 0.7 (Sv)$ 
```

```
Out[92]= 11690.
```

```
In[93]:=
(*Strength of Connection Elements*)
(*Fillet Weld Shear*)
```

$$W_{fw} = \frac{\pi}{2} T_x t_e \sigma_{fw}$$

```
Out[93]= 6105.57
```

```
In[94]:=
(*Strength of Connection Elements*)
(*Nozzel Wall Shear*)
```

$$W_{nw} = \frac{\pi}{2} \frac{(T_x + d)}{2} t_n \sigma_{nw}$$

```
Out[94]= 6243.29
```

```
In[95]:=
WS1-1 = Wnw
WS2-2 = Wfw
```

```
Out[95]= 6243.29
```





```
Out[96]= 6105.57
```

(*All Paths WS₁₋₁, WS₂₋₂, are stronger than the required strength W*)

(* Stress Concentration Factor for mini-conflat openings in head. Reference: Wiley *)

Stress Concentration Factors

Table 4
Maximum K_t for circular plate with circular holes with internal pressure only

	Pattern	Spacing	Maximum K_t	Location	Reference
1		$r/R = 0.5$	See Fig. 126	See Fig. 126	223, 228, 229
2		$R/R_0 = 0.5$ $r/R_0 = 0.2$	See Fig. 127	See Fig. 127	230
3		$R/R_0 = 0.5$ $r/R_0 = 0.2$	See Fig. 127	See Fig. 127	230
		$R/R_0 = 0.5$ $r/R_0 = 0.25$	2.45	A	223
4		$R/R_0 = 0.6$ $r/R_0 = 0.2$	2.278 Pressure in All Holes 1.521 Pressure in Center Hole Only	A B	223

```

In[1039]:= (*must run "Flange stress_hub_403.nb"
            file first to save variables defined below into memory*)

(* Assumptions:Chamber head design has 5 mini-conflat holes,not 6,
   Kt will be conservative. Chamber head has 1.5 " diameter inner hole, #4 model has
   equal diameter holes throughout, Kt will not be conservative. Assume
   these 2 opposites have a cancelling effect and given Kt is valid. Actual BC hole
   radius is 0.3125 ". But, for this analysis assume all holes 0.75" radius *)

Ro = 5.25 (*in.,Flange outside radius*)
rh = 0.750 (*in.,BC hole radius*)
Ri = 0.750 (*in.,inner hole radius*)
R = 5.5 / 2 (* in., mini conflat bolt circle radius *)
l =  $\frac{R_i}{R_o}$  (*graph constant*)
m =  $\frac{R}{R_o}$  (*graph constant*)
o =  $\frac{r_h}{R_o}$  (*graph constant*)

Out[1039]= 5.25

Out[1040]= 0.75

Out[1041]= 0.75

Out[1042]= 2.75

Out[1043]= 0.142857

Out[1044]= 0.52381

Out[1045]= 0.142857

In[1256]:= (*  $\frac{R}{R_o}$  and  $\frac{r_h}{R_o}$  are slightly less than #4 model,
            but Kt will be less (conservative) for chamber head design.*)
            Kt = 2.278

Out[1256]= 2.278

```

```

In[1257]:=
  Ca = 0.3    (*flange attachment constant*)
  p = 350 × 1.15 (*psi, MAWP*)
  Ef = 1.0    (*Efficiency Factor *)
  dga = 8.54 (*in. gasket diameter*)
  Wm1
  (* lb., Must run "Flange stress_hub_403.nb" to
  define this variable. Minimum required bolt load, for operating *)
  hG = 0.520 (* in., Must run
  "Flange stress_hub_403.nb" to define this variable.Bending moment length *)
  σu = 77000.0 (*psi, 316 L ultimate strength*)
  σa =  $\frac{16700}{K_t}$  (*psi, 316 L allowable strength*)

```

```
Out[1257]= 0.3
```

```
Out[1258]= 402.5
```

```
Out[1259]= 1.
```

```
Out[1260]= 8.54
```

```
Out[1261]= 24677.2
```

```
Out[1262]= 0.52
```

```
Out[1263]= 77000.
```

```
Out[1264]= 7330.99
```

```

In[1265]:= th = dga √  $\frac{(C_a * p)}{(\sigma_a * E_f)} + \frac{(1.9 * W_{m1} * h_G)}{(\sigma_a * E_f * d_{ga}^3)}$  (* in., required flange thickness *)

```

```
Out[1265]= 1.26123
```

```
In[1266]:= If[th < 1.5, "flange thickness is OK", "flange thickness is NOT OK"]
```

```
Out[1266]= flange thickness is OK
```

```

In[1565]:= (* Maximum distance between
             hole centers for a cluster of holes in head, UG-36 (3) (d) *)
(* No two unreinforced openings shall have their centers closer than: *)
R
dbetweenholes1 = Sin[36 ×  $\frac{\pi}{180}$ ] × R × 2

d2 = 0.625
d1 = d2 (* diameter of holes *)
Cd = 2.5 (d1 + d2)

If[dbetweenholes1 > Cd,
   "distance between 5.5 BC holes OK", "distance between 5.5 BC holes NOT OK"]

dbetweenholes2 = R - .75 - .3125
d2 = 0.625
d1 = 1.500
Cd = 2.5 (d1 + d2)

If[dbetweenholes2 > Cd, "distance between center hole and 5.5 BC holes OK", "distance
   between center hole and 5.5 BC holes NOT OK,,,, use alternative UG-39 (d)"]

dbetweenholes2 < 2  $\left( \frac{(d_1 + d_2)}{2} \right)$ 
dbetweenholes2 > 1.25  $\left( \frac{(d_1 + d_2)}{2} \right)$ 

(* in., required flange thickness,
   UG-39 (e) (1) (2), using alternative to Area reinforcement of UG39 (b) (1) *)

σa = 16700

ef =  $\frac{R - \left( \frac{(d_1 + d_2)}{2} \right)}{R}$  (* UG39 (e) (2) *)
fs =  $\sqrt{0.5 / ef}$ 

th = dga  $\sqrt{fs \times 2 \left( \frac{(C_a * p)}{(\sigma_a * E_f)} + \frac{(1.9 * W_{ml} * h_G)}{(\sigma_a * E_f * d_{ga}^3)} \right)}$ 

Out[1565]= 2.75

Out[1566]= 3.23282

Out[1567]= 0.625

Out[1568]= 0.625

Out[1569]= 3.125

Out[1570]= distance between 5.5 BC holes OK

Out[1571]= 1.6875

```



```
Out[1572]= 0.625
```

```
Out[1573]= 1.5
```

```
Out[1574]= 5.3125
```

```
Out[1575]= distance between center hole and 5.5 BC holes NOT OK,,,,, use alternative UG-39(d)
```

```
Out[1576]= True
```

```
Out[1577]= True
```

```
Out[1578]= 16700
```

```
Out[1579]= 0.613636
```

```
Out[1580]= 0.902671
```

```
Out[1581]= 1.12279
```

```
Out[1589]= 0.625
```

```
Out[1590]= 1.5
```

```
Out[1591]= 5.3125
```

```
Out[1592]= distance between center hole and 5.5 BC holes NOT OK,,,,, use alternative UG-39(d)
```

```
Out[1593]= True
```

```
Out[1594]= True
```

```
Out[1595]= 16700
```

```
Out[1596]= 0.613636
```

```
Out[1597]= 0.902671
```

```
Out[1598]= 1.24385
```

```

(*must run "Flange stress_hub_978.nb"
  file first to save variables defined below into memory*)

(* Assumptions: Chamber head design has has no holes *)

Ro = 5.25 (*in., Flange outside radius*)

Ca = 0.3    (*flange attachment constant*)
p = 850 × 1.15 (*psi, MAWP*)
Ef = 1.0    (*Efficiency Factor *)
dga = G (*in. gasket diameter*)
Wm1
(* lb., Must run "Flange stress_hub_978.nb
  " to define this variable. Minimum required bolt load, for operating *)
hg = 0.520 (* in.,
  Must run "Flange stress_hub_978.nb" to define this variable. Bending moment length *)
σu = 77000.0 (*psi, 316 L ultimate strength*)
σa = 16700    (*psi, 316 L allowable strength*)

0.3

977.5

1.

7.98

58849.9

0.52

77000.

16700


$$t_h = d_{ga} \sqrt{\frac{(C_a * p)}{(\sigma_a * E_f)} + \frac{(1.9 * W_{m1} * h_g)}{(\sigma_a * E_f * d_{ga}^3)}} \quad (* \text{ in., required flange thickness } *)$$


1.2468

If[ t_h < 1.980, "flange thickness is OK", "flange thickness is NOT OK"]

flange thickness is OK

(* Minimum thickness of plate under gasket (hub) *)


$$t_g = d_{ga} \sqrt{(1.9 * W_{m1} * h_g) / (\sigma_a * d_{ga}^3)} \quad (* \text{ UG34, sketch (k) } *)$$


If[ t_g < 1.980, "flange hub thickness is OK", "flange hub thickness is NOT OK"]

0.660529

flange hub thickness is OK

```

```

(*must run "Flange stress_hub_small_978.nb"
  file first to save variables defined below into memory*)

(* Assumptions: Head design has has no holes *)

Ro = 4.63 / 2 (*in., Flange outside radius*)

Ca = 0.3    (*flange attachment constant*)
p = 850 × 1.15  (*psi, MAWP*)
Ef = 1.0    (*Efficiency Factor *)
dga = G (*in. gasket diameter*)
Wm1
(* lb., Must run "Flange stress_hub_small_978.nb
  " to define this variable. Minimum required bolt load, for operating *)
hG = 0.520 (* in., Must run
  "Flange stress_hub_small_978.nb" to define this variable. Bending moment length *)

σa = 16700  (*psi, 304 L allowable strength*)

0.3

977.5

1.

3.35

10143.7

0.52

16700


$$t_h = d_{ga} \sqrt{\frac{(C_a * p)}{(\sigma_a * E_f)} + \frac{(1.9 * W_{m1} * h_G)}{(\sigma_a * E_f * d_{ga}^3)}} \quad (* \text{ in., required flange thickness } *)$$


0.613356

If[th < 0.750, "flange thickness is OK", "flange thickness is NOT OK"]

flange thickness is OK

(* Minimum thickness of plate under gasket (hub) *)


tg = dga √ ((1.9 * Wm1 * hG) / (σa * dga3)) (* UG34, sketch (k) *)

If[tg < 0.81, "flange hub thickness is OK", "flange hub thickness is NOT OK"]

0.423249

flange hub thickness is OK

```

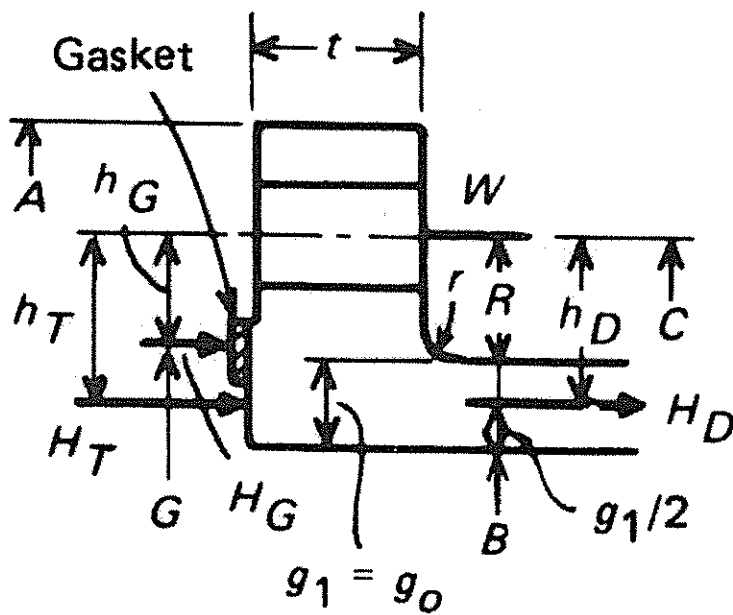

(5)

(* Bolted Flange Connections with flat metal Copper Gasket,
Xe chamber high voltage feedthru *)
(* 350 psia MOP, conflat type head *)

```

(* Bolt Load at operating conditions *)
G = 0.72 (* Diameter, in. at gasket load location *)
P = 350*1.15 (* MAWP, internal design pressure *)
m = 4.75 (* gasket factor flat Cu gasket, Table 2-4.1 *)
Ng = 0.25 (* width of Cu gasket *)
bo =  $\frac{N_g}{32}$  (* N/4 for multiple serrations Table 2-5.2 (5),
    assume N/32 given a single knife edge serration as used in Conflats *)
If[bo <= 0.25, b = bo, b = .5  $\sqrt{b_o}$ ]
y = 13000 (* psi, design seating stress for soft copper, Table 2-5.1 *)
H = 0.785 G2 P (* lb., Total hydrostatic end force *)
Hp = 2 b × π G m P (* lb., Total joint-contact surface compression load *)
Wm1 = H + Hp (* Minimum required bolt load, for operating *)
Wm2 = π G b y (* Minimum required bolt load, for gasket seating *)

0.72

402.5

4.75

0.25

0.0078125

0.0078125

13000

163.795

67.5712

231.366

229.729

```

```

In[54]:= (* Design Bolt Load*)

$$A_b = \frac{\pi \times 0.1248^2}{4} \times 6$$
 (*cross sectional area of #8-32 screw*)
SF = 4 (* MEDSS *)
ST = 81000
(*Unbrako - KS 1216 8-32 SHCS, 160, ksi tensile strength; T = -400 °F to 1200 °F
OR ASTM-A493-95 Grade S30430; 81 ksi tensile strength *)
Sa = ST / SF
Lb = Sa × Ab (* lb., Max allowable bolt load *)
Am1 = Wm1 / Sa (* in2, cross-sectional area of bolts under operating condition *)
Am2 = Wm2 / Sa (* in2, cross-sectional area of bolts for gasket seating *)
If[Am1 > Am2, Am = Am1, Am = Am2]
(* in2, total required cross-sectional area of bolts *)

Wo = Wm1 (* lb., Flange design bolt load, for operating *)

$$W_g = \frac{(A_m + A_b) S_a}{2}$$
 (* lb., Flange design bolt load, for gasket seating *)
SFu = Lb SF / Wg

Out[54]= 0.0733956

Out[55]= 4

Out[56]= 81000

Out[57]= 20250

Out[58]= 1486.26

Out[59]= 0.0114255

Out[60]= 0.0113446

Out[61]= 0.0114255

Out[62]= 231.366

Out[63]= 858.814

Out[64]= 6.92239

```

```

Ce = 0.3    (*flange attachment constant*)
p = 350 × 1.15  (*psi, MAWP*)
Ef = 1.0    (*Efficiency Factor *)
dga = G (*in. gasket diameter*)
Wm1
(* lb., Minimum required bolt load, for operating *)
hg = 0.171 (* in., Bending moment length *)
σu = 77000.0 (*psi, 304 L ultimate strength*)
σa = 16700  (*psi, 304 L allowable strength*)

th = dga √  $\frac{(C_e * p)}{(\sigma_a * E_f)} + \frac{(1.9 * W_{m1} * h_g)}{(\sigma_a * E_f * d_{ga}^3)}$  (* in., required flange thickness *)

0.3

402.5

1.

0.72

231.366


0.171

77000.

16700

0.1

```

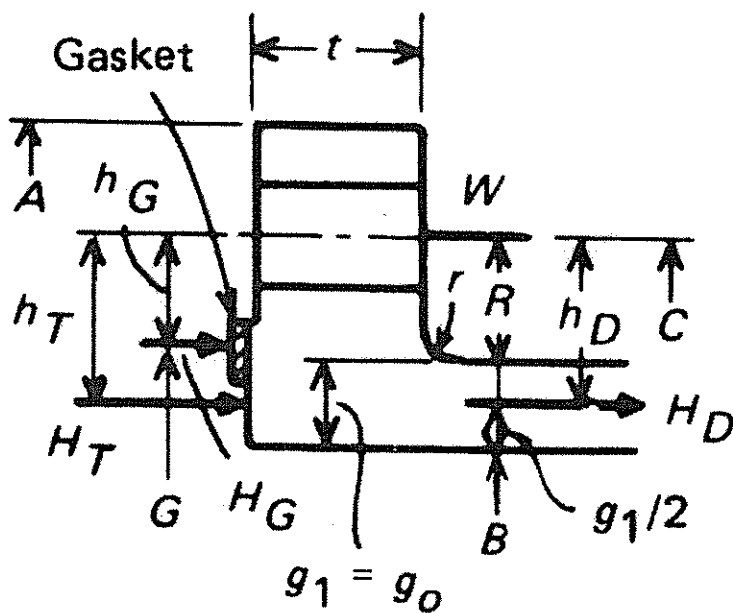(5)

(* Bolted Flange Connections with flat metal Copper Gasket,
Xe chamber gamma ray feedthru *)
(* 350 psia MOP, conflat type head *)

```

(* Bolt Load at operating conditions *)
G = 1.650 (* Diameter, in. at gasket load location *)
P = 350 * 1.15 (* MAWP, internal design pressure *)
m = 4.75 (* gasket factor flat Cu gasket, Table 2-4.1 *)
Ng = 0.25 (* width of Cu gasket *)
bo =  $\frac{N_g}{32}$  (* N/4 for multiple serrations Table 2-5.2 (5),
    assume N/32 given a single knife edge serration as used in Conflats *)
If[bo <= 0.25, b = bo, b = .5  $\sqrt{b_o}$ ]
y = 13000 (* psi, design seating stress for soft copper, Table 2-5.1 *)
H = 0.785 G2 P (* lb., Total hydrostatic end force *)
Hp = 2 b × π G m P (* lb., Total joint-contact surface compression load *)
Wm1 = H + Hp (* Minimum required bolt load, for operating *)
Wm2 = π G b y (* Minimum required bolt load, for gasket seating *)

1.65

402.5

4.75

0.25

0.0078125

0.0078125

13000

860.208

154.851

1015.06

526.462

```

```

In[76]:= (* Design Bolt Load*)

$$A_b = \frac{\pi \times 0.2052^2}{4} \times 6 \text{ (*cross sectional area of 1/4-28 screw*)}$$

SF = 4 (* MEDSS *)
ST = 81000
(*Unbrako - KS 1216 1/4-28 SHCS, 160, ksi tensile strength; T = -400 °F to 1200 °F
OR ASTM-A493-95 Grade S30430; 81 ksi tensile strength *)
Sa = ST ÷ SF
Lb = Sa × Ab (* lb., Max allowable bolt load *)
Am1 = Wm1 / Sa (* in2, cross-sectional area of bolts under operating condition *)
Am2 = Wm2 / Sa (* in2, cross-sectional area of bolts for gasket seating *)
If[Am1 > Am2, Am = Am1, Am = Am2]
(* in2, total required cross-sectional area of bolts *)

Wo = Wm1 (* lb., Flange design bolt load, for operating *)

$$W_g = \frac{(A_m + A_b) S_a}{2} \text{ (* lb., Flange design bolt load, for gasket seating *)}$$

SFu = Lb SF / Wg

Out[76]= 0.198425

Out[77]= 4

Out[78]= 81000

Out[79]= 20250

Out[80]= 4018.1

Out[81]= 0.0501264

Out[82]= 0.0259981

Out[83]= 0.0501264

Out[84]= 1015.06

Out[85]= 2516.58

Out[86]= 6.38661

```

```

Ca = 0.13 (*flange attachment constant*)
p = 350 × 1.15 (*psi, MAWP*)
Ef = 1.0 (*Efficiency Factor *)
dga = G (*in. gasket diameter*)
Wm1
(* lb., Minimum required bolt load, for operating *)
hG = 0.331 (* in., Bending moment length *)
σu = 77000.0 (*psi, 304 L ultimate strength*)
σa = 16700 (*psi, 304 L allowable strength*)

th = dga √  $\frac{C_a \times p}{\sigma_a \times E_f}$  (* in., required flange thickness, no bending moment *)

tho = dga √  $\frac{(C_a \times p)}{(\sigma_a \times E_f)} + \frac{(1.9 \times W_{m1} \times h_G)}{(\sigma_a \times E_f \times d_{ga}^3)}$  (* in., required flange thickness *)

p = 0 (*psi, MAWP*)
Wm2
(* lb., Minimum required bolt load, for gasket seating *)

thg = dga √  $\frac{(C_a \times p)}{(\sigma_a \times E_f)} + \frac{(1.9 \times W_{m2} \times h_G)}{(\sigma_a \times E_f \times d_{ga}^3)}$  (* in., required flange thickness *)

0.13
402.5
1.
1.65
1015.06
0.331
77000.
16700
0.0923592
0.178038
0
526.462
0.109616

```

(* Miscellaneous Calculations *)

(* UG-36 Openings in Pressure vessels*)

(* UG-36 (c) (3) (d), No two unreinforced openings shall have their centers closer than the sum of their diameters: *)

(* This applies to all holes in the shell of the vessel. Actual holes have reinforcement built into the design so this is conservative. *)

$$d_1 = 2.87$$

$$d_2 = 0.5$$

$$l_s = d_1 + d_2$$

$$l = \frac{\pi \times 7.625}{4} \quad (* \text{ distance between holes} *)$$

$$l \geq l_s$$

$$2.87$$

$$0.5$$

$$3.37$$

$$5.98866$$

True

(* Drilled holes not penetrating shell *)

(* holes must be less than 2 " dia. & not less than 0.25 "*)

$$D_1 = 7.625$$

$$t = 0.5$$

$$D_1 / t$$

$$D_1 / t \geq 10$$

$$7.625$$

$$0.5$$

$$15.25$$

True

$$d_h = 0.375 \quad (* \text{ UNF } 3/8-16, \text{ major dia. } *)$$

$$d_h / D_1$$

$$0.375$$

$$0.0491803$$

Rt = 0.375 (* from graph *)
 If [$d_h / D_i < 0.03$, Rt = .25, Rt = Rt]

$t_{mn} = t(Rt)$ (* Appx. 30 Fig. 30-1, remaining wall thickness*)

0.375

0.375

0.1875

$$0.5 - 0.1875 = 0.313 \text{ in.}$$

$d_h = 0.250$ (* UNF 1/4-20, major dia. *)

d_h / D_i

0.25

0.0327869

Rt = 0.256 (* from graph *)

If [$d_h / D_i < 0.03$, Rt = .25, Rt = Rt]

$t_{mn} = t(Rt)$ (* Appx. 30 Fig. 30-1, remaining wall thickness*)

0.256

0.256

0.128

$$0.5 - 0.128 = 0.372 \text{ in.}$$

(* Drilled / tapped holes in unstayed flat head *)

(* reinforcement required, replacement of area *)

(* 8-32 for mini conflat *)

$t_r = 1.26123$ (* in., minimum required flange thickness *)

$t_a = 1.5$ (* in., actual flange thickness *)

$d_h = 0.164$ (* in., hole diameter *)

$d_d = 0.312$ (* in., depth of hole *)

$A_r = d_h \times d_d$ (* in.^2, area required *)

$A_a = d_h (t_a - d_d)$ (* in.^2, area available *)

If [$A_a > A_r$, "Reinforcement OK for mini-conflat blind holes",

"Reinforcement NOT OK for mini-conflat blind holes"]

1.26123

1.5

0.164

0.312

0.051168

0.194832

Reinforcement OK for mini-conflat blind holes

```
(* Drilled / tapped holes in unstayed flat head *)
(* reinforcement required, replacement of area *)
(* 8-32 for mounting brackets inside vessel *)
tr = 1.26123 (* in., minimum required flange thickness *)
ta = 1.5 (* in., actual flange thickness *)
dh = 0.164 (* in., hole diameter *)
dd = 0.25 (* in., depth of hole *)

Ar = dh × dd (* in.^2, area required *)
Aa = dh (ta - dd) (* in.^2, area available *)
If [Aa > Ar, "Reinforcement OK for mounting bracket blind holes",
  "Reinforcement NOT OK for mounting bracket blind holes"]
```

1.26123

1.5

0.164

0.25

0.041

0.205

Reinforcement OK for mounting bracket blind holes

```
(* Drilled / tapped holes in unstayed flat head *)
(* reinforcement required, replacement of area *)
(* 1/4-28 for medium conflat, center hole *)
tr = 1.26123 (* in., minimum required flange thickness *)
ta = 1.5 (* in., actual flange thickness *)
dh = 0.250 (* in., hole diameter *)
dd = 0.5 (* in., depth of hole *)

Ar = dh × dd (* in.^2, area required *)
Aa = dh (ta - dd) (* in.^2, area available *)
If [Aa > Ar, "Reinforcement OK for medium conflat blind holes",
  "Reinforcement NOT OK for medium conflat blind holes"]
```

1.26123

1.5

0.25

0.5

0.125

0.25

Reinforcement OK for medium conflat blind holes

```
(* Weld impact testing exemption calculation *)
(* UHA-51 (g) *)
Sa = 16700
S1 = 3499.17
Svm = 7754.6879
If [S1/Sa < 0.4, "Impact testing NOT required for weld",
    "Impact testing REQUIRED required for weld"]

16700

3499.17

7754.6879

Impact testing NOT required for weld

(* Base material Impact testing exemption *)
(* UHA-51 (d) (1) (a) austenitic chromium-nickel stainless steels: 304, 304 L,
    316, 316 L.
```


(* Fracture Critical Components *)

In[91]:= (* The applied stress is: *)

$R_i = 3.8125$

$R_o = 4.3125$

$MAWP = 978$

$\sigma_a = 16700$ (*allowable stress for 316 L SST*)

$\sigma_y = 37000$

$R_i = 3.8125$

$R_o = 4.3125$

$t = R_o - R_i$

$Ratio = \frac{R_o}{R_i}$

If [$1.1 < Ratio < 1.5$, medium wall]

If [$Ratio < 1.1$, thin wall]

If [$Ratio > 1.5$, thick wall]

(*Circumferential Stress, S_2 *)

$$S_2 = \frac{MAWP (R_o^2 + R_i^2)}{(R_o^2 - R_i^2)}$$

Out[91]= 3.8125

Out[92]= 4.3125

Out[93]= 978

Out[94]= 16700

Out[95]= 37000

Out[96]= 3.8125

Out[97]= 4.3125

Out[98]= 0.5

Out[99]= 1.13115

Out[100]= medium wall

Out[103]= 7976.34

(* First consider actual stress intensity factors from literature (testing). Then apply this $K_{Ic} = K_I$ value to the Xe vessel at its MAWP/stress *)

(* Degraded Piping Program Phase II, 4/99 *)

(* Material 304 and 316 stainless steel, range: 561 to 13,400 in-lb/in²,

J_I used is the lowest measurable value in all tests, parent or welded material *)

In[14]:=

$$J_i = 561 \quad (* \text{ in-lb/in}^2 *)$$

$$\nu = 0.33 \quad (* \text{ Poisson's ratio } *)$$

$$E_y = \frac{29.7 \times 10^6}{(1 - \nu^2)} \quad (* \text{ psi } *)$$

$$K_{Ic} = \sqrt{J_i \times E_y} \quad (* \text{ psi } \sqrt{\text{in}} *)$$

$$a_{crs} = \frac{1}{1.21 \pi} \left(\frac{K_{Ic}}{S_2} \right)^2 \quad (* \text{ in., crack critical length, surface flaw } *)$$

$$a_{cri} = \frac{1}{\pi} \left(\frac{K_{Ic}}{S_2} \right)^2 \quad (* \text{ in., crack critical length, imbedded flaw } *)$$

$$\text{length}_{crs} = 4 \times a_{crs}$$

$$\text{length}_{cri} = 4 \times a_{cri}$$

(* considering leak before break criteria,
leak occurs before catastrophic failure in a pressure vessel when *)

$$\sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left(\frac{S_2}{\sigma_y} \right)^2}} \quad (* \text{ Fracture and Fatigue Control in Structures,}$$

Rolfe and Barsom, Prentice-Hall, 1977, pg. 394*)

$$K_{Ic} >= \sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left(\frac{S_2}{\sigma_y} \right)^2}} \quad (* \text{ Hoop stress applies, } S_2 *)$$

$$\text{If} \left[K_{Ic} >= \sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left(\frac{S_2}{\sigma_y} \right)^2}}, \right.$$

"Leaking should occur before failure", "failure may occur before leaking"]

(* LIFE Expectancy Cycles *)

$$a_0 = 0.125 \quad (* \text{ in., initial flaw size } *)$$

$$A = 3.0 \times 10^{-10} \quad (* \text{ Metal Fatigue in Engineering, 1980, John Wiley \& Sons, pg 86 } *)$$

$$n = 3.25 \quad (* \text{ Metal Fatigue in Engineering, 1980, John Wiley \& Sons, pg 86 } *)$$

$$N_f = \frac{2}{2-n} \left(\frac{1}{A \left(1.12 \frac{S_2}{1000} \sqrt{\pi} \right)^n} \right) \left(a_{crs}^{\left(\frac{2-n}{2} \right)} - a_0^{\left(\frac{2-n}{2} \right)} \right)$$

(* Damage Tolerant Design Handbook " V.2, 1983 *)

$$N_f = \frac{2}{2-n} \left(\frac{1}{A \left(1.12 \frac{S_2}{1000} \sqrt{\pi} \right)^n} \right) \left(a_{cri}^{\left(\frac{2-n}{2} \right)} - a_0^{\left(\frac{2-n}{2} \right)} \right)$$

(* Damage Tolerant Design Handbook " V.2, 1983 *)

Out[14]= 561

Out[15]= 0.33

```
Out[16]=  $3.33296 \times 10^7$   
Out[17]= 136740.  
Out[18]= 77.3126  
Out[19]= 93.5482  
Out[20]= 309.25  
Out[21]= 374.193  
Out[22]= 10115.1  
Out[23]= True  
Out[24]= Leaking should occur before failure  
Out[25]= 0.125  
Out[26]=  $3. \times 10^{-10}$   
Out[27]= 3.25  
Out[28]=  $2.42577 \times 10^6$   
Out[29]=  $2.43076 \times 10^6$ 
```

```

In[60]:= (* For the ellipsoidal head *)
Di = 7.625
tw = 0.5
Ef = 0.7 (*butt weld efficiency based on no inspection, Table UW-12*)


$$\sigma = \frac{\text{MAWP} (D_i + 0.2 t_w)}{(2 E_f t_w)}$$

S2 =  $\sigma$ 

$$a_{\text{crs}} = \frac{1}{1.21 \pi} \left( \frac{K_{\text{Ic}}}{S_2} \right)^2 \quad (* \text{ in., crack critical length, surface flaw } *)$$


$$a_{\text{cri}} = \frac{1}{\pi} \left( \frac{K_{\text{Ic}}}{S_2} \right)^2 \quad (* \text{ in., crack critical length, imbedded flaw } *)$$

lengthccrs = 4 × acrs
lengthccri = 4 × acri

(* considering leak before break criteria,
leak occurs occurs before catastrophic failure in a pressure vessel when *)

$$\sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left( \frac{S_2}{\sigma_y} \right)^2}} \quad (* \text{ Fracture and Fatigue Control in Structures,}$$

Rolfe and Barsom, Prentice-Hall, 1977, pg. 394*)

$$K_{\text{Ic}} \geq \sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left( \frac{S_2}{\sigma_y} \right)^2}} \quad (* \text{ Hoop stress applies, } S_2 *)$$

If [KIc ≥  $\sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left( \frac{S_2}{\sigma_y} \right)^2}}$  ,
"Leaking should occur before failure", "failure may occur before leaking"]

(* LIFE Expectancy Cycles *)

a0 = 0.125 (* in., initial flaw size *)
A = 3.0 × 10-10 (* Metal Fatigue in Engineering, 1980, John Wiley & Sons, pg 86 *)
n = 3.25 (* Metal Fatigue in Engineering, 1980, John Wiley & Sons, pg 86 *)


$$N_f = \frac{2}{2-n} \left( \frac{1}{A \left( 1.12 \frac{S_2}{1000} \sqrt{\pi} \right)^n} \right) \left( a_{\text{crs}}^{\left( \frac{2-n}{2} \right)} - a_0^{\left( \frac{2-n}{2} \right)} \right)$$

(* Damage Tolerant Design Handbook " V.2, 1983 *)

$$N_f = \frac{2}{2-n} \left( \frac{1}{A \left( 1.12 \frac{S_2}{1000} \sqrt{\pi} \right)^n} \right) \left( a_{\text{cri}}^{\left( \frac{2-n}{2} \right)} - a_0^{\left( \frac{2-n}{2} \right)} \right)$$

(* Damage Tolerant Design Handbook " V.2, 1983 *)

Out[60]= 7.625

Out[61]= 0.5

Out[62]= 0.7

```

```
Out[63]= 10792.9
Out[64]= 10792.9
Out[65]= 42.2259
Out[66]= 51.0934
Out[67]= 168.904
Out[68]= 204.373
Out[69]= 13824.2
Out[70]= True
Out[71]= Leaking should occur before failure
Out[72]= 0.125
Out[73]=  $3. \times 10^{-10}$ 
Out[74]= 3.25
Out[75]= 900192.
Out[76]= 902921.
```

```

In[104]:= (* For the flat head *)

σ = 5182.85 (* from head_350_K_openings2.nb*)
S2 = σ

acrs =  $\frac{1}{1.21 \pi} \left( \frac{K_{IC}}{S_2} \right)^2$  (* in., crack critical length, surface flaw *)
acri =  $\frac{1}{\pi} \left( \frac{K_{IC}}{S_2} \right)^2$  (* in., crack critical length, imbedded flaw *)
lengthccrs = 4 × acrs
lengthccri = 4 × acri

(* considering leak before break criteria,
leak occurs occurs before catastrophic failure in a pressure vessel when *)
 $\sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left( \frac{S_2}{\sigma_y} \right)^2}}$  (* Fracture and Fatigue Control in Structures,
Rolfe and Barsom, Prentice-Hall, 1977, pg. 394*)

KIC >=  $\sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left( \frac{S_2}{\sigma_y} \right)^2}}$  (* Hoop stress applies, S2 *)

If[KIC >=  $\sqrt{\frac{\pi t S_2^2}{1 - \frac{1}{2} \left( \frac{S_2}{\sigma_y} \right)^2}}$ ,

"Leaking should occur before failure", "failure may occur before leaking"]

(* LIFE Expectancy Cycles *)

ao = 0.125 (* in., initial flaw size *)
A = 3.0 × 10-10 (* Metal Fatigue in Engineering, 1980, John Wiley & Sons, pg 86 *)
n = 3.25 (* Metal Fatigue in Engineering, 1980, John Wiley & Sons, pg 86 *)

Nf =  $\frac{2}{2-n} \left( \frac{1}{A \left( 1.12 \frac{S_2}{1000} \sqrt{\pi} \right)^n} \right) \left( a_{crs}^{\left( \frac{2-n}{2} \right)} - a_o^{\left( \frac{2-n}{2} \right)} \right)$ 

(* Damage Tolerant Design Handbook " V.2, 1983 *)

Nf =  $\frac{2}{2-n} \left( \frac{1}{A \left( 1.12 \frac{S_2}{1000} \sqrt{\pi} \right)^n} \right) \left( a_{cri}^{\left( \frac{2-n}{2} \right)} - a_o^{\left( \frac{2-n}{2} \right)} \right)$ 

(* Damage Tolerant Design Handbook " V.2, 1983 *)

Out[104]= 5182.85

Out[105]= 5182.85

Out[106]= 183.113

Out[107]= 221.567

Out[108]= 732.454

Out[109]= 886.269

```

Out[110]= 6527.84

Out[111]= True

Out[112]= Leaking should occur before failure

Out[113]= 0.125

Out[114]= $3. \times 10^{-10}$

Out[115]= 3.25

Out[116]= 9.92359×10^6

Out[117]= 9.93542×10^6

```
(* Fragment Evaluation *)
```

```
(* It is assumed that the most vulnerable point in this vessel is the Ceramaseal high voltage feedthroughs mounted to the mini-Conflats which are mounted to the 350 MOP head. These could easily be bumped or damaged by mishandling resulting in a fragment / projectile. The following will estimate the shielding thickness required for personnel protection near the vessel head. Also assume all of the energy is transferred to a single fragment. *)
```

```
In[22]:= mfg = 37.7 (* g; actual measurment *)  
mfu = mfg * 6.852 × 10-5 (* lb.s2/ft; slugs *)
```

$$v_f = \sqrt{\frac{2 \text{ Energy}}{m_{fu}}} \quad (* \text{ ft/s } *)$$

```
Out[22]= 37.7
```

```
Out[23]= 0.0025832
```

```
Out[24]= 6575.9
```

```
In[21]:= (* Check zero mass velocity. Fragemnt can travel no faster than the shock wave that is driving it. *)
```



```

P_ratio =  $\frac{P_1}{P_2}$  (* *)

g = 32.2 (* ft/s^2 *)
T = 528 (* °R *)
k = 1.4
R = 53.3 (* ft-lb/lb-°R *)
a =  $\sqrt{k g R T}$ 
v_f1 = a * 2.55 (* ft/s Figure 12 Zero Mass velocity *)
v_f12 = v_f1 * Cos[ $\frac{0.785398}{2}$ ] (* MEDSS eqn. 38 *)
v_f1m = v_f1 * 0.3048 (* m/s *)
v_f1m2 = v_f1 * 0.3048 (* m/s *)
m1 =  $\frac{2 \text{ Energy}}{v_{f1}^2}$  32.2 (* lb_m; largest fragment that can achieve this velocity *)

```

```
Out[94]= 66.5306
```

```
Out[95]= 32.2
```

```
Out[96]= 528
```

```
Out[97]= 1.4
```

```
Out[98]= 53.3
```

```
Out[99]= 1126.35
```

```
Out[100]= 2872.19
```

```
Out[101]= 2653.55
```

```
Out[102]= 875.443
```

```
Out[103]= 808.804
```

```
Out[104]= 0.436013
```

```

(* The Ceramaseal feedthrough mass is <
   m1 so it can only achieve this maximum velocity.

```

```
Fragment shielding evaluation..... *)
```

```
In[105]:= T_m = 6 \times 10^{-5} \left( \frac{m_{fg}}{1000} \right)^{0.33} v_{flm} (* UK formula *)
```

```
T_m = T_m \times 12 \times 3.28084 (* in *)
```

```
(* Thor formula: Lexan *)
```

```
\alpha = 1.814
```

```
\beta = -1.652
```

```
c_1 = 7.329
```

```
A_f = \frac{\pi 0.5^2}{4}
```

```
T_{in} = \frac{1}{A_f} \left( \frac{v_{fl}}{10^{c_1} \left( 7000 \frac{m_1}{32.2} \right)^\beta} \right)^{\frac{1}{\alpha}}
```

```
Out[105]= 0.0178062
```

```
Out[106]= 0.701032
```

```
Out[107]= 1.814
```

```
Out[108]= -1.652
```

```
Out[109]= 7.329
```

```
Out[110]= 0.19635
```

```
Out[111]= 2.36231
```

```
(* After ricochet the shielding thickness needs to be:*)
```

$$T_m = 6 \times 10^{-5} \left(\frac{m_{fg}}{1000} \right)^{0.33} v_{f1m2} \quad (* \text{ m; UK formula } *)$$

$$T_m = T_m \times 12 \times 3.28084 \quad (* \text{ in } *)$$

(* Thor formula: Lexan *)

$$\alpha = 1.814$$

$$\beta = -1.652$$

$$c_1 = 7.329$$

$$A_f = \frac{\pi 0.5^2}{4}$$

$$T_{in} = \frac{1}{A_f} \left(\frac{v_{f12}}{10^{c_1} \left(7000 \frac{m_1}{32.2} \right)^\beta} \right)^{\frac{1}{\alpha}}$$

Out[112]= 0.0164508

Out[113]= 0.647669

Out[114]= 1.814

Out[115]= -1.652

Out[116]= 7.329

Out[117]= 0.19635

Out[118]= 2.26142



File No. MESN99-038-0A
July 2, 1999

MECHANICAL ENGINEERING SAFETY NOTE

Gas Delivery System and Reclamation Cylinders for Gamma Ray Imager

Prepared by:

Blake Myers
Mechanical Engineer
New Technologies Engineering Division

Reviewed by:

Chuck Borzileri
Pressure Consultant
Applied Research Engineering Division

Dan Archer
Experimental Physicist
C&MS Directorate/NAI Program

Approved by:

Satish Kulkarni
Division Leader
New Technologies Engineering Division

Distribution:

Dan Archer, L-186
Chuck Borzileri, L-384
Satish Kulkarni, L-113
Blake Myers, L-174
Tim Ross, L-474
Kathlyn Snyder, L-172
Klaus Ziock, L-43
Engineering Records Center, L-118

Description of the System:

This safety note covers the gas delivery system and the gas reclamation cylinders used in a full volume gamma ray imager located in Building 132S, Room 2723. There are three parts to the imager. The first part is the gas delivery system built commercially by Insync Systems. It is used to purify and deliver electronegative free (99.9999999%) gas at an MOP of 135 psig. The second part of the system consists of two time projection chambers (TPC) where the experiments will be performed. The TPCs will nominally operate at 300psig but one has been designed for 400 and the other for 980 psig MAWP. They are covered by a separate safety note titled Time Projection Chamber, MESN99-020-0A. The third part of the system uses cryogenic reclamation cylinders to reclaim the purified gas. These cylinders have been fabricated by Acme Cryogenics and are rated by Acme to 2200 psig MAWP. The system layout is seen in Fig. 1. Gas will be transferred in the system by thermal cycles, using LN2 to create the temperature gradient via conduction through the walls of the reclamation cylinders. A certain percentage of alcohol may be used in the LN2 bath to raise the temperature of the bath above 77K. The asphyxiation hazard associated with the evaporation of LN2 and alcohol is dealt with in OSP 132S.31.

Note that there are four MAWPs in this system. They are MAWP0 for the input to the Supply Panel, MAWP1 for the Gas Delivery portion, MAWP2 for TPCs and MAWP3 for the Gas Reclamation portion.

The Gas Delivery System purifies research grade gas to an ultraclean gas that is free of electronegative materials. It consists of a Control Panel plus 4 secondary panels and connecting plumbing. A schematic is shown in Fig. 2. All of the process valves on the secondary panels are all metal, bellows sealed valves actuated with 50 psig house air with manual switches controlling the air. The switches are on the Control Panel. The secondary panels are designated as: Supply, Fig. 3, Purification, Fig. 4, Chamber, Fig. 5 and Reclamation, Fig. 6.

The Supply Panel has connections for three gas cylinders of research grade (99.999%) gas. The gas cylinders will contain Ar, Xe and CO₂. (There may be interest in using combustible gases in later stages of this research. A revision of this note would be written to cover such work.) The pressure output of the cylinders is limited by a regulator to 135 psig MOP and protected by a 157 psig rupture disc. It is connected to the Purification and Reclamation panels as shown in Fig.2.

The Purification Panel includes a room temperature getter (Oxisorb Model S511-HV) followed by a hot getter (SAES Phase 1 MonoTorr). The Oxisorb and the MonoTorr

both have a manufacturer's MOP of 150 psig. The material in the getters can be returned to the manufacturer, after being saturated, for regeneration or disposal. There is a mass flow controller and a 157 psig rupture disk following the MonoTorr. The output of the Purification Panel flows to 3 places: 1) the Chamber Panel which leads to the TPC's, 2) the recirculation pump (which is currently replaced by a jumper) and 3) the Reclamation Panel, again as shown in Fig. 2.

The Chamber Panel provides gas flow to the TPCs, the turbomolecular pump (TMP) and system vent. The gas flow/pressure from the chamber into the rest of the system is restricted operationally by pressure regulators at the outlet of the chambers. Intermediate pressure gas is prevented from pressuring the purification panel above the MOP of 135 psig by both purification system operating procedures and a 157 psig rupture disk.

The rupture disc reliability is closely regulated by the manufacturer to the requirement that 2 discs from the involved lot rupture at the lot pressure plus or minus 5%. The lot pressure is the average of the two test disc rupture pressures and it must fall into the manufacturing range of $-4 / +7$ % of the pressure that is ordered by the customer. The lot pressure is stamped on a tag attached to the disc body. It is 157 psig. This means that MAWP1 could be as high as 168 psig for the low pressure portion of the the system. We designate MAWP1 at the lot pressure of 157 psig.

Overpressuring the TPCs will be prevented in final operations by: 1- monitoring and controlling gas flow into the chamber with the Mass Flow Controller, 2- using a load cell with 50 gm resolution interlocked to the valve allowing flow into the chamber, 3- having 402 psig rupture disks on the chambers. In preliminary operations the mass flow controller will be used under 2-man operator control to limit the amounts of Xe to 840 gm and Ar to 250 gm as measured by a Data Instruments load cell with a resolution of 200 gm. This would limit the TPC pressure to $<3/8$ the MAWP2 or ~ 150 psig as shown in Tables 1 and 2 respectively. The operators will have pressure readings on the TPCs to confirm the control and can revert to LN2 cooling and venting to limit the pressure. There is inherent safety in gas transfer from a TPC to a reclamation cylinder in that the volume ratio, TPC to RC, is ~ 3 but the MAWP ratio is $400/2200$ or $\sim 1/5$.

The Reclamation Panel allows for gas to be transferred into or out of the reclamation cylinders. These cylinders attach to the reclamation panel with a VCR fitting (for cleanliness) immediately followed by a rupture disc set at 2230 psig and a pressure transducer. They each have a volume of 5.36 liter. Gas is drawn into a reclamation cylinder by dipping it in a surrounding cryogenic bath of LN2 or LN2/alcohol mix. In preliminary operations the mass of Xe in a reclamation cylinder will be limited by 2-man operator control to 8 kg and Ar in a separate cylinder to 650 gm as measured by a Data Instruments load cell with a resolution of 200 gm. This will limit the pressure to $<1/2$ of MAWP3 or ~ 1000 psig as shown in Tables 1 and 2 respectively. The associated pressure transducer reading will confirm the 2-man operator control. Above these masses the

cylinder will be weighed with a load cell from Data Instruments to measure the amount of gas in the cylinder. As above, in final configuration the load cell will be interlocked to the inlet flow valve,

The characteristics of the gases of interest are given in the following table:

Table 1. Process Gas Characteristics

Gas	Mol. Wt. grams	Melting Point °C	Boiling Point °C	Critical Temp °C	Critical Pressure psia	Critical Density g/ml
Ar	39.95	-189.4	-185.9	-122.4	705.4	0.531
Xe	131.1	-111.9	-108.1	16.6	846.7	1.155
CO ₂	44.01	-56.6	-78.4*	16.6	1070.6	0.460

* Sublimation Temperature

Tables 2 and 3 respectively show that <10.6 kg of Xe and <1.3 kg of Ar will limit the cylinder pressures to less than the 2200psig MAWP3. The reclamation cylinders themselves weigh about 75 lbs. The present load cells have a 300 lb capacity, a 0.5 lb resolution and a tare weight removal feature on the readout.

Table 2. Pressure vs Mass of Argon in a Reclamation Cylinder or a TPC

reclaim cyl	(liters)=	5.4				
T=294K			Reclaim		TPC	
p(atm)	p(psi)	moles/liter	V Ar@1atm	mass(kg)	V Ar@1atm	mass(kg)
1	14.7	0.0	5.4	0.01	15.04	0.02
1.5	22.05	0.1	8.1	0.01	22.57	0.04
2	29.4	0.1	10.8	0.02	30.10	0.05
3	44.1	0.1	16.2	0.03	45.34	0.08
4	58.8	0.2	21.5	0.04	60.28	0.10
5	73.5	0.2	26.9	0.04	75.40	0.12
6	88.2	0.2	32.4	0.05	90.55	0.15
7	102.9	0.3	37.8	0.06	105.71	0.18
8	117.6	0.3	43.2	0.07	120.89	0.20
9	132.3	0.4	48.6	0.08	136.09	0.23
10	147	0.4	54.1	0.09	151.31	0.25
15	220.5	0.6	81.4	0.13	227.70	0.38
20	294	0.8	108.8	0.18	304.56	0.50
25	367.5	1.1	136.5	0.23	381.89	0.63
30	441	1.3	164.3	0.27	459.66	0.76
35	514.5	1.5	192.2	0.32	537.87	0.89
40	588	1.7	220.3	0.37	616.50	1.02
45	661.5	1.9	248.5	0.41	695.52	1.15
50	735	2.1	276.9	0.46	774.91	1.28
60	882	2.6	334.0	0.55	934.73	1.55
70	1029	3.0	391.6	0.65	1095.77	1.82
80	1176	3.5	449.5	0.74	1257.79	2.08
90	1323	3.9	507.6	0.84	1420.57	2.35
100	1470	4.4	566.0	0.94	1583.82	2.62
120	1764	5.3	682.7	1.13	1910.65	3.17
140	2058	6.2	799.0	1.32	2235.95	3.71
160	2352	7.1	913.8	1.51	2557.34	4.24
180	2646	7.9	1026.5	1.70	2872.59	4.76
200	2940	8.8	1136.2	1.88	3179.75	5.27
220	3234	9.6	1242.5	2.06	3477.20	5.76
240	3528	10.4	1344.9	2.23	3763.74	6.24
260	3822	11.1	1443.1	2.39	4038.63	6.69
280	4116	11.9	1537.0	2.55	4301.43	7.13
300	4410	12.6	1626.6	2.70	4551.99	7.54

from Thermodynamic Properties of Argon from the Triple Point to 300 K At Pressures to 1000 Atmospheres QD 162 G1 1969B A.L.Gosman

Table3. Pressure vs Mass of Xenon in a Reclamation Cylinder or a TPC

	reclaim cyl (liters)=		5.36				
	T=295K			Reclaim (Liters)		TPC (Liters)	
m ³ /kg	p(atm)	p(psi)	moles/liter	V Xe@1at	mass(kg)	V Xe@1at	mass(kg)
185.80	1.0	14.5	0.0	5.3	0.03	14.91	0.08
36.33	4.9	72.4	0.2	27.3	0.15	76.27	0.41
17.63	9.9	144.9	0.4	56.2	0.30	157.17	0.85
11.38	14.8	217.3	0.7	87.0	0.47	243.50	1.31
8.24	19.7	289.8	0.9	120.2	0.65	336.36	1.81
6.34	24.7	362.2	1.2	156.1	0.84	436.92	2.35
5.07	29.6	434.7	1.5	195.5	1.05	547.08	2.94
4.14	34.5	507.1	1.8	239.3	1.29	669.64	3.60
3.43	39.5	579.6	2.2	289.0	1.56	808.81	4.35
2.85	44.4	652.0	2.7	347.1	1.87	971.25	5.23
2.37	49.3	724.5	3.2	418.1	2.25	1170.17	6.30
1.93	54.3	796.9	3.9	512.2	2.76	1433.51	7.72
1.50	59.2	869.4	5.1	662.3	3.56	1853.49	9.98
0.86	64.2	941.8	8.8	1147.7	6.18	3211.98	17.29
0.67	69.1	1014.3	11.4	1483.2	7.98	4150.65	22.34
0.62	74.0	1086.7	12.3	1594.5	8.58	4462.12	24.02
0.60	79.0	1159.2	12.8	1664.1	8.96	4657.10	25.07
0.58	83.9	1231.6	13.2	1715.5	9.23	4800.72	25.84
0.56	88.8	1304.1	13.5	1756.9	9.46	4916.56	26.46
0.55	93.8	1376.5	13.8	1791.5	9.64	5013.52	26.98
0.54	98.7	1449.0	14.0	1821.5	9.80	5097.45	27.44
0.53	108.6	1593.9	14.4	1871.8	10.07	5238.14	28.19
0.52	118.4	1738.8	14.7	1913.0	10.30	5353.50	28.81
0.51	128.3	1883.7	15.0	1949.1	10.49	5454.67	29.36
0.50	138.2	2028.6	15.2	1980.3	10.66	5541.95	29.83
0.49	148.0	2173.5	15.5	2008.8	10.81	5621.78	30.26
0.49	157.9	2318.4	15.7	2034.9	10.95	5694.56	30.65
0.48	167.8	2463.3	15.8	2058.5	11.08	5760.86	31.01
0.48	177.6	2608.2	16.0	2081.0	11.20	5823.82	31.34
0.47	187.5	2753.1	16.2	2100.5	11.31	5878.18	31.64
0.47	197.4	2897.9	16.3	2119.8	11.41	5932.29	31.93
0.46	217.1	3187.7	16.6	2153.9	11.59	6027.79	32.44
0.45	236.9	3477.5	16.8	2185.8	11.76	6116.94	32.92
7.19	79.0	1159.2	3.5	452.6	0.75	<- Ar for comparison	

Once the gas has been condensed in the bottom of the reclamation cylinders, pressure is built in the reclamation cylinders by removing the cryogenic bath. Gas is introduced into the low pressure loop of the system through a regulator as shown in Fig. 2. The pressure of the gas is monitored with a pressure transducer and is physically limited by a 157 psig rupture disk. Normal gas flow is into the Gas Purification System from the reclamation cylinders.

InSync Systems certifies the tubing, fittings and weldments as shown in Appendices D-G. Copies of all InSync certification documents are attached in AppendixD.

Hazards:

The LLNL safety guidance is to calculate the isentropic energy release associated with the expansion of the contained gas from MAWP3 to the local atmospheric pressure. The pertinent equation is

$$E = kRT / (k-1) ((p_2/p_1)^{1/k} - 1), \quad \text{ftlb/lb}$$

Using values as follows

$k = 1.67$ for Ar and Xe, 1.3 for CO_2 , $T = 530\text{R}$, $p_1 = 2244.3$ psia, $p_2 = 14.3$ psia, $R = 1545/\text{MW}$ ft lb / lb F, MW for Ar = 39.9 , for Xe = 131.3 , for $\text{CO}_2 = 44$, storage masses for Ar and Xe from Tables 1 and 2 and for CO_2 from 5.36 liter and perfect gas density

gives the greatest total delta energy for Xe of $3.26\text{E}5$ ft lb / cylinder equivalent to 97.8 gm of TNT. The total is over the $7.5\text{E}4$ ft lb level prescribed as the lower limit for requiring a safety note for manned area equipment. A lower total delta energy value results for CO_2 because its three atom molecule lowers k from 1.67 to 1.30 and for Ar because of its greater departure from a perfect gas.

The operational pressure hazards are tempered by the use of rupture discs to limit the service pressures to the MAWPs. These discs are closely controlled by their manufacturers as discussed earlier.

Two-man operator judgment is required to limit the fill gas weights in initial runs to give pressures of \sim half MAWP3. There will be interlocks on the TPC and reclamation cylinder fill levels to prevent over charging before going on to higher fill weights and pressures.

There is a slight potential for asphyxiation associated with the free evaporation of LN_2 and for excessive noise associated with valve venting. These hazards are discussed in OSP 132S.31.

Pressure Safety Assessment:

Acme designed the reclamation cylinders in accordance with ASME Boiler and Pressure Vessel Code, Section 8, Division 1, 1998. These calculations are shown in Appendix B. They did not Code stamp the vessels for reasons that are not clear at this juncture. The fabrication drawing is shown in Appendix C. As shown the cylindrical portion is 4-in. Schedule 160 pipe with an OD of 4.50 in. and an ID of 3.44 in. The heads are 4-in Schedule 160 welding pipe caps with the same inner and outer diameter as the pipe as

shown also in Appendix C. The welds are full penetration with a standard 37.5 degree bevel on each part. The cylinder material is Type 316L stainless steel. The minimum thickness of the wall of the vessel nozzle is 0.035 in. as shown in Appendix C. The ID of the nozzle is 0.180 so that the nominal stress at MAWP3 is $p r / t = 2200 * 0.090 / 0.035 = 5700$ psi.

Thick wall pressure vessel calculations for the main body in accordance with Timoshenko (2) show a von Mises stress (Timoshenko (3)) of 5.7 ksi which gives a factor of safety of 32 on the 316L steel at ~70K and 17 (Aerospace Materials ... (4)) at room temperature. All welding at Acme was done by ASME Code certified welders. Acme tested all four cylinders at 3300 psig.

InSync Systems fabricated all of the panel plumbing in their shop under SEMI (Semiconductor Equipment and Materials International) rules. All pressure boundaries are Type 316 stainless. All welding is automatic Orbital. Fabrication conditions are clean to meet the SEMI standards. Table 4 and Appendix D show the properties of the components in the InSync assemblies. The pressure ratings for the components are seen to be a minimum of 200 psig for the low pressure system, 1000 psig for the 980 psig system and 2200 psig for the 2200 psig system. SEMI standards do not require a pressure check of plumbing in order to maintain the cleanliness of the internal surfaces. InSync did a vacuum leak test of the plumbing in each panel with the satisfactory results shown in Appendix E. InSync did the panel connecting plumbing at Livermore. The table shows the tubing and fittings to be well above the 157 psig MAWP1.

This note provides for (1) pressure proof testing at 1.27 X MAWP1 of all of the branches which are rated at an MAWP1 of 157 psig, (2) leak testing at 0.5 X MAWP2 of the TPC circuit and (3) pressure proof testing of the high pressure portion of the Reclamation Panel and Cylinder circuits at 0.85 X MAWP3. The 157 psig branches test pressure level is limited by the 200 psig limit of the Supply Panel regulator output pressure gages. The TPC circuit test pressure is limited for operational convenience noting that the chambers have been tested to 1.5 X MAWP2 separately and that the valves and hoses are rated well above MAWP2. The Reclamation Panel and Cylinder test pressure level is limited by the need to preserve the high pressure rupture discs. Here it is noted that the chambers have been pressure tested separately to 1.5 X MAWP3 plus the valves and Swagelok flex tubing are rated well above MAWP3.

Table 4. Component Pressure Ratings

Component	Pressure Rating	Remarks
Valves, Supply and Reclaim Panel	3500 psig	Nupro SS-HBVCR4-P-C
Valves, Chamber Panel	1000 psig	Nupro SS-8BG-VCR-3C
Valves, Chamber discharge	1000 psig	Nupro SS-8BG-VCR-3C
Reclamation Cylinders	2200 psig	Acme Cryogenics
Pressure regulators, S. & R. Panels	3500 psig	Tescom 64-2663KRA10
Pressure regulators, Chmbr Disch	3500 psig	Tescom 64-2663KRH19
Rupture disc, low pressure	157 psig, +/-5%	Zook 306546
Rupture disc, high pressure	2230 psig, +/-5%	Zook 306953
Pressure transducer, low pressure	5000 psig	Bendix C2143000C-834655
Pressure transducer, high pressure	10000 psig	Bendix C214250C-834655
Pressure gage, low pressure	200 psig	Tescom 4802-0200M
Pressure gage, high pressure	3000 psig	Tescom 4802-3000M
Oxygen getter	150 psig	Oxisorb S511-HV
SAES Getter	150 psig	Monotorr Phase 1
Mass flow controller	1500 psig	Brooks 5964C4MAP35KA
VCR plugs, 1/4 in.	5100 psig	Cajon SS-4-VCR-P
VCR caps, 1/4 in.	5100 psig	Cajon SS-4-VCR-CP
VCR caps, 1/2 in.	5100 psig	Cajon SS-8-VCR-CP
VCR gaskets, 1/4 in., unplated, nickel	NA	Cajon NI-4-VCR-2-GR-VS
Welding fittings	5100 psig	Swagelok Microfit
Tubing, 1/4 in.	4140 MSWP	316L, ASTM A269
Tubing, 3/8 in.	2770 MSWP	316L, ASTM A269
Tubing, 1/2 in.	2910 MSWP	316L, ASTM A269

Pressure Testing Preparation

The purpose of the pressure testing is to demonstrate that the overall system is leak tight as assembled and that all panel and interconnect plumbing is pressure safe. The low pressure rupture disc bodies are massive and difficult to open without jeopardizing the integrity of the panel plumbing and the discs themselves so that a buffer array as shown in Fig. 7 will be used to remove any pressure difference on the discs during pressure testing.

Prior to testing it is necessary it is necessary to carry out the following procedures. Please refer to Figs. 2 and 7 for component identification.

First introduction of gas into the system:

The gas should be introduced into the system in stages. The gas handling system is under a slight pressure, a few psi, from when the system was assembled at InSync.

1. The Dirty Gas Bottle should be installed and attached to the supply gas panel with a regulator and CGA flex tube connector
2. Perform a cycle purge on the section of tubing where the bottle was connected. Use the Ar cylinder as a purge gas.
 - b) Hook up Ar cylinder with a regulator and CGA hose
 - c) Open Valve 11
 - d) Crack Ar Cyl and regulator
 - e) Cycle Valve 11 a few times ending with Valve 11 open
 - f) Close then Crack Ar cyl a few times
 - g) Allow Ar to flow for a few minutes
 - h) With Ar bleeding off, close Valve 11
 - i) Open Ar Cylinder completely
 - j) Make sure Regulator is closed
 - k) Open Valve 10

The other dirty supply lines should be purged in a similar manner. This will require opening the valves corresponding to V11 which are V21 and V31, closing them as above and opening the V10 equivalents, V20 and V30. When the Ar purge is complete, purge for a few seconds with the gas that is going to be used in the system on that line to clean out any Ar.

3. Proceed to introduce the gas into the rest of the system opening only one valve at a time until you reach the Mass Flow Controller.
4. Make sure the Mass Flow Controller is in the closed position before gas is introduced on the inlet side of the controller. Once gas pressure is built on the inlet side of the Mass Flow Controller, crack the controller open and allow a little gas to flow through, then open the controller slowly until it is full open.
5. Flow gas through the remainder of the system making sure to go thru both the chamber section of tubing and the reclaim sections.
6. Gas should be collected in the reclaim cylinders starting with Reclaim 4 and working back to Reclaim 1. Cryo (LN2) will have to be used to collect the gas in the reclaim cylinders.
7. If necessary, gas can be vented through Valve 95.

Adding a new cylinder of Dirty Gas (at least Research Grade):

1. Ensure all valves (V10-V11-V12, V20-V21-V22, V30-V31-V32) are closed near the cylinder, including the main valve on the cylinder.
2. Remove the old cylinder.
3. Place the new cylinder in the rack and attach the CGA fitting leading to the Gas Handling system.

4. Cycle purge the lines with the following prescription that shows Xe as an example. There should be a bottle of Ar on the system. If you are replacing the Ar cylinder, use the new cylinder of Ar for the cycle purge.
 - d) Hook up Xe cylinder with a check valve in the discharge line to prevent inflow
 - e) Open Valve 22 (Ar for Cycle Purge)
 - f) Ar Cyl should be open. If not, follow cycle purge above to ensure that opening the Ar cyl does not introduce dirt into the system.
 - g) Open Valve 22 to introduce gas into the purge line
 - h) Open Valve 11
 - i) Open Valve 12
 - j) Allow Ar to flow and blow the line out
 - k) Close Valve 11
 - l) Close Valve 12
 - m) Close Ar Cyl Valve
 - n) Cycle Valve 21
 - o) Close Valve 22
 - p) Open Valve 11
 - q) Crack Xe Cyl open
 - r) Close Valve 11
 - s) Work Xe Cyl valve open and closed to get dirt out ending in Closed position
 - t) Cycle Valve 11 ending in closed position
 - u) Open Xe Cyl Valve
 - v) Make sure Regulator is Closed
 - w) Open valve 10
 - x) Now use the regulator to introduce gas into the system

Pressure Testing

The following testing is to be carried out by a Pressure Inspector, a Pressure Installer, a mechanical engineer and the chief experimenter .

Clear the area and put up the signs and barricades.

1. Overall system low pressure test.

Having swept the plumbing in accordance with the previous procedure connect a research grade gas bottle to the Ar supply connection with a regulator and CGA flex hose.

Check that a rupture disc buffer array has been installed which connects the supply panel vent line to the four 157 psig rupture disc discharge connections as shown in Fig. 7.

Check that the source bottle supply and regulator valves are closed.

Check that all valve positions on the control boards show closed.

Check that the four reclamation cylinders are connected to their respective pigtails as shown on the Insync schematic (Fig. 2).

Check that TPC1 is connected between V91 and V96 and that jumpers are connected between V93 and V97 and between V88 and V98.

Check that 3 supply, 2 TPC and 4 reclaim regulators are closed (adjusting handle fully CCW).

Open the source bottle stop valve and set the regulator to 200 psig.

Verify that PT1 and PT2 read zero psig.

Reduce the source pressure to ~20 psig.

Open all valves one at a time except V83, V86 and V95.

This involves a total of 43 numbered valves as follows,

V10, V11, V12, V13, V20, V21, V22, V23, V30, V31, V32, V33, V40, V41, V42, V43, V50, V51, V52, V53, V60, V61, V62, V63, V70, V71, V72, V80, V81, V82, V84, V85, V87, V88, V89, V90, V91, V92, V93, V94, V96, V97, V98,

plus 3 Supply Panel, 4 Reclaim Panel and 2 TPC pressure regulators for an overall total of 52 items.

Raise the source pressure to 50 psig, verify that PT1 and PT2 read 50 psig.

Shut off the source pressure and show that PT1 and PT2 hold 50 psig for 5 minutes.

If there is a leak, leak hunt with an audio leak detector, repair the leak and retest.

Repeat this pressurize, shut off, hold procedure at 100, and 150 psig.

Raise the source pressure to 200 psig, verify that PT1 and PT2 read 200 psig.

Shut off the source pressure and show that PT1 and PT2 hold >195 psig for a period of one hour.

If the pressure falls below 195 psig, shut off the source pressure and vent the system by simultaneously cracking V-Test 1 and V-Test 2 and adjusting them for a pressure drop rate of ~15 psi/ min with the pressure at V-Test 1 kept ~5 to 10 psig below that at V-Test 2, repair the leak and return directly to the 200 psig test level for verification.

When the 200 psig test results are satisfactory vent the system in the same way.

Close the 43 numbered valves and the 9 pressure regulators.

Remove the buffer array.

2. Supply Panel Input High Pressure Test

Since the Supply Panel input manifold will be pressurized directly to a bottle pressure MOP of up to 2000 psig in normal operation and since it is not pressure relieved it is necessary to test it to 3300 psig to provide for a MAWP0 of 2200 psig following the 200 psig testing.

Connect a regulated high pressure clean gas source to a Source Panel input station.

Verify that the other two input stations are closed.

Open valves V10, V12, V20, V22, V30 and V32.

Raise the source pressure to 1100 psig and note that the Supply Panel regulator input pressure gages all read 1100 psig.

Shut off the source pressure and show that the input pressure gages hold 1100 psig for 5 minutes.

If there is a leak, leak hunt with an audio leak detector, repair the leak and retest.

Raise the source pressure to 2200 psig

Shut off the source pressure and show that the input pressure gages hold 2200 psig for 5 minutes.

If there is a leak, leak hunt with an audio leak detector, repair the leak and retest.

Raise the source pressure to 3300 psig.

Shut off the source pressure and show that the pressure gages hold >3300 psig for 30 minutes.

Repeat the leak hunt, repair, retest procedure as necessary.

When the 3900 psig test results are satisfactory vent the system by opening V31.

Close V10, V12, V20, V22, V30, V31 and V32.

3. Reclamation Panel High Pressure Test

There is need to check the integrity of the high pressure portion of the Reclamation Panel.

The cylinders have been tested to 3300 psig as required for an MAWP3 of 2200 psig.

The flex hoses which connect the four cylinders to the panel are rated at 3100 psig. The tubing, pressure transducers and pressure regulators are rated higher than the 3300 psig as is seen in Table 4. The burst discs will fail at MAWP3 within their tolerance band.

Verify that all valves and pressure regulators on the Reclamation Panel are closed.

Fill Reclaim 1 thru the MFC with enough Ar to give 1800 psig plus 0, minus 200 psig when liquefied and equilibrated to room temperature.

The fill sequence is to supply the gas from the Ar Supply connection on the Source Panel, thru the getters and MFC, thru V94, V89, V63, V53, V43, V41, V40 to Reclaim 1. Close V41 and show that the initial pressure is held within 30 psig over a 30 minute period.

If there is a leak, vent the cylinder at <140 psig thru the V42, V43, V53, V63, V89, V97, V93, V95 path, repair it and retest.

Transfer the gas thru the Reclaim 1 regulator at <140 psig and V42, V43, V51, V50 to Reclaim 2 and repeat the 1800 psig nominal pressure test as above, make up for any residue in Reclaim 1 using the initial fill sequence shown above except replace V43, V41, V40 with V51, V50.

Close V51 and show that the initial pressure is held within 30 psig over a 30 minute period.

If there is a leak, vent as above from Reclaim 2 and retest.

Transfer the gas thru the Reclaim 2 regulator at <140 psig and V52, V53, V61, V60 to Reclaim 3 and repeat the 1800 psig nominal pressure test as above, make up for any residue in Reclaim 2 using the initial fill sequence shown above.

Close V61 and show that the initial pressure is held within 30 psig over a 30 minute period.

If there is a leak, vent as above from Reclaim 3 and retest.

Transfer the gas thru the Reclaim 3 regulator at <140 psig and V62, V63, V71, V70 to Reclaim 4 and repeat the 1800 psig nominal pressure test as above, make up for any residue in Reclaim 3 using the initial fill sequence shown above except replace V63, V53, V43, V41, V40 with V71, V70.

Close V71 and show that the initial pressure is held within 30 psig over a 30 minute period.

If there is a leak, vent as above from Reclaim4 and retest.

If not, vent as above from Reclaim 4.

This concludes the testing._

Close all valves.

Leave the Ar bottle in place.

Remove the signs and barricades.

Labeling

Attach a standard LLNL pressure test label to the Gas Supply Valve Control Panel as follows,

ASSY Gamma Ray Imager

SAFETY NOTE MESN99-038-0A

MAWP Varies, see labels

FLUID Ar, Xe, CO2

TEMP varies, see labels

REMARKS Restricted use

TEST NO. (Supplied by tester)

BY

DATE

Attach standard LLNL pressure test labels to each of the four reclamation cylinders and to each of the four valve panels as follows,

ASSY Reclamation Cylinder No. 1, 2, 3, 4

SAFETY NOTE MESN99-038-0A

MAWP3 2200 psig

FLUID Ar, Xe, CO2

TEMP 77 K to 50 C

REMARKS	Restricted use
TEST NO.	(Supplied by tester)
BY	DATE

ASSY Gas Supply Panel Input, PN 10E0804-01

SAFETY NOTE MESN99-038-0A

MAWP0 2200 psig

FLUID Ar, Xe, CO2

TEMP 10 C to 50C

REMARKS	Restricted use
TEST NO.	(Supplied by tester)
BY	DATE

ASSY Gas Supply Panel Output, PN 10E0804-01

SAFETY NOTE MESN99-038-0A

MAWP1 150 psig

FLUID Ar, Xe, CO2

TEMP 10 C to 50C

REMARKS	Restricted use
TEST NO.	(Supplied by tester)
BY	DATE

ASSY Gas Reclamation Panel Input, PN 10E0804-02

SAFETY NOTE MESN99-038-0A

MAWP1 150 psig

FLUID Ar, Xe, CO2

TEMP 10 C to 50C

REMARKS	Restricted use
TEST NO.	(Supplied by tester)

BY

DATE

ASSY Gas Processing Panel, PN 10E0804-03

SAFETY NOTE MESN99-038-0A

MAWP1 150 psig

FLUID Ar, Xe, CO2

TEMP 10C to 50 C

REMARKS Restricted use

TEST NO. (Supplied by tester)

BY

DATE

ASSY Detector Chambers Fill Panel, PN 10E0804-04

SAFETY NOTE MESN99-038-0A

MAWP1 150 psig

FLUID Ar, Xe, CO2

TEMP -20C to 50 C

REMARKS Restricted use

TEST NO. (Supplied by tester)

BY

DATE

Associated Procedures


1. OSP 132S.31


References


1. Chapter 32 - Pressure, Supplements 32.03 - Pressure Vessel and System Design and 32.05 - Pressure Testing, LLNL Health & Safety Manual
2. S. Timoshenko, Strength of Materials, Part 2, D. Van Nostrand, 1941, 239
3. S. Timoshenko, Strength of Materials, Part 2, Krieger, 1976, 454
4. Aerospace Structural Metals Handbook, Volume 2, DOD/Battelle, 1995

5. B-132S Facility Safety Procedure (FSP-132S)
6. LLNL Environmental Compliance Manual
7. LLNL Training Program Manual
8. Design Safety Standards Manual, ME Department, LLNL

Fig. 1 System Layout

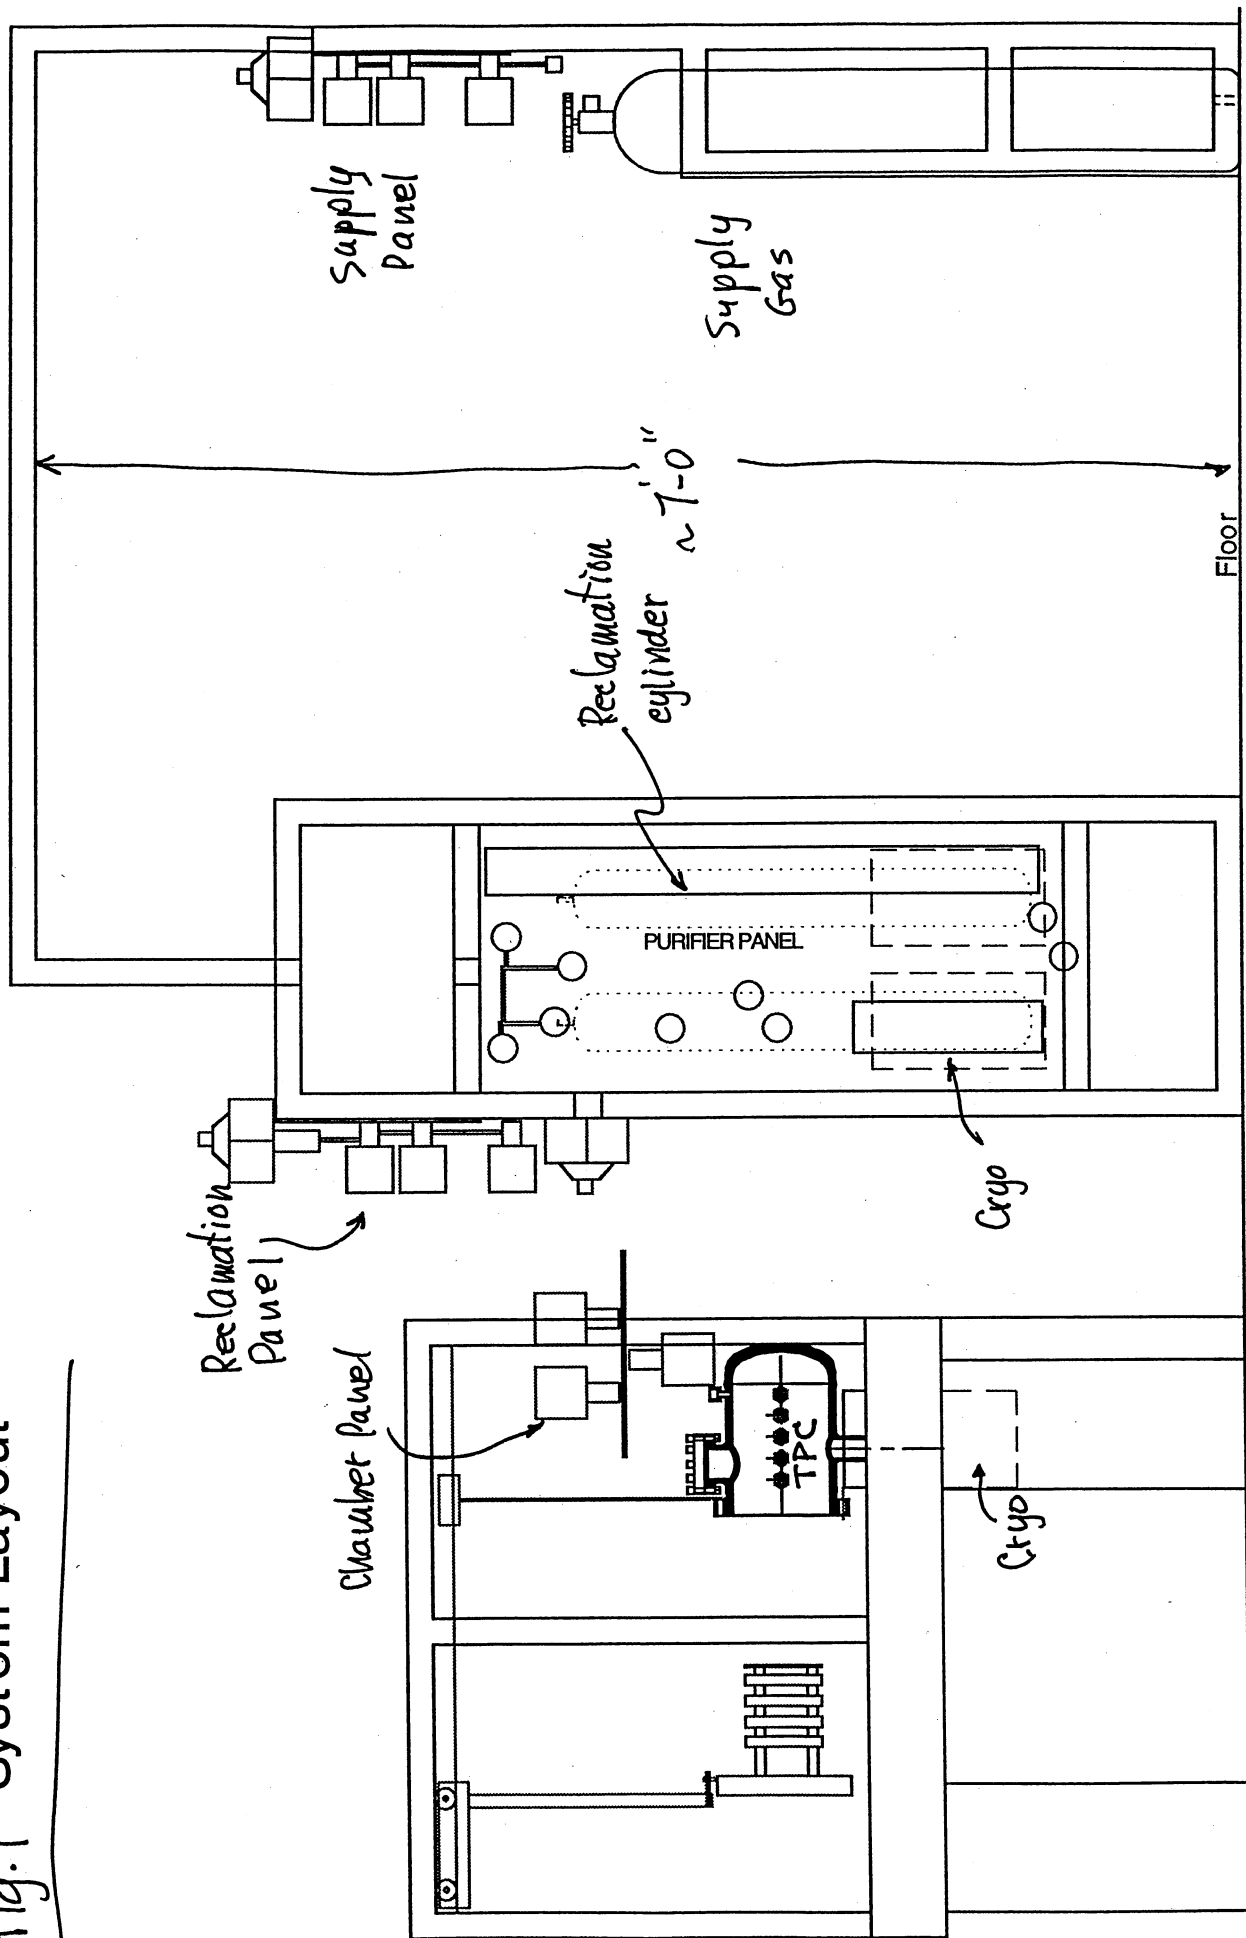

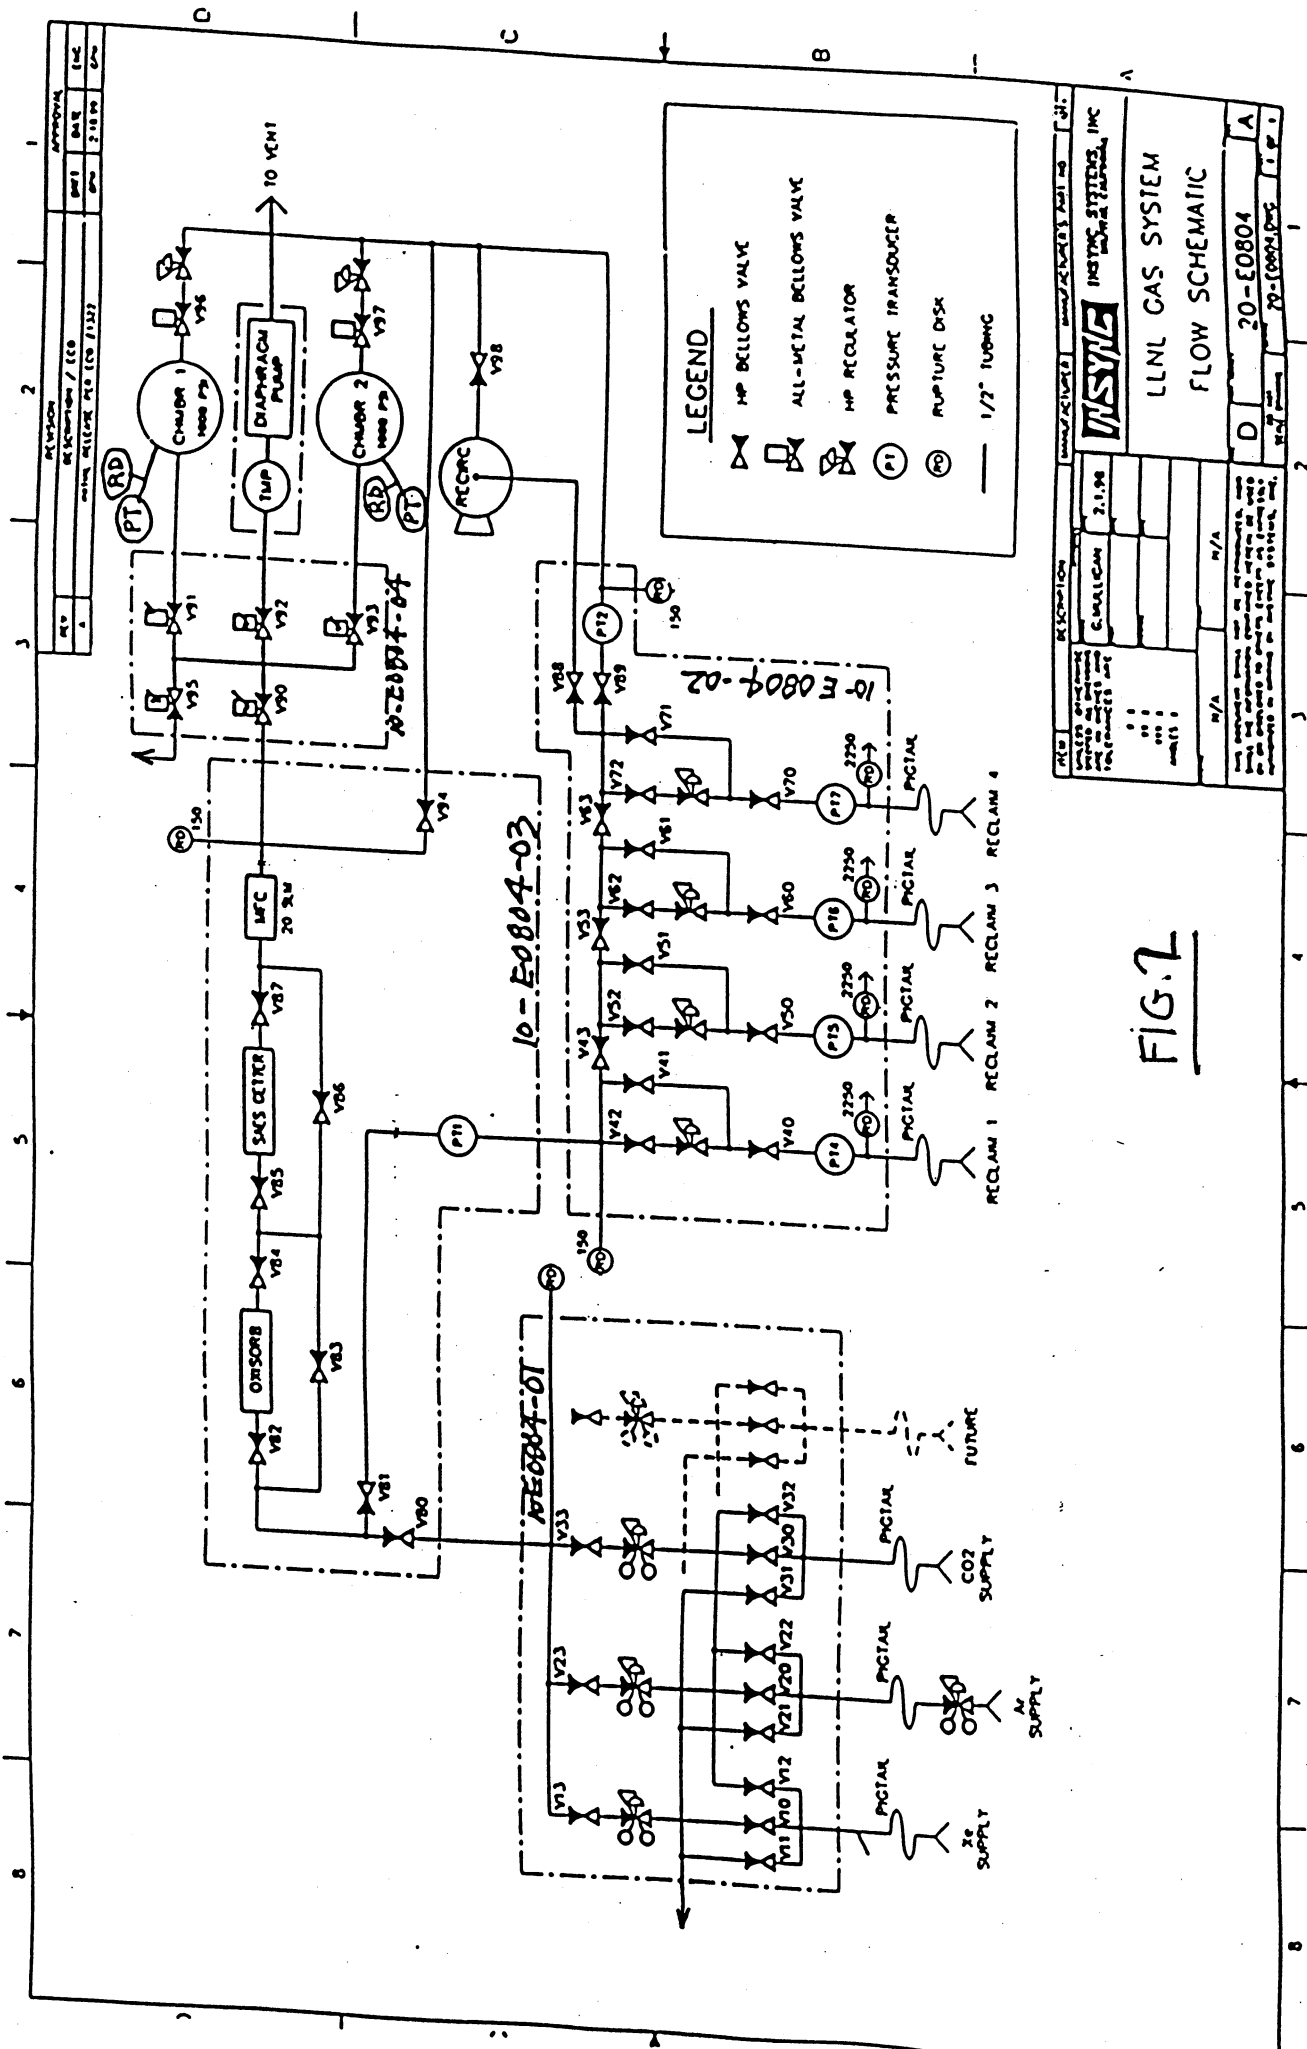


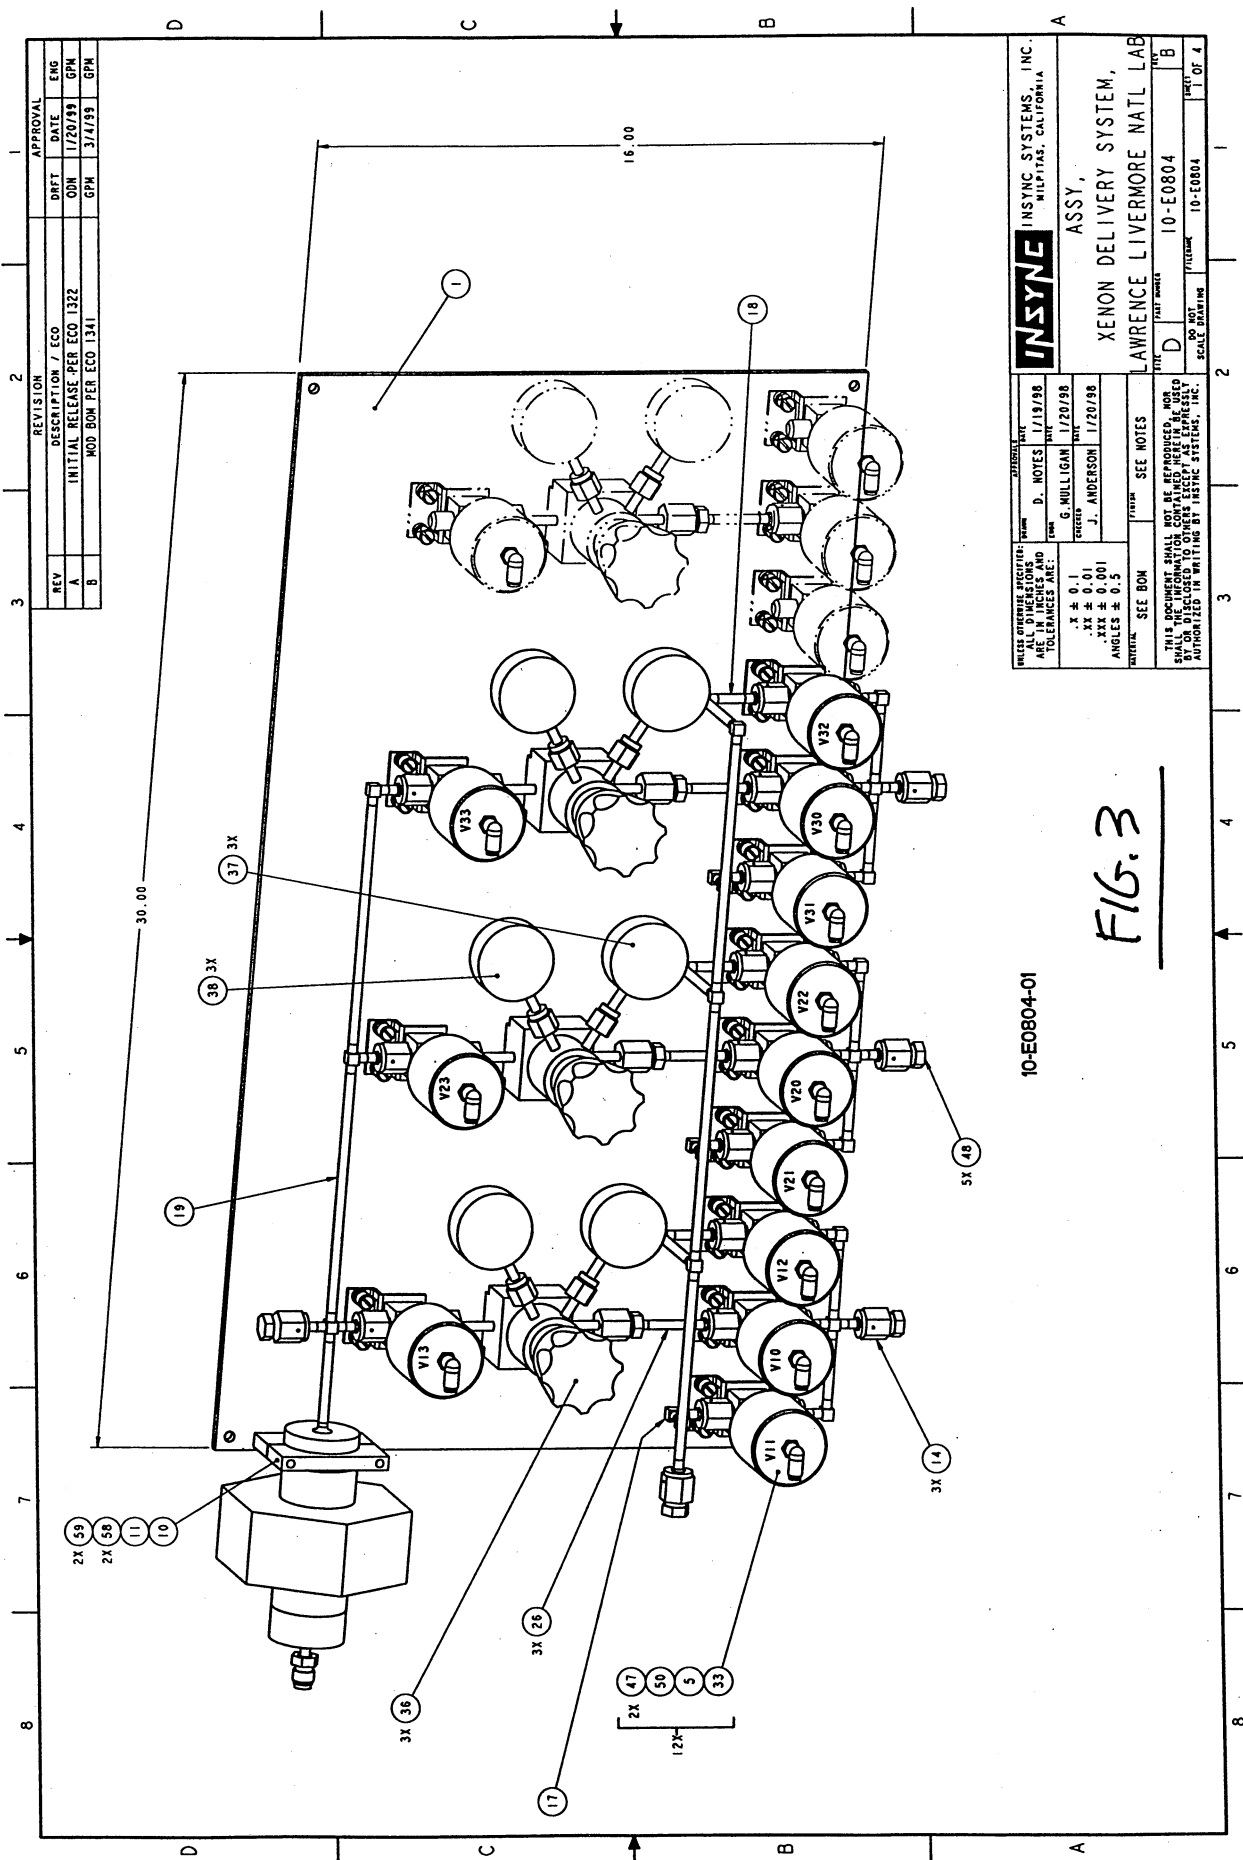

INSYNE INSYNE SYSTEMS, INC. MILPITAS, CALIFORNIA	
ASSY, XENON DELIVERY SYSTEM, LAWRENCE LIVERMORE NATL LAB	
FROM: D. NOYES 1/19/98 TO: G. MULLIGAN 1/20/98 EXECUTED: J. ANDERSON 1/20/98	TITLE: D PART NUMBER: 10-E0804 DO NOT SCALE DRAWING 1 OF 4
THIS DOCUMENT SHALL NOT BE REPRODUCED, FOR ANY PURPOSE, WITHOUT THE WRITTEN PERMISSION OF LAWRENCE LIVERMORE NATIONAL LABORATORY. THIS INFORMATION CONTAINED HEREIN IS UNCLASSIFIED EXCEPT WHERE SHOWN OTHERWISE.	

10-E0804-01

FIG. 3

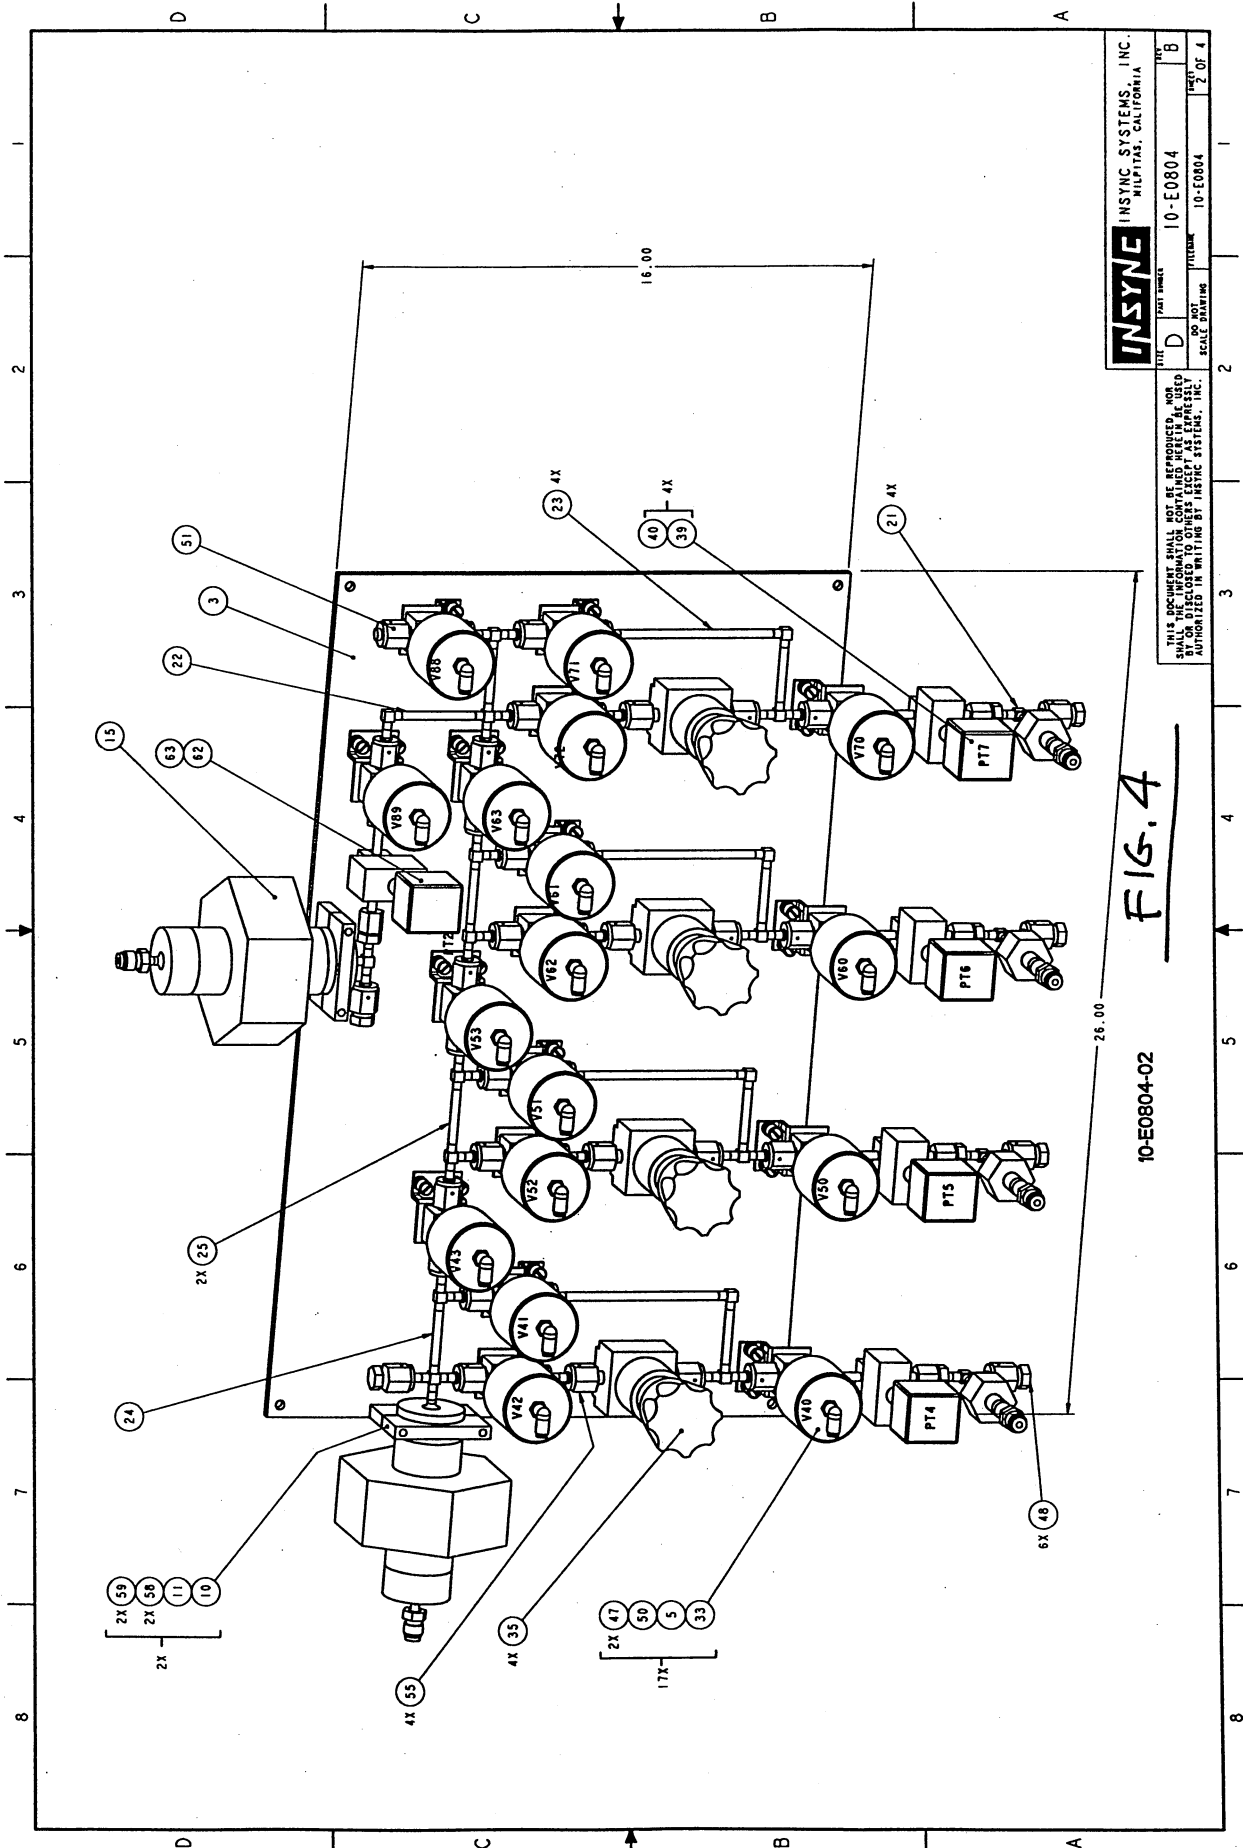

INSYNE INSYNCE SYSTEMS, INC.
MILPITAS, CALIFORNIA

TITLE	D	10-E0804	2 OF 4
DO NOT SCALE DRAWING			

THIS DOCUMENT IS NOT BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN PERMISSION OF INSYNCE SYSTEMS, INC. IT IS THE PROPERTY OF INSYNCE SYSTEMS, INC. AND IS LOANED TO YOU BY INSYNCE SYSTEMS, INC. IT IS TO BE RETURNED TO INSYNCE SYSTEMS, INC. UPON REQUEST. IT IS NOT TO BE DISCLOSED TO OTHERS EXCEPT AS EXPRESSLY AUTHORIZED IN WRITING BY INSYNCE SYSTEMS, INC.

FIG. 4

10-E0804-02

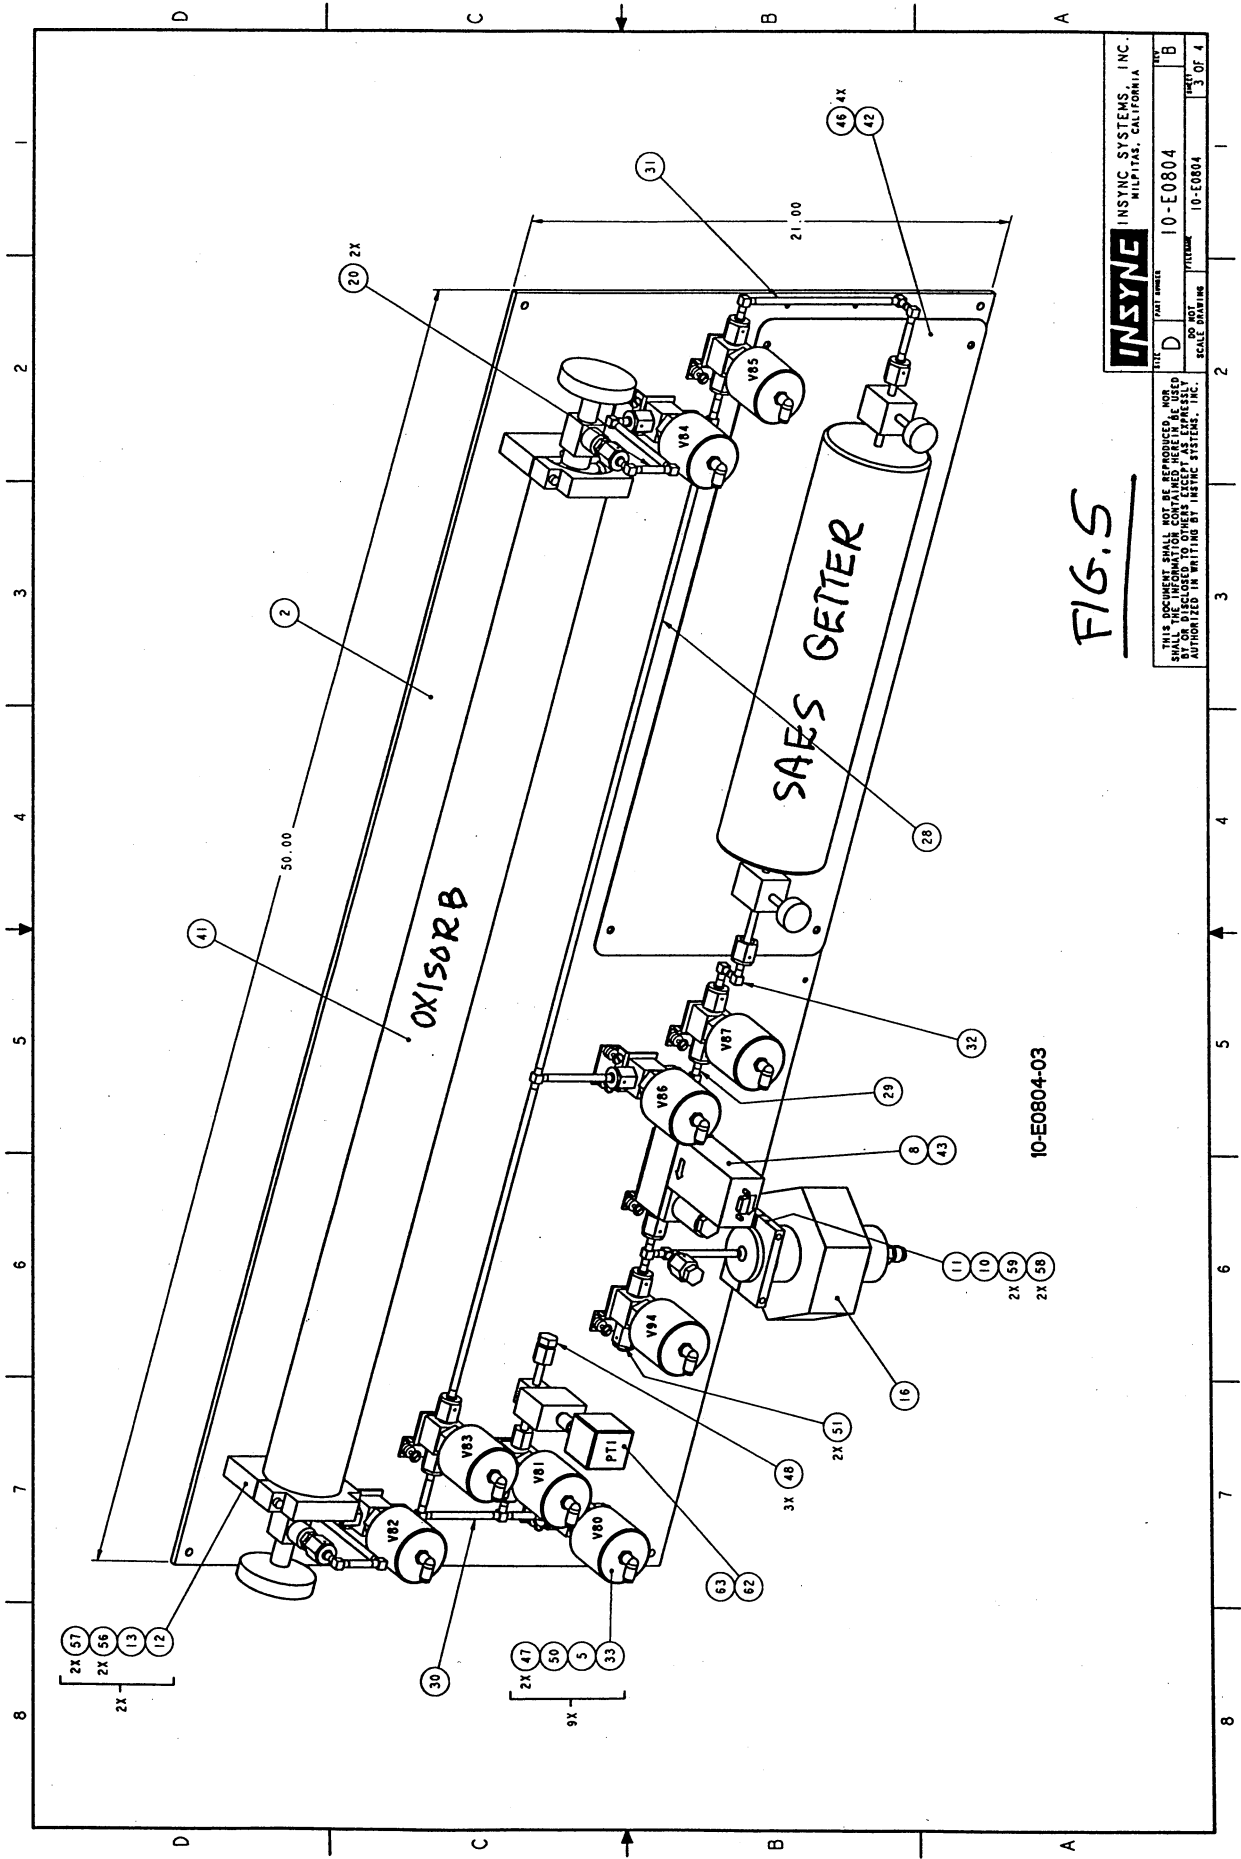
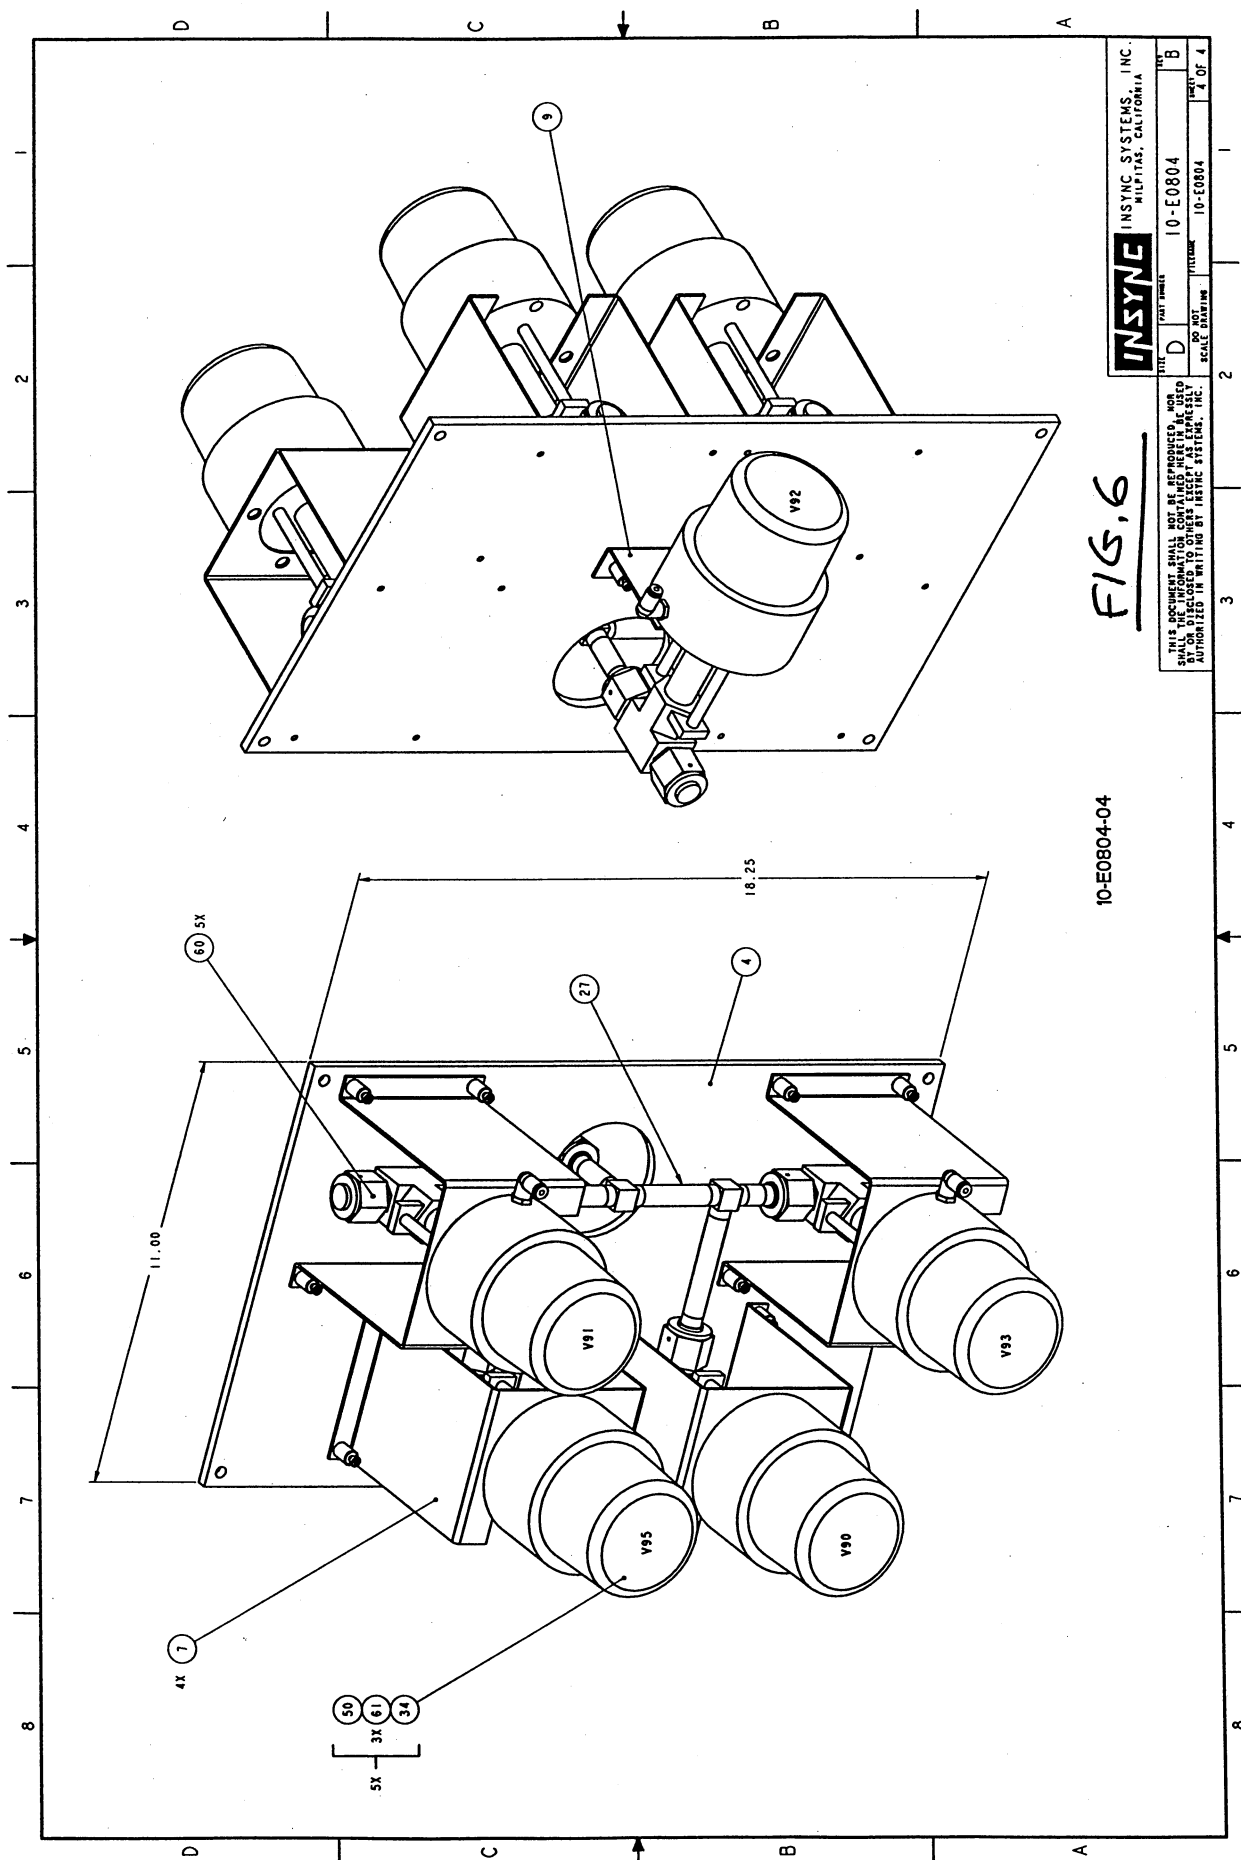


FIG. 5

INSYNE INSYNIC SYSTEMS, INC. MILPITAS, CALIFORNIA	
FILE	10-E0804
REV	B
DATE	10-E0804
SCALE	ROUTING
3 OF 4	

THIS DOCUMENT SHALL NOT BE REPRODUCED, NOR
ANY PART THEREOF, WITHOUT THE WRITTEN
PERMISSION OF INSYNIC SYSTEMS, INC.
AUTHORIZED IN WRITING BY INSYNIC SYSTEMS, INC.



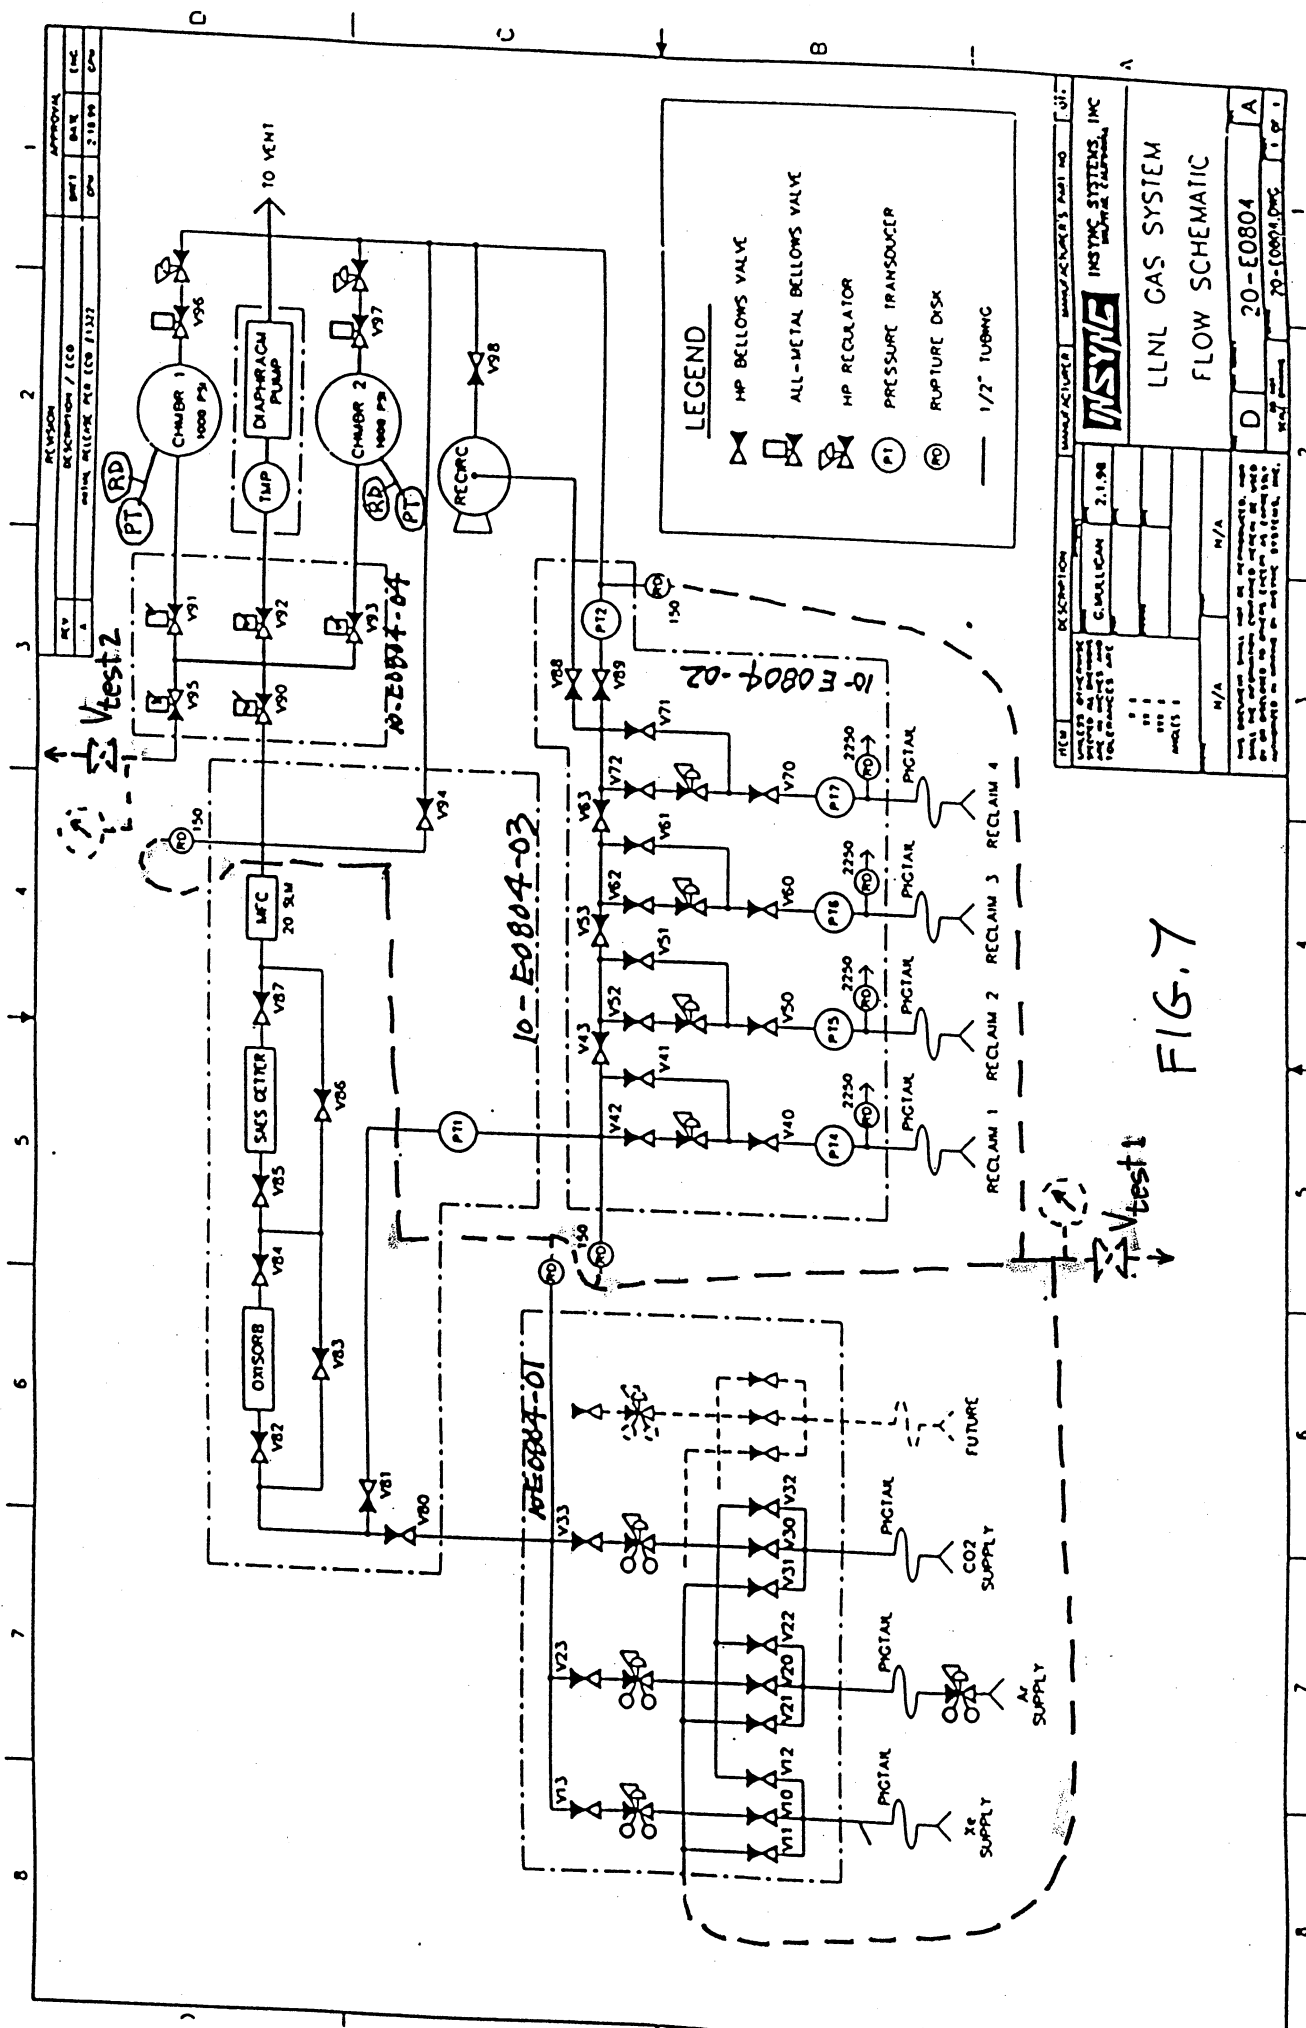


FIG. 7

ITEM	DESCRIPTION	MANUFACTURER	MANUFACTURER'S PART NO.	QTY.
1	CHARGER 1	INSYS	20-E0804	1
2	CHARGER 2	INSYS	20-E0804	1
3	DIAPHRAGM PUMP	INSYS	20-E0804	1
4	RECIRC	INSYS	20-E0804	1
5	PT	INSYS	20-E0804	1
6	RD	INSYS	20-E0804	1
7	V1	INSYS	20-E0804	1
8	V2	INSYS	20-E0804	1
9	V3	INSYS	20-E0804	1
10	V4	INSYS	20-E0804	1
11	V5	INSYS	20-E0804	1
12	V6	INSYS	20-E0804	1
13	V7	INSYS	20-E0804	1
14	V8	INSYS	20-E0804	1
15	V9	INSYS	20-E0804	1
16	V10	INSYS	20-E0804	1
17	V11	INSYS	20-E0804	1
18	V12	INSYS	20-E0804	1
19	V13	INSYS	20-E0804	1
20	V14	INSYS	20-E0804	1
21	V15	INSYS	20-E0804	1
22	V16	INSYS	20-E0804	1
23	V17	INSYS	20-E0804	1
24	V18	INSYS	20-E0804	1
25	V19	INSYS	20-E0804	1
26	V20	INSYS	20-E0804	1
27	V21	INSYS	20-E0804	1
28	V22	INSYS	20-E0804	1
29	V23	INSYS	20-E0804	1
30	V24	INSYS	20-E0804	1
31	V25	INSYS	20-E0804	1
32	V26	INSYS	20-E0804	1
33	V27	INSYS	20-E0804	1
34	V28	INSYS	20-E0804	1
35	V29	INSYS	20-E0804	1
36	V30	INSYS	20-E0804	1
37	V31	INSYS	20-E0804	1
38	V32	INSYS	20-E0804	1
39	V33	INSYS	20-E0804	1
40	V34	INSYS	20-E0804	1
41	V35	INSYS	20-E0804	1
42	V36	INSYS	20-E0804	1
43	V37	INSYS	20-E0804	1
44	V38	INSYS	20-E0804	1
45	V39	INSYS	20-E0804	1
46	V40	INSYS	20-E0804	1
47	V41	INSYS	20-E0804	1
48	V42	INSYS	20-E0804	1
49	V43	INSYS	20-E0804	1
50	V44	INSYS	20-E0804	1
51	V45	INSYS	20-E0804	1
52	V46	INSYS	20-E0804	1
53	V47	INSYS	20-E0804	1
54	V48	INSYS	20-E0804	1
55	V49	INSYS	20-E0804	1
56	V50	INSYS	20-E0804	1
57	V51	INSYS	20-E0804	1
58	V52	INSYS	20-E0804	1
59	V53	INSYS	20-E0804	1
60	V54	INSYS	20-E0804	1
61	V55	INSYS	20-E0804	1
62	V56	INSYS	20-E0804	1
63	V57	INSYS	20-E0804	1
64	V58	INSYS	20-E0804	1
65	V59	INSYS	20-E0804	1
66	V60	INSYS	20-E0804	1
67	V61	INSYS	20-E0804	1
68	V62	INSYS	20-E0804	1
69	V63	INSYS	20-E0804	1
70	V64	INSYS	20-E0804	1
71	V65	INSYS	20-E0804	1
72	V66	INSYS	20-E0804	1
73	V67	INSYS	20-E0804	1
74	V68	INSYS	20-E0804	1
75	V69	INSYS	20-E0804	1
76	V70	INSYS	20-E0804	1
77	V71	INSYS	20-E0804	1
78	V72	INSYS	20-E0804	1
79	V73	INSYS	20-E0804	1
80	V74	INSYS	20-E0804	1
81	V75	INSYS	20-E0804	1
82	V76	INSYS	20-E0804	1
83	V77	INSYS	20-E0804	1
84	V78	INSYS	20-E0804	1
85	V79	INSYS	20-E0804	1
86	V80	INSYS	20-E0804	1
87	V81	INSYS	20-E0804	1
88	V82	INSYS	20-E0804	1
89	V83	INSYS	20-E0804	1
90	V84	INSYS	20-E0804	1
91	V85	INSYS	20-E0804	1
92	V86	INSYS	20-E0804	1
93	V87	INSYS	20-E0804	1
94	V88	INSYS	20-E0804	1
95	V89	INSYS	20-E0804	1
96	V90	INSYS	20-E0804	1
97	V91	INSYS	20-E0804	1
98	V92	INSYS	20-E0804	1
99	V93	INSYS	20-E0804	1
100	V94	INSYS	20-E0804	1
101	V95	INSYS	20-E0804	1
102	V96	INSYS	20-E0804	1
103	V97	INSYS	20-E0804	1
104	V98	INSYS	20-E0804	1
105	V99	INSYS	20-E0804	1
106	V100	INSYS	20-E0804	1
107	V101	INSYS	20-E0804	1
108	V102	INSYS	20-E0804	1
109	V103	INSYS	20-E0804	1
110	V104	INSYS	20-E0804	1
111	V105	INSYS	20-E0804	1
112	V106	INSYS	20-E0804	1
113	V107	INSYS	20-E0804	1
114	V108	INSYS	20-E0804	1
115	V109	INSYS	20-E0804	1
116	V110	INSYS	20-E0804	1
117	V111	INSYS	20-E0804	1
118	V112	INSYS	20-E0804	1
119	V113	INSYS	20-E0804	1
120	V114	INSYS	20-E0804	1
121	V115	INSYS	20-E0804	1
122	V116	INSYS	20-E0804	1
123	V117	INSYS	20-E0804	1
124	V118	INSYS	20-E0804	1
125	V119	INSYS	20-E0804	1
126	V120	INSYS	20-E0804	1
127	V121	INSYS	20-E0804	1
128	V122	INSYS	20-E0804	1
129	V123	INSYS	20-E0804	1
130	V124	INSYS	20-E0804	1
131	V125	INSYS	20-E0804	1
132	V126	INSYS	20-E0804	1
133	V127	INSYS	20-E0804	1
134	V128	INSYS	20-E0804	1
135	V129	INSYS	20-E0804	1
136	V130	INSYS	20-E0804	1
137	V131	INSYS	20-E0804	1
138	V132	INSYS	20-E0804	1
139	V133	INSYS	20-E0804	1
140	V134	INSYS	20-E0804	1
141	V135	INSYS	20-E0804	1
142	V136	INSYS	20-E0804	1
143	V137	INSYS	20-E0804	1
144	V138	INSYS	20-E0804	1
145	V139	INSYS	20-E0804	1
146	V140	INSYS	20-E0804	1
147	V141	INSYS	20-E0804	1
148	V142	INSYS	20-E0804	1
149	V143	INSYS	20-E0804	1
150	V144	INSYS	20-E0804	1
151	V145	INSYS	20-E0804	1
152	V146	INSYS	20-E0804	1
153	V147	INSYS	20-E0804	1
154	V148	INSYS	20-E0804	1
155	V149	INSYS	20-E0804	1
156	V150	INSYS	20-E0804	1
157	V151	INSYS	20-E0804	1
158	V152	INSYS	20-E0804	1
159	V153	INSYS	20-E0804	1
160	V154	INSYS	20-E0804	1
161	V155	INSYS	20-E0804	1
162	V156	INSYS	20-E0804	1
163	V157	INSYS	20-E0804	1
164	V158	INSYS	20-E0804	1
165	V159	INSYS	20-E0804	1
166	V160	INSYS	20-E0804	1
167	V161	INSYS	20-E0804	1
168	V162	INSYS	20-E0804	1
169	V163	INSYS	20-E0804	1
170	V164	INSYS	20-E0804	1
171	V165	INSYS	20-E0804	1
172	V166	INSYS	20-E0804	1
173	V167	INSYS	20-E0804	1
174	V168	INSYS	20-E0804	1
175	V169	INSYS	20-E0804	1
176	V170	INSYS	20-E0804	1
177	V171	INSYS	20-E0804	1
178	V172	INSYS	20-E0804	1
179	V173	INSYS	20-E0804	1
180	V174	INSYS	20-E0804	1
181	V175	INSYS	20-E0804	1
182	V176	INSYS	20-E0804	1
183	V177	INSYS	20-E0804	1
184	V178	INSYS	20-E0804	1
185	V179	INSYS	20-E0804	1
186	V180	INSYS	20-E0804	1
187	V181	INSYS	20-E0804	1
188	V182	INSYS	20-E0804	1
189	V183	INSYS	20-E0804	1
190	V184	INSYS	20-E0804	1
191	V185	INSYS	20-E0804	1
192	V186	INSYS	20-E0804	1
193	V187	INSYS	20-E0804	1
194	V188	INSYS	20-E0804	1
195	V189	INSYS	20-E0804	1
196	V190	INSYS	20-E0804	1
197	V191	INSYS	20-E0804	1
198	V192	INSYS	20-E0804	1
199	V193	INSYS	20-E0804	1
200	V194	INSYS	20-E0804	1
201	V195	INSYS	20-E0804	1
202	V196	INSYS	20-E0804	1
203	V197	INSYS	20-E0804	1
204	V198	INSYS	20-E0804	1
205	V199	INSYS	20-E0804	1
206	V200	INSYS	20-E0804	1
207	V201	INSYS	20-E0804	1
208	V202	INSYS	20-E0804	1
209	V203	INSYS	20-E0804	1
210	V204	INSYS	20-E0804	1
211	V205	INSYS	20-E0804	1
212	V206	INSYS	20-E0804	1
213	V207	INSYS	20-E0804	1
214	V208	INSYS	20-E0804	1
215	V209	INSYS	20-E0804	1
216	V210	INSYS	20-E0804	1
217	V211	INSYS	20-E0804	1
218	V212	INSYS	20-E0804	1
219	V213	INSYS	20-E0804	1
220	V214	INSYS	20-E0804	1
221	V215	INSYS	20-E0804	1
222	V216	INSYS	20-E0804	1
223	V217	INSYS	20-E0804	1
224	V218	INSYS	20-E0804	1
225	V219	INSYS	20-E0804	1
226	V220	INSYS	20-E0804	1
227	V221	INSYS	20-E0804	1
228	V222	INSYS	20-E0804	1
229	V223	INSYS	20-E0804	1
230	V224	INSYS	20-E0804	1
231	V225	INSYS	20-E0804	1
232	V226	INSYS	20-E0804	1
233	V227	INSYS	20-E0804	1
234	V228	INSYS	20-E0804	1
235	V229	INSYS	20-E0804	1
236	V230	INSYS	20-E0804	1
237	V231	INSYS	20-E0804	1
238	V232	INSYS	20-E0804	1
239	V233	INSYS	20-E0804	1
240	V234	INSYS	20-E0804	1
241	V235	INSYS	20-E0804	1
242	V236	INSYS	20-E0804	1
243	V237	INSYS	20-E0804	1
244	V238	INSYS	20-E0804	1
245	V239	INSYS	20-E0804	1
246	V240	INSYS	20-E0804	1
247	V241	INSYS	20-E0804	1
248	V242	INSYS	20-E0804	1
249	V243	INSYS	20-E0804	1
250	V244	INSYS	20-E0804	1
251	V245	INSYS	20-E0804	1
252	V246	INSYS	20-E0804	1
253	V247	INSYS	20-E0804	1
254	V248	INSYS	20-E0804	1
255	V249	INSYS	20-E0804	1
256	V250	INSYS	20-E0804	1
257	V251	INSYS	20-E0804	1
258	V252	INSYS	20-E0804	1
259	V253	INSYS	20-E0804	1
260	V254	INSYS	20-E0804	1
261	V255	INSYS	20-E0804	1
262	V256	INSYS	20-E0804	1
263	V257	INSYS	20-E0804	1
264	V258	INSYS	20-E0804	1
265	V259	INSYS	20-E0804	1
266	V260	INSYS	20-E0804	1
267	V261	INSYS	20-E0804	1
268	V262	INSYS	20-E0804	1
269	V263	INSYS	20-E0804	1
270	V264	INSYS	20-E0804	1
271	V265	INSYS	20-E0804	1
272	V266	INSYS	20-E0804	1
273	V267	INSYS	20-E0804	1
274	V268	INSYS	20-E0804	1
275	V269	INSYS	20-E0804	1
276	V270	INSYS	20-E0804	1
277	V271	INSYS	20-E0804	1
278	V272	INSYS	20-E0804	1
279	V273	INSYS	20-E0804	1



APPENDIX A

FINAL INSPECTION AND TEST REPORT

ITEM NO. 225-819633 DESCRIPTION LIVERMORE LABS PRESSURE VESSEL
 SHOP ORDER NO. MOS8560 SERIAL NO. 15473, 15474, 15475, 15476

PRESSURE TEST

TYPE TEST: PNEUMATIC ☒ HYDROSTATIC ☐ CIRCUIT:

PROOF TESTED AT FULL TEST PRESSURE OF 3300 PSIG WITH N2

AND HELD FOR 10 MINUTES/ HOURS; PRESSURE THEN REDUCED TO PSIG
 FOR EXAMINATION FOR LEAKS.

SAFETY RELIEF VALVE SET AT N/A PSIG; PRESSURE SWITCH SET AT N/A

TEST PROCEDURE NO. TESTED BY DA-23 TEST DATE 3/8/99

FINAL INSPECTION

ALL PROCESS & INSTRUMENT LINES STRAIGHT, LEVEL & PLUMB


ALL REQUIRED COMPONENTS INSTALLED, IN PROPER LOCATION, AND
 FLOW DIRECTIONS IS CORRECT

ALL WELDS MEET QUALITY STDS. OF Q-113

ALL BRAZED JOINTS-EVIDENCE OF COMPLETE BOND AROUND ENTIRE JOINT
 (360°)


PAINTED SURFACES SMOOTH & UNIFORM, FULL COVERAGE, NO RUNS OR
 SAGS, TOUCHED-UP WHERE REQUIRED

ALL REQUIRED TAGS & NAMEPLATES IN PLACE & CORRECT PER DRAWING
 FUNCTIONAL TEST PERFORMED

INSP. STAMP

N/A

N/A

PREPARATION FOR SHIPMENTINSP. STAMP

ALL OPEN PORTS CLOSED/SEALED TO PREVENT CONTAMINATION

ALL TEMPORARY & FLO-PEN MARKINGS HAVE BEEN REMOVED

ALL GROSS STAINS & DISCOLORATION REMOVED FROM PIPING & FRAMES

EQUIPMENT CLEANED FOR SHIPMENT (WIPED DOWN)

SYSTEM PRESSURIZED TO PSIG FOR SHIPMENT (SHOW EXACT PRESSURE, TEMP.,
 DATE & TECHNICIAN'S INITIALS ON TAG ATTACHED TO EQUIPMENT). N/A

THIS EQUIPMENT MEETS ALL ABOVE REQUIREMENTS AND IS APPROVED FOR SHIPMENT

Scott L.
 QUALITY CONTROL TECHNICIAN

3/9/99
 DATE



TABLE 1A
SECTION I; SECTION III, CLASS 2 AND 3; AND SECTION VIII, DIVISION 1
MAXIMUM ALLOWABLE STRESS VALUES S FOR FERROUS MATERIALS
 (*See Maximum Temperature Limits for Restrictions on Class)

Table 1A Page 72-73		Table 1A Page 72		Table 1A Page 73	
Addenda		Maximum Allowable Stress, ksi (Multiply by 1000 to Obtain psi, for Metal Temperature, °F, Not Exceeding)			
Nominal Composition	16Cr - 12Ni - 2Mo	-20 to 100	16.7	950	...
Product Form	Smls. pipe	180	...	1000	...
Spec. No.	SA-312	200	14.1	1050	...
Type/ Grade	TP316L	250	...	1100	...
Alloy Desig./ UNS No.	S31603	300	12.7	1150	...
Class/ Cond./ Temper	...	400	11.7	1200	...
Size/ Thickness, in.	...	500	10.9	1250	...
P-No.	8	600	10.4	1300	...
Group No.	1	650	10.2	1350	...
Min. Tensile Strength, ksi	70	700	10.0	1400	...
Min. Yield Strength, ksi	25	750	9.8	1450	...
Applic. and Max. Temp. Limits (NP = Not Permitted) (SPT = Supports Only)		800	9.6	1500	...
I	NP	850	9.4	1550	...
III	NP	900	...	1600	...
VIII-1	B50			1650	...
External Pressure Chart No.	HA-4				
Notes	...				

General Notes

- (a) The following are the abbreviations used for Product Form: (a) Wld. - Welded; (b) Smls. - Seamless.
- (b) The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- (c) When used for Section III Class MC design, the stress values listed herein shall be multiplied by a factor of 1.1 (NE-3T12.4); these values shall be considered as design stress intensities or allowable stress values as required by NE-3200 or NE-3300, respectively.
- (d) For Section VIII applications, stress values in restricted shear such as dowel bolts or similar construction in which the shearing member is so restricted that the section under consideration would fail without reduction of area shall be 0.80 times the values in the above Table.
- (e) For Section VIII applications, stress values in bearing shall be 1.80 times the values in the above Table.
- (f) Stress values for -20 to 100°F are applicable for colder temperatures when toughness requirements of Section III or Section VIII are met.

Min Allowable
Tensile Stress

Allowable Stress used
in ASME BPV Code
Section VIII Div. 1
Calculations

$$\frac{70}{16.7} > 4 \text{ Safety Factor}$$

APPENDIX B

ACME Cryogenics, Inc.
Pressure Vessel Calculations for:

Lawrence Livermore Labs Pressure Vessel
S/O: M058560, qty (4) ea

Vessel Description:
4" dia. x 36 OAL vessel w/(1) nozzle

Design Code:
ASME Boiler & Pressure Vessel Code Sect. VIII, Div. 1
1998 Edition

Special Notes: Vessel designed w/ SF=4 as is standard with code.

Design Engineer: A. Halsey Date: 1/15/99

ENGINEER REVIEW: MAFIL, DE Date: 1/26/99

NOTE: ASME Sect 8, Div 1 uses Mat'l allowable
stresses = Min. tensile stress / 4 \therefore 4:1 S.F. is MET.

C:\COMPRESS\DATA\QUOTES\PATERSON.VSL May 12, 1999

TABLE OF CONTENTS

Pressure Summary	1
Thickness Summary	2
TOP HEAD	3
SHELL	4
BOTTOM HEAD	5
N1	6
Total Pages In This Report	7

C:\COMPRESS\DATA\QUOTES\PATERSON.VSL May 12, 1999

Pressure SummaryPressure summary for pressure chamber 1

Identifier	P design (psi)	T design (deg F)	MAWP (psi)	MAP (psi)	Pe external (psi)	UG-99 Ratio	UCS-66 MOMT (deg F)	Exemption or Stress Reduction	Corrosion Allowance (in)
TOP HEAD	3000.0	158.0	3869.3	4253.4	0.0	1.099			
SHELL	3000.0	158.0	3095.6	3402.9	0.0	1.099		Not applicable	0.000
BOTTOM HEAD	3000.0	158.0	3869.3	4253.4	0.0	1.099		Not applicable	0.000
N1	3000.0	158.0	3000.0	3000.0	0.0	1.000		Not applicable	0.000

Vessel MAWP hot & corroded is 3000 psi @ 158 degrees F.

Vessel MAP new & cold is 3000 psi @ 70 degrees F.

Vessel is not designed for external pressure.

Hydrotest pressure calculation based on MAWP

$$= 1.5 \times \text{MAWP} \times 1 = 4500 \text{ psi} \quad \text{or} \quad \text{PNEUMATIC} = 1.25 \times \text{MAWP} \times 1 = 3750 \text{ psi}$$

Vessel hydrotest pressure, horizontal position is 4500 psi.

Design notes:

Minimum thickness is 1/16 inch per UG-16(b).

Corrosion weight loss is 100% of theoretical loss.

UG-23 stress increase is 1.2.

Test liquid specific gravity is 1.

Minimum nozzle outside projection 1 inches.

Maximum stress allowed during field hydrotest is 90% of yield.

Butt weld thickness transitions made by removing material.

P-No 1 material >1.25 to 1.5 in. thick is preheated (UCS-56).

Interpretation VIII-1-83-66 has been applied.

C:\COMPRESS\DATA\QUOTES\PATERSON.VSL May 12, 1999

Thickness Summary

Component Identifier	Dia (in)	Length (in)	Nom t (in)	Req t (in)	Joint E	Load	Governing Status	Stress	Deflect (in)
Top head	4.50 od		0.5310*	0.4323	0.85	internal			
Shell	4.50 od	30.00	0.5825	0.4783	0.85	internal			
Bottom head	4.50 od		0.5310*	0.4323	0.85	internal			

Nom t - vessel wall thickness
 Req t - required vessel thickness due to governing loading + corrosion
 E - longitudinal seam joint efficiency
 * - head minimum thickness

Load:
 internal - circ stress due to internal pressure governs
 external - external pressure governs
 wind - combined long stress due to STATUS + wind governs
 seismic - combined long stress due to STATUS + seismic governs

C:\COMPRESS\DATA\QUOTES\PATERSON.VSL May 12, 1999

TOP HEADASME Section VIII Division 1, 1998 Edition

Component: 2:1 head
 Material specification: SA 182 F316L LOW <=5"
 Internal design pressure: P = 3000 psi @ 158 deg F
 Corrosion allowance: Inner C = 0 Outer = 0 in

PWHT is not performed

Radiography: Category A joints - Seamless NO X-Ray
 Head to shell seam - None UW-11(c) type 1

Estimated weight: new = 8.7 lb
 capacity: new = .1 corr = 8.7 US ga
 corr = .1

OD = 4.5 t = .531 (min) flange = 1.5 forming = 0 in (new)

Design thickness: (At 158 deg F) Appendix 1-4(c)

$$t = P \cdot D_o \cdot K / (2 \cdot S \cdot E + 2 \cdot P \cdot (K - 0.1)) + \text{Corrosion} + f_a$$

$$= 3000 \cdot 4.5 \cdot 1 / (2 \cdot 15192 \cdot 0.85 + 2 \cdot 3000 \cdot (1 - 0.1)) + 0 + 0$$

$$= 0.4323 \text{ in}$$

MAP: (New & at 70 deg F) Appendix 1-4(c)

$$P = 2 \cdot S \cdot E \cdot t / (K \cdot D_o - 2 \cdot t \cdot (K - 0.1)) - P_s$$

$$= 2 \cdot 16700 \cdot 0.85 \cdot 0.531 / (1 \cdot 4.5 - 2 \cdot 0.531 \cdot (1 - 0.1)) - 0$$

$$= 4253.454 \text{ psi}$$

MAWP: (Corroded & at 158 deg F) Appendix 1-4(c)

$$P = 2 \cdot S \cdot E \cdot t / (K \cdot D_o - 2 \cdot t \cdot (K - 0.1)) - P_s$$

$$= 2 \cdot 15192 \cdot 0.85 \cdot 0.531 / (1 \cdot 4.5 - 2 \cdot 0.531 \cdot (1 - 0.1)) - 0$$

$$= 3869.369 \text{ psi}$$

UG-32(l) Minimum Straight Flange Thickness

Design thickness: (At 158 deg F) Appendix 1-1(a)

$$t = P \cdot R_o / (S \cdot E + 0.4 \cdot P) + \text{Corrosion}$$

$$= 3869.369 \cdot 2.25 / (15192 \cdot 0.85 + 0.4 \cdot 3869.369) + 0$$

$$= 0.602 \text{ in}$$

C:\COMPRESS\DATA\QUOTES\PATERSON.VSL May 12, 1999

SHELLASME Section VIII Division 1, 1998 Edition

Component: Cylinder
 Material specification: SA 312 TP316L SMLS LOW (pipe)
 Internal design pressure: P = 3000 psi @ 158 deg F
 Corrosion allowance: Inner C = 0 Outer = 0 in

PWHT is not performed

Radiography: Category A joints - Seamless NO X-Ray
 Category B joints - None UW-11(c) type 1

Estimated weight: new = 60.5 corr = 60.5 lb
 capacity: new = 1.162 corr = 1.162 US ga

OD = 4.5 length Lc = 30 t = 0.5625 in (nominal, new)

Design thickness: (At 158 deg F) Appendix 1-1(a)

$$t = P \cdot R_o / (S \cdot E + 0.4 \cdot P) + \text{Corrosion}$$

$$= 3000 \cdot 2.25 / (15192 \cdot 0.85 + 0.4 \cdot 3000) + 0$$

$$= 0.4783 \text{ in}$$

MAP: (New & at 70 deg F) Appendix 1-1(a)

$$P = S \cdot E \cdot t / (R_o - 0.4 \cdot t) - P_s$$

$$= 16700 \cdot 0.85 \cdot 0.4921875 / (2.25 - 0.4 \cdot 0.4921875) - 0$$

$$= 3402.911 \text{ psi}$$

MAWP: (Corroded & at 158 deg F) Appendix 1-1(a)

$$P = S \cdot E \cdot t / (R_o - 0.4 \cdot t) - P_s$$

$$= 15192 \cdot 0.85 \cdot 0.4921875 / (2.25 - 0.4 \cdot 0.4921875) - 0$$

$$= 3095.63 \text{ psi}$$

BOTTOM HEADASME Section VIII Division 1, 1998 Edition

Component: 2:1 head
 Material specification: SA 182 F316L LOW <=5"
 Internal design pressure: P = 3000 psi @ 158 deg F
 Corrosion allowance: Inner C = 0 Outer= 0 in

PWHT is not performed

Radiography: Category A joints - Seamless NO X-Ray
 Head to shell seam - None UW-11(c) type 1

Estimated weight: new = 8.7 corr = 8.7 lb
 capacity: new = .1 corr = .1 US ga

OD = 4.5 t = .531 (min) flange= 1.5 forming= 0 in (new)

Design thickness: (At 158 deg F) Appendix 1-4(c)

$$t = P \cdot D_o \cdot K / (2 \cdot S \cdot E + 2 \cdot P \cdot (K - 0.1)) + \text{Corrosion} + f_a$$

$$= 3000 \cdot 4.5 \cdot 1 / (2 \cdot 15192 \cdot 0.85 + 2 \cdot 3000 \cdot (1 - 0.1)) + 0 + 0$$

$$= 0.4323 \text{ in}$$

MAP: (New & at 70 deg F) Appendix 1-4(c)

$$P = 2 \cdot S \cdot E \cdot t / (K \cdot D_o - 2 \cdot t \cdot (K - 0.1)) - P_s$$

$$= 2 \cdot 16700 \cdot 0.85 \cdot 0.531 / (1 \cdot 4.5 - 2 \cdot 0.531 \cdot (1 - 0.1)) - 0$$

$$= 4253.454 \text{ psi}$$

MAWP: (Corroded & at 158 deg F) Appendix 1-4(c)

$$P = 2 \cdot S \cdot E \cdot t / (K \cdot D_o - 2 \cdot t \cdot (K - 0.1)) - P_s$$

$$= 2 \cdot 15192 \cdot 0.85 \cdot 0.531 / (1 \cdot 4.5 - 2 \cdot 0.531 \cdot (1 - 0.1)) - 0$$

$$= 3869.369 \text{ psi}$$

UG-32(1) Minimum Straight Flange Thickness

Design thickness: (At 158 deg F) Appendix 1-1(a)

$$t = P \cdot R_o / (S \cdot E + 0.4 \cdot P) + \text{Corrosion}$$


$$= 3869.369 \cdot 2.25 / (15192 \cdot 0.85 + 0.4 \cdot 3869.369) + 0$$

$$= 0.602 \text{ in}$$

NI

Opening NI Reinforcement Calculations Per UG-37

Located on: TOP HEAD
Local vessel thickness: .531 in
Liquid static head included: 0 psi
Flange description: Not installed
Nozzle material specification: SA 479 316L HIGH
Nozzle orientation: 0 degrees
End of nozzle to datum line: -4.5 in
Nozzle calculated as hillside: no
Projection outside vessel Lpr: 1.884711 in

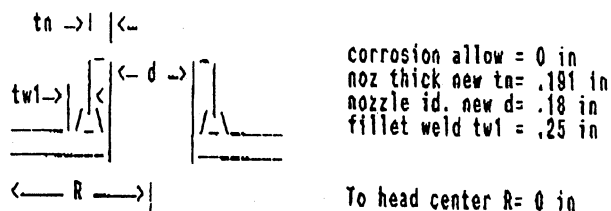

Reinforcement Calculations For Nozzle MAWP

Limits of reinforcement UG-40

Parallel to the vessel wall $(R_n + t_n + t) = .812$ in
Normal to the vessel wall outside $2.5*(t_n - C_n) + t_e = .4775$ in
Normal to the vessel wall inside $2.5*(t_n - C_n - C) = .4775$ in

Nozzle required thickness

$$\begin{aligned} t_{rn} &= P \cdot R_n / (S_n \cdot E - 0.6 \cdot P) \\ &= 3000 \cdot 0.09 / (16700 \cdot 1 - 0.6 \cdot 3000) \\ &= 0.0181 \text{ in} \end{aligned}$$

Required thickness tr from UG-37(a)(3)

$$\begin{aligned} t_r &= P \cdot K_1 \cdot D / (2 \cdot S \cdot E - 0.2 \cdot P) \\ &= 3000 \cdot 0.9 \cdot 3.438 / (2 \cdot 15192 \cdot 1 - 0.2 \cdot 3000) \\ &= 0.3117 \text{ in} \end{aligned}$$

Opening does not require reinforcement per UG-36(c)(3)(a)

Check the welds - From UW-16(c):

Fillet weld: $t_{min} = \text{lesser of } 0.75 \text{ or } t_n \text{ or } t, t_{min} = 0.191$ in
 $t_c(\text{min}) = \text{lesser of } 0.25 \text{ or } 0.7 \cdot t_{min}, t_c(\text{min}) = 0.1337$ in
 $t_c(\text{actual}) = 0.7 \cdot \text{Leg} = 0.7 \cdot 0.25 = 0.175$ in

The fillet weld size is satisfactory.

Weld strength calculations are not required for this detail which conforms to Fig. UW-16.1, sketch (a).

UG-45 Nozzle Neck Thickness Check

Wall thickness per UG-45(a): $tr_1 = 0.0181$ in ($E = 1$)
Wall thickness per UG-45(b)(1): $tr_2 = 0.3463$ in
Wall thickness per UG-16(b): $tr_3 = 0.0625$ in
Std pipe wall per UG-45(b)(4): $tr_4 = 0.079625$ in
The greater of tr_2 or tr_3 : $tr_5 = 0.3463$ in
The lesser of tr_4 or tr_5 : $tr_6 = 0.079625$ in

Req'd per UG-45 is the larger of tr_1 or $tr_6 = 0.079625$ in

N1

Available nozzle wall thickness new, $t_n = 0.191$ in

The nozzle neck thickness is adequate for MAWP.

Exempt from weld strength calculations per UW-15(b)(2)

VCR Fitting:

Nozzle Circ. Stress:

$$P = \frac{S \cdot E \cdot t}{R + .6 \cdot t}$$

$$P = \frac{(16700)(1)(.035)}{R + .6(.035)}$$

$$= 5266 \text{ psi} \quad > 3000 \text{ psi} \therefore \underline{\underline{\sigma_t}}$$

SA 479-316L


$S = 16700 \text{ psi @ } 158^\circ \text{F}$

$E = 1$

$t = .035$ "

$R = .19/2 = .09$

APPENDIX C

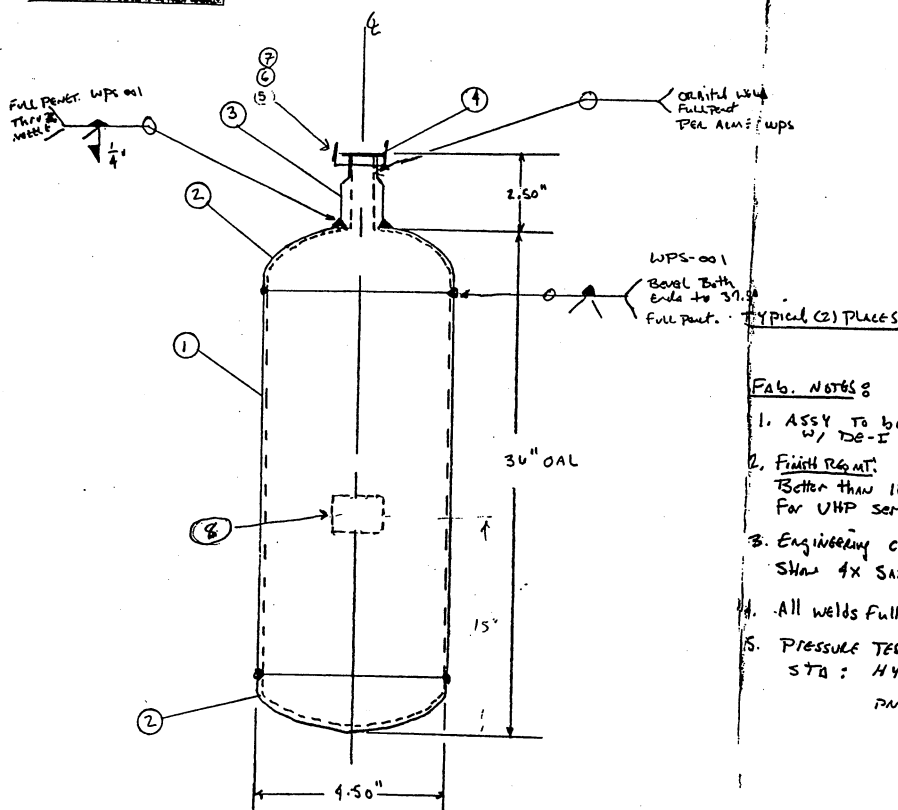

FAB. NOTES:

1. ASSY TO BE CLASS "A" O₂ CLEANED & RIGGED W/ DE-I WASH to ALME STA.
2. Finish Reqmt. Better than 10. Finish, inside only (electropolished) for UHP service.
3. Engineering calc must be provided to show 4x safety factor on design.
4. All welds full penetration
5. Pressure TEST ASSY PER ALME STA: HYD. to 1500 psig or pneu. to 3750 psig


ACME PART NO.	ITEM	QTY	UNITS	DESCRIPTION	DRW. NO.	MATERIAL
270-84343	1	A/R	ET	Pipe 4" 304 UN	SA192-31UL	
270-84344	2	EA	Flange 4" 304 UN	SA192-31UL		
270-84345	3	EA	Gasket 4" 304 UN	SA192-31UL		
809-416502	4	1	EA	Plug 1/2" 304 UN	SA192-31UL	
272-441552	5	1	EA	Plug 1/2" 304 UN	SA192-31UL	
809-416508	6	2	EA	Plug 1/2" 304 UN	SA192-31UL	
812-441512	7	1	EA	Plug 1/2" 304 UN	SA192-31UL	
812-441512	8	1	EA	Plug 1/2" 304 UN	SA192-31UL	

(Material Certs. Req'd)

NOTES	
1. OPERATING PRESSURE	PSIG 1500
2. OPERATING TEMPERATURE	°F -150
3. DESIGN PRESSURE, MAX	PSIG 1500
4. DESIGN TEMPERATURE, MAX	°F -150
5. DESIGN TEMPERATURE, MIN	°F -150
6. CONSTRUCTION STD. VOL. DIV. 1	ASME
7. CODE BOOK	ASME
8. CORROSION ALLOWANCE	0.00
9. X-RAY INSPECTION	100%
10. STRESS RELIEVING	ASME
11. EFFECTIVE LENGTHENING JOINTS	ASME
12. MAXIMUM ALLOWABLE PRESSURE	ASME
13. MAXIMUM ALLOWABLE WORKING PRESS.	ASME
14. HYDROSTATIC TEST PRESSURE	ASME
15. PNEUMATIC TEST PRESSURE	ASME
16. PAINT	ASME
17. PURCHASER'S SPECIFICATIONS	ASME
18. INSPECTIONS	ASME
19. PURCHASER'S COMPANY	ASME
20. TEST PROCEDURE	ASME
21. ALL WELDS AND HANGERS WELDS TO	ASME
22. STABLE MATERIAL VESSEL CONTAINING	ASME
23. ALL CONNECTIONS TO BE BLANKED	ASME
24. HYDROGEN BURNING/IGNITION	ASME
25. CHARTER TESTS	ASME
26. CAPACITY IN GALLONS	ASME

DESIGN APPROVALS: 1. DESIGNER 2. CHECKED 3. APPROVED 4. PURCHASER 5. WITNESS	DATE: 1/1/82 TIME: 10:00 BY: [Signature] FOR: [Signature]	CAUTION Cryogenic Vessel Pressure Vessel	ACME CRYOTRONICS
---	--	--	---------------------

ITEM #3

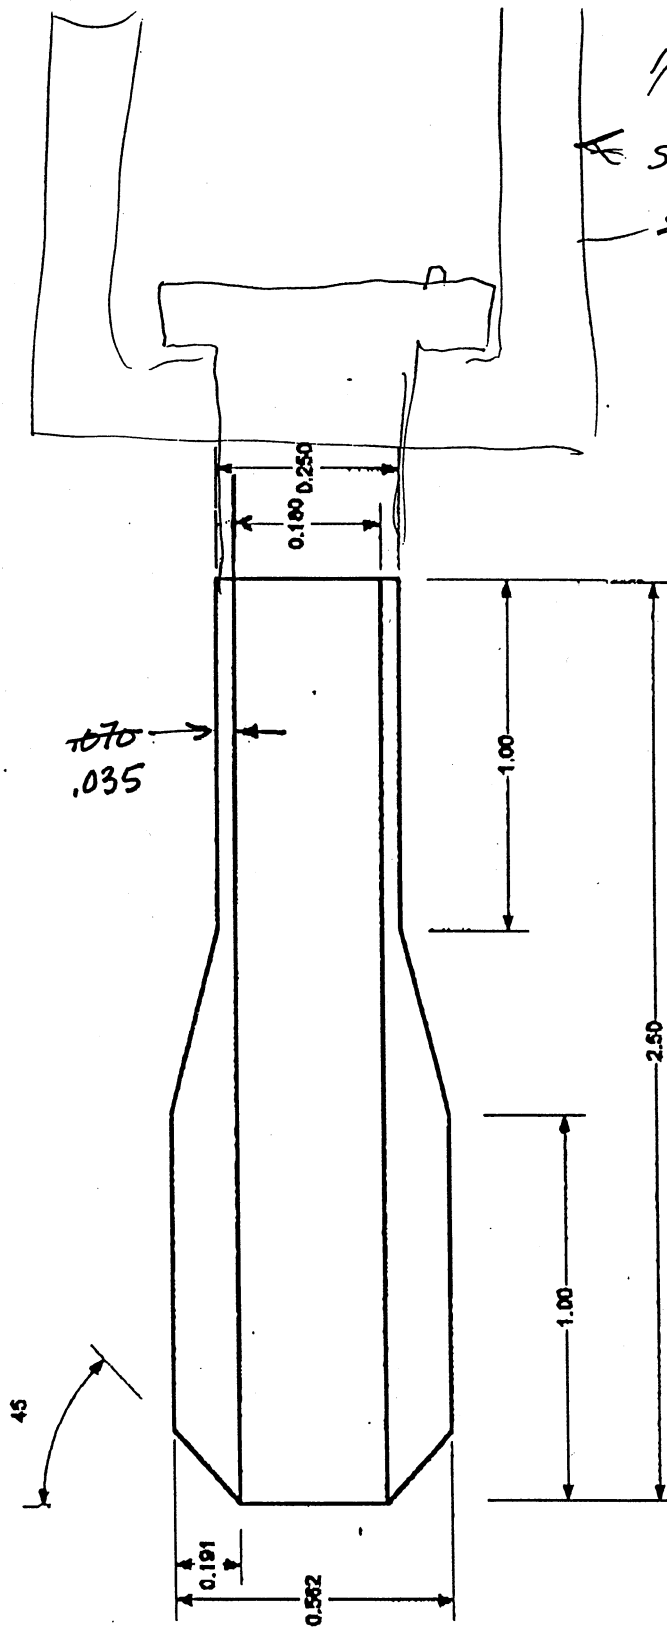

1/4" FEMALE
SS-2-VCR-1

~~SS-VCR~~

000-819705-A

INTERIOR FINISH 20RA MAX

MATERIAL: 316L STAINLESS STEEL

SCHEDULE NUMBER and/or WEIGHT*	WALL THICK- NESS Inches t	INSIDE DIAM- ETER Inches d	FIFTH POWER of ID In ⁵ d ⁵	AREAS and WEIGHTS						RADIUS of GYRA- TION Inches r _g	MOMENT of INERTIA in ⁴ I	SEC- TION MOD- ULUS in ³ Z	PRESSURE/STRESS MODULI† for			
				SURFACE AREA		Cross-Sectional		WEIGHT of					BOILER CODE POWER DISTR. HEAT'G. & REFR. PIPING c ₁	OIL PIPING (based on LAME FORM.) c ₂	GAS & AIR PIPING	
				OUT- SIDE sq ft per ft A _o	IN- SIDE sq ft per ft A _i	METAL AREA sq in. A	FLOW AREA sq in. A _f	PIPE lb per ft w	WATER lb per ft w _w						DIV. 1 c ₃	DIV. 2 c ₄
3" NOMINAL SIZE (cont'd) (OUTSIDE DIAMETER D=3.500)																
80 XS 80S 160 XX	.241	3.018	250	.916	.790	2.467	7.15	8.39	3.10	1.155	3.29	1.883	.0862	.0961	.0948	.0992
	.254	2.992	240	.916	.783	2.590	7.03	8.81	3.04	1.151	3.43	1.962	.0932	.1032	.1013	.1045
	.289	2.922	213	.916	.765	2.915	6.71	9.91	2.90	1.140	3.79	2.165	.1122	.1226	.1188	.1189
	.300	2.900	205	.916	.759	3.016	6.60	10.25	2.86	1.136	3.90	2.226	.1182	.1287	.1243	.1234
	.312	2.875	196	.916	.753	3.129	6.49	10.64	2.81	1.132	4.01	2.294	.1248	.1355	.1303	.1284
	.406	2.687	140	.916	.703	3.950	5.67	13.43	2.46	1.103	4.81	2.748	.1776	.1894	.1773	.1670
	.437	2.626	125	.916	.687	4.205	5.42	14.30	2.35	1.094	5.03	2.876	.1956	.2076	.1928	.1798
XX	.600	2.300	64	.916	.602	5.466	4.15	18.58	1.80	1.047	5.99	3.425	.2937	.3065	.2743	.2468
3½" NOMINAL SIZE (OUTSIDE DIAMETER D=4.000)																
10S 40 ST 40S 80 XS 80S XX	.120	3.760	752	1.047	.984	1.463	11.10	4.97	4.81	1.372	2.76	1.378	.0202	.0279	.0300	.0432
	.128	3.744	736	1.047	.980	1.557	11.01	5.29	4.77	1.370	2.92	1.461	.0237	.0315	.0335	.0461
	.134	3.732	724	1.047	.977	1.628	10.94	5.53	4.74	1.368	3.04	1.522	.0264	.0342	.0361	.0482
	.148	3.704	697	1.047	.970	1.791	10.78	6.09	4.67	1.363	3.33	1.664	.0327	.0405	.0422	.0533
	.188	3.624	625	1.047	.949	2.251	10.31	7.65	4.47	1.349	4.10	2.050	.0508	.0589	.0598	.0677
	.226	3.548	562	1.047	.929	2.680	9.89	9.11	4.28	1.337	4.79	2.394	.0682	.0766	.0764	.0814
	.281	3.438	480	1.047	.900	3.283	9.28	11.16	4.02	1.319	5.71	2.855	.0938	.1027	.1004	.1012
	.318	3.364	431	1.047	.881	3.678	8.89	12.51	3.85	1.307	6.28	3.141	.1114	.1206	.1166	.1145
	.344	3.312	399	1.047	.867	3.951	8.62	13.43	3.73	1.298	6.66	3.331	.1238	.1333	.1280	.1238
	.469	3.062	269	1.047	.802	5.203	7.36	17.69	3.19	1.259	8.25	4.127	.1855	.1961	.1827	.1688
XX	.636	2.728	151	1.047	.714	6.721	5.84	22.85	2.53	1.210	9.85	4.925	.2725	.2840	.2558	.2290
4" NOMINAL SIZE (OUTSIDE DIAMETER D=4.500)																
10S 40 ST 40S 80 XS 80S 120 160 XX	.120	4.260	1403	1.178	1.115	1.651	14.25	5.61	6.17	1.549	3.96	1.762	.0179	.0247	.0267	.0384
	.128	4.244	1377	1.178	1.111	1.758	14.15	5.98	6.13	1.546	4.21	1.869	.0211	.0279	.0298	.0410
	.134	4.232	1358	1.178	1.108	1.838	14.07	6.25	6.09	1.544	4.38	1.949	.0234	.0303	.0321	.0429
	.142	4.216	1332	1.178	1.104	1.944	13.96	6.61	6.04	1.542	4.62	2.054	.0266	.0335	.0352	.0454
	.165	4.170	1261	1.178	1.092	2.247	13.66	7.64	5.91	1.534	5.29	2.350	.0358	.0428	.0442	.0528
	.188	4.124	1193	1.178	1.080	2.55	13.36	8.66	5.78	1.526	5.93	2.64	.0450	.0522	.0531	.0602
	.205	4.090	1144	1.178	1.071	2.77	13.14	9.40	5.69	1.520	6.39	2.84	.0519	.0592	.0597	.0656
	.237	4.026	1058	1.178	1.054	3.17	12.73	10.79	5.51	1.510	7.23	3.22	.0649	.0724	.0722	.0758
	.250	4.000	1024	1.178	1.047	3.34	12.57	11.35	5.44	1.505	7.56	3.36	.0702	.0778	.0772	.0800
	.271	3.958	971	1.178	1.036	3.60	12.30	12.24	5.33	1.498	8.08	3.59	.0789	.0866	.0854	.0867
	.281	3.938	947	1.178	1.031	3.74	12.18	12.72	5.27	1.495	8.33	3.70	.0831	.0908	.0893	.0899
	.300	3.900	902	1.178	1.021	3.96	11.95	13.46	5.17	1.489	8.78	3.90	.0910	.0989	.0867	.0960
	.312	3.876	875	1.178	1.015	4.10	11.80	13.96	5.11	1.485	9.05	4.02	.0960	.1040	.1013	.0998
	.337	3.826	820	1.178	1.002	4.41	11.50	14.99	4.98	1.477	9.61	4.27	.1065	.1147	.1111	.1078
	.375	3.750	742	1.178	.982	4.86	11.04	16.52	4.78	1.464	10.42	4.63	.1227	.1312	.1258	.1200
	.437	3.626	627	1.178	.949	5.58	10.33	18.96	4.47	1.445	11.65	5.18	.1495	.1585	.1499	.1398
	.500	3.500	525	1.178	.916	6.28	9.62	21.36	4.17	1.425	12.77	5.67	.1773	.1868	.1744	.1600
.531	3.438	480	1.178	.900	6.62	9.28	22.51	4.02	1.416	13.27	5.90	.1912	.2009	.1865	.1699	
XX	.674	3.152	311	1.178	.825	8.10	7.80	27.54	3.38	1.374	15.29	6.79	.2573	.2676	.2421	.2157
5" NOMINAL SIZE (OUTSIDE DIAMETER D=5.563)																
40 ST 40S 80 XS 80S 120 160 XX	.134	5.295	4162	1.456	1.386	2.29	22.02	7.77	9.53	1.920	8.43	3.03	.0189	.0245	.0260	.0347
	.258	5.047	3275	1.456	1.321	4.30	20.01	14.62	8.66	1.878	15.17	5.45	.0592	.0652	.0650	.0688
	.352	4.859	2708	1.456	1.272	5.76	18.54	19.59	8.03	1.847	19.65	7.07	.0905	.0970	.0946	.0911
	.375	4.813	2583	1.456	1.260	6.11	18.19	20.78	7.88	1.839	20.68	7.43	.0983	.1050	.1018	.0971
	.437	4.688	2264	1.456	1.227	7.04	17.26	23.95	7.47	1.819	23.31	8.38	.1196	.1266	.1213	.1131
	.500	4.563	1978	1.456	1.194	7.95	16.35	27.04	7.06	1.799	25.74	9.25	.1415	.1489	.1411	.1294
	.625	4.313	1492	1.456	1.129	9.70	14.61	32.97	6.33	1.760	30.03	10.80	.1862	.1943	.1804	.1618
	.750	4.063	1107	1.456	1.064	11.40	12.97	38.77	5.61	1.722	33.64	12.10	.2323	.2410	.2202	.1941

CAPS

Schedule 160†



Part No. 84

Seamless Steel TUBE-TURN Welding Fittings

NOMINAL PIPE SIZE	OUTSIDE DIAMETER O.D.	INSIDE DIAMETER I.D.	WALL THICKNESS T	LENGTH E	TANGENT S	DISH RADIUS R±	KNUCKLE RADIUS r±	APPROXIMATE WEIGHT IN POUNDS	LIST PRICE
1	1.315	.815	.250	1½	1.05	.71	.14	.39	\$ 8.50
1¼	1.660	1.160	.250	1½	.96	1.00	.20	.54	8.50
1½	1.900	1.338	.281	1½	.88	1.17	.22	.68	8.50
2	2.375	1.689	.343	1¾	.98	1.47	.28	1.19	18.00
2½	2.875	2.125	.375	2	1.09	1.90	.35	1.96	24.20
3	3.500	2.626	.437	2½	1.41	2.29	.44	3.52	24.20
4	4.500	3.438	.531	3	1.61	3.02	.57	6.54	28.00
5	5.563	4.313	.625	3½	1.80	3.77	.72	11.0	39.70
6	6.625	5.189	.718	4	1.98	4.54	.86	17.5	50.00
8	8.625	6.813	.906 ⁽¹⁾	5	2.39	5.96	1.14	32.0	60.00
10	10.750	8.500	1.125 ⁽¹⁾	5½	2.25	7.43	1.42	54.1	105.00
12	12.750	10.126	1.312 ⁽¹⁾	6½	2.66	8.85	1.69	88.7	147.00

kinetics.

fluid systems
1463 centre pointe drive
milpitas, ca 95035

telephone 408.946.3100
facsimile 408.934.6301

Mr. Daniel Archer, Ph.D.
Nuclear Physicist
Lawrence Livermore National Laboratory
7000 East Avenue
Livermore, CA 94551

APPENDIX D

Dear Dan,

Per your request, this letter outlines the manufacturing techniques and industry standards Kinetics Fluid Systems (formerly Insync) used to fabricate the Xenon Delivery System specified and purchased by Lawrence Livermore National Laboratory.

Insync Job # U0898 (1/8/99)
Insync Item # 870LLL-0001-U0898
Description: 10-E0804 REV. X1, Xenon Delivery System
LLNL PO # B502632
Ship Date: 3/23/98

Overview:

The design rules, materials of construction, welding methods and assembly techniques used on the Xenon delivery system are consistent with the standards used in low pressure (<250psig) and high pressure (250-3000psig) ultra high purity gas delivery systems for the semiconductor manufacturing industry. These industry standards are extremely rigorous due to the susceptibility to microcontamination and the highly toxic, flammable and corrosive gases used in semiconductor manufacturing.

Below, please find the material specifications and industry standards used for this project. Note that the SEMI (Semiconductor Equipment and Materials International) standards each reference other standards including ASME, ASTM, FED-STD, IES, ISO, SEMI, etc. The texts of the specific documents are available from each of the respective organizations.

Panel design and construction:

The following standards were used as general design rules for the Xenon delivery system.

System Design:

SEMI E49.9 'Guide for ultra-high purity gas distribution systems in semiconductor manufacturing equipment'

Materials:

SEMI F20

Assembly/Test:

SEMI E49.6 'Guide for subsystem assembly and testing procedures-stainless steel systems'

Leak Testing:

SEMI F1 'Specification of for leak integrity of toxic gas piping systems'

Tubing:

All tubing used in this system is manufactured by Valex and conforms to the following standards:

Tubing specifications		
Component	Materials	Application Specifications
1/4" O.D. Tubing P/N T40-VS-.25-035A5	T316L Stainless Steel	ASTM A 269, ASTM A632 MSWP 4,142 psi, TBP 17,355psi
3/8" O.D. Tubing P/N T40-VS-.375-035A5	T316L Stainless Steel	ASTM A 269, ASTM A632 MSWP 2,776 psi, TBP 11,631psi
1/2" O.D. Tubing T40-VS-.5-049A5	T316L Stainless Steel	ASTM A 269, ASTM A632 MSWP 2,917 psi, TBP 12,222psi

MSWP=maximum safe working pressure TBP=theoretical burst pressure

Fittings, glands and gaskets:

The fittings, glands and gaskets used in this system are manufactured by Swagelok or Parker and conform to the following standards:

Fitting, gland and gasket standards		
Materials	Component	Application Specifications
316SS	Bodies, Nuts Gaskets, Forged Shapes	ASME SA479, ASTM A276 ASME A240, ASTM A167 ASME SA182, ASTM A314
316L VAR	TB Glands	ASME SA479, ASTM A276
200 Nickel	Gaskets	ASTM B162

Gasket seal integrity specifications			
Gasket	Leak rate, std cm³/s		
	Inboard	Outboard	
	At 10 ⁻⁵ torr	At 5000 psig	Extrapolated to vacuum
(Nickle) VS unplated	<4 x 10 ⁻¹¹	<5.5 x 10 ⁻¹⁰	<4 x 10 ⁻¹⁵

Please call if you have any additional questions or require further clarifications. Thank you again for the opportunity.

Sincerely,

Kinetics Fluid Systems
Ed Poe

INSYNC Systems, Inc.
1463 Centre Pointe Drive
Milpitas, CA 95035
408-946-3100
Fax 408-934-6301

APPENDIX E

SYSTEM LEAK CHECK AND CONFORMANCE CERTIFICATION

Ser. # 003707, 003708, 003709, 003710

System Number: 10-E0804 _____ Rev.: B Qty: 1 set _____

INSYNC System Job Number: U0898 _____

Description: Xenon Delivery System _____

Technician: Sid Cropper _____ Date: 3/22/1999 _____

We certify this panel was Helium leak checked and is certified with a Helium Mass Spectrometer with a leak rate sensitivity of less than 1×10^{-9} atm.cc He/sec. with the following:

(X) Alcatel 181 td

And passed with the following exceptions:

Four 2" rupture disc assemblies passed at; 1.0×10^{-8} atm, 2.4×10^{-8} atm,
 5.0×10^{-7} atm, 3.0×10^{-5} atm

Four 1/2" rupture disc assemblies passed at 1.0×10^{-8} atm

Signature: _____

Date: 3/25/99

INSYNC PARENT #: 10-E0804
DESCRIPTION: Xenon Delivery System
WELD COUNT: 74

REV: X1
REV DESC: Initial Release
ENG: GPM
DATE: 12/22/98

ITEM #	DESCRIPTION	QTY	MFR	MFR PART #	CUSTOMER/ D REV	Max psi
--------	-------------	-----	-----	------------	-----------------	---------

Weldments

14	Tube Assy, Supply, Inlet	3	Insync ✓	30-E1873, Rev A		
15	Tube Assy, Reclaim, Divert	1	Insync	30-E1874, Rev B		
16	Tube Assy, Main Outlet	1	Insync	30-E1875, Rev B		
17	Tube Assy, Supply, Divert Manifold	1	Insync	30-E1876, Rev A		
18	Tube Assy, Supply, Purge Manifold	1	Insync	30-E1877, Rev A		
19	Tube Assy, Supply Outlet	1	Insync	30-E1878, Rev B		
20	Tube Assy, Oxisorb Line	2	Insync	30-E1879, Rev A		
21	Tube Assy, Reclaim Outlet	4	Insync	30-E1880, Rev B		
22	Tube Assy, Reclaim Inlet, Rt	1	Insync	30-E1881, Rev A		
23	Tube Assy, Reclaim Diver Outlet	4	Insync	30-E1882, Rev A		
24	Tube Assy, Reclaim Inlet, Left	1	Insync	30-E1883, Rev B		
25	Tube Assy, Reclaim Divert Manifold	2	Insync	30-E1884, Rev A		
26	Tube Assy, Supply, Spool	3	Insync	30-E1887, Rev A		
27	Tube Assy, Chamber Manifold	1	Insync	30-E1888, Rev A		
28	Tube Assy, Main Divert Manifold	1	Insync	30-E1889, Rev A		
29	Tube Assy, Main, Getter Divert	1	Insync	30-E1890, Rev A		
30	Tube Assy, Main, Inlet Manifold	1	Insync	30-E1891, Rev A		
31	Tube Assy, Getter Inlet Line	1	Insync	30-E1895, Rev A		
32	Tube Assy, Getter Line	1	Insync	30-E1896, Rev A		
55	Tube Assy, Adapter, F/F	4	Insync			

Ed Poe
800-672-4363

10-113150-00 X1

Purchased Components

Clean Valves

33	Valve, High-Pressure Bellows, M/M	39	Nupro ✓	SS-HBVCR4-P-C		3500
34	Valve, All-Metal Bellows, 1/2", M/M	7	Nupro ✓	SS-8BG-VCR-3C		1000

Regulators

35	Regulator, Adjustable, M/M	6	Tescom ✓	64-2663KRA10		3500
----	----------------------------	---	----------	--------------	--	------

APPENDIX F


36 Regulator, Adjustable, 4 port F/F					
37 Gauge, Pressure	3 Tescom	64-2663KRH19			3500
38 Gauge, Pressure	3 Tescom	4802-3000M			n/a
Pressure Monitoring	3 Tescom	4802-0200M			n/a
39 Transducer, Pressure, FVCR, Bendix	4 Setra ✓	C2143000C-834-655			10000 burst
40 Display, Pressure, Bendix	4 Setra	3301C4CLC			n/a
62 Transducer, Pressure, FVCR, Bendix	2 Setra ✓	C214250C-834-655			5000 burst
63 Display, Pressure, Bendix	2 Setra	3301C7CLC			n/a
Getter Materials					
41 Oxisorb Getter	1 Oxisorb ✓	S511-HV			150
42 Saes Getter	1 Saes ✓	Monotorr Phase 1			150
Flow Controller					
43 MFC, 20 SLM Ar, D-sub	1 Brooks ✓	5964C4MAP35KA			1500
44 MFC, Controller	1 Brooks	0151AAD2A11A			n/a
Pneumatics and Misc					
45 Tubing, Poly, 1/8 x 1/16	34 Bay Pneum	1C-013-10			n/a
50 Fitting, male 1/8 npt, 1/8t elbow	46 SMC	KJL01-34S			n/a
46 Screw, 8-32 x 3/8, SS, Button Hd	4 Pro-Fastener				n/a
47 Screw, 10-32 x 3/8, SS, Button Hd	76 Pro-Fastener				n/a
52 Schematic, Gas Box	0 Insync	20-E0804			n/a
53 Toggle, Pneum Valve	46 Clippard	MTV-3P			n/a
54 Indicator, Pressure	46 Clippard	IND-3			n/a
VCR Components					
48 Plug, 1/4" VCR	14 Cajon	SS-4-VCR-P			
49 Gasket, 1/4" VCR, Unplated Nickel	183 Cajon	NI-4-VCR-2-GR-VS			
51 Cap, 1/4" VCR	3 Cajon	SS-4-VCR-CP			
60 Cap, 1/2" VCR	5 Cajon	SS-8-VCR-CP			
Rupture Disks					
Union Holder, 1/2 Tube Stub	7 InSync	6U 1/2 UNION HOLDER			
Rupture Disk, #306546	3 Zook				157
Rupture Disk, #306953	4 Zook				2230
Rupture Disk	BS&B				
Rupture Disk	BS&B				
Rupture Disk	BS&B				

n/a = pressure rating not needed




GENERAL INFORMATION

APPENDIX G

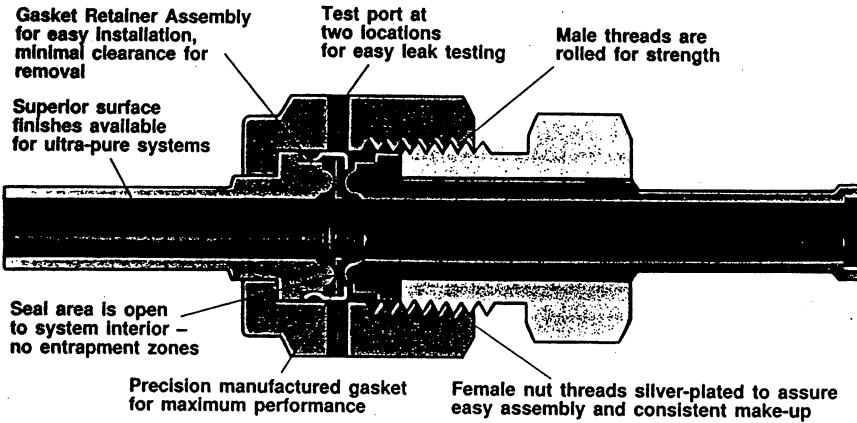

ANTI-TWIST DESIGN
For additional information, see page 10.

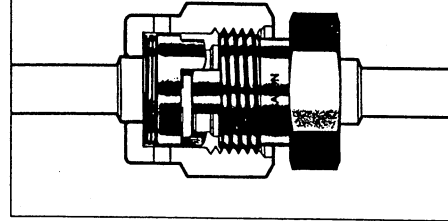

VCR® Components offer the high purity of a metal-to-metal seal, providing leak-free service from critical vacuum to positive pressure. The seal on a VCR® assembly is made when the gasket is compressed by two highly polished beads during the engagement of a male nut or body hex and a female nut.

MATERIALS (designators)

Bodies, Glands and Nuts:
316 stainless steel (SS)
316L stainless steel (316L)
316L VAR – Vacuum Arc Remelt stainless steel (6LV)

HIGH PURITY

A variety of VCR Face Seal Fittings are available with controlled surface finishes, electropolished and specially cleaned to meet Ultra-Pure system requirements. (For more information refer to SWAGELOK Specification SC-01.)


TESTING

The VCR® assembly with a standard gasket design has been helium leak tested to a rate of 4×10^{-9} std cm³/s and the VS gasket design to a rate of 5×10^{-11} std cm³/s without leakage.

DIMENSIONS

- Dimensions are in inches, for reference only, subject to change
- E dimension references the smallest nominal inside diameter of the part

CAUTION: Do not mix or interchange parts with those of other manufacturers

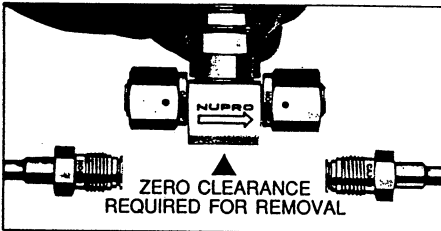

PRESSURE RATINGS

- Calculations based on allowable stress value of 20,000 psi for stainless steel at ambient temperature, per ANSI Code for Pressure Piping B31.3.
- To determine pressure ratings in accordance with ANSI B31.1, multiply psig rating by 0.94.



TEMPERATURE RATINGS

Components	Material	Temperature	
		°F	°C
Fittings	316 Stainless Steel	1000	538
	316L Stainless Steel	1000	538
	316LV Stainless Steel	1000	538
Gaskets	316 Stainless Steel	1000	538
	Nickel	600	316
	Copper	400	204
	Aluminum®	400	204

®Not suggested for vacuum service.


TYPICAL VCR® ASSEMBLY

VCR® Assemblies are made up of four or five basic components.

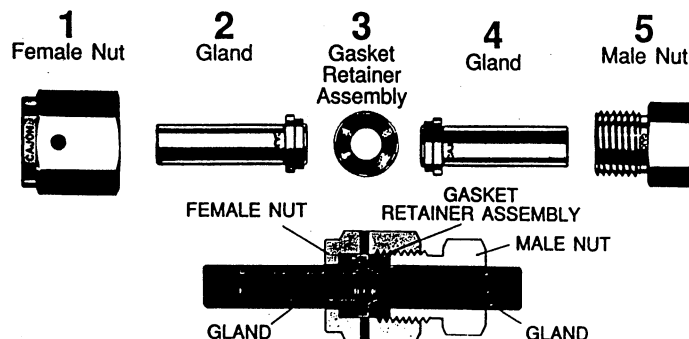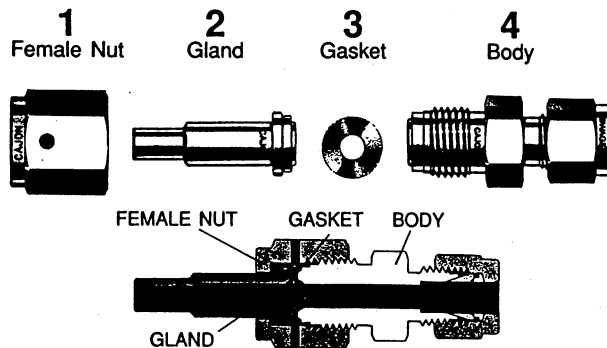


GLANDS

Short Tube Butt Weld




T Tube O.D.	ORDERING NUMBER	C	E	H	Nominal Wall Thickness	Working Pressure	
						psig	bar
1/8	316L-2-VCR-3S-2TB7	.75	.06 [Ⓢ]	1.08	.028	8500	585
1/4	6LV-4-VCR-3S-4TB2 [Ⓢ]	.25	.18	.60	.035	5100	351
1/4	316L-4-VCR-3S-4TB3	.38	.18	.72	.035	5100	351
1/4	6LV-4-VCR-3S-4TB7 [Ⓢ]	.75	.18	1.10	.035	5100	351
1/4	6LV-8-VCR-3S-4TB7	.75	.18	1.12	.035	5100	351
3/8	6LV-8-VCR-3S-6TB2	.25	.31	.62	.035	3300	227
3/8	6LV-8-VCR-3S-6TB7 [Ⓢ]	.75	.31	1.12	.035	3300	227
1/2	6LV-8-VCR-3S-8TB2	.25	.40	.62	.049	3500	241
1/2	316L-8-VCR-3S-8TB3	.38	.40	.74	.049	3500	241
1/2	6LV-8-VCR-3S-8TB7 [Ⓢ]	.75	.40	1.12	.049	3500	241

Long Tube Butt Weld

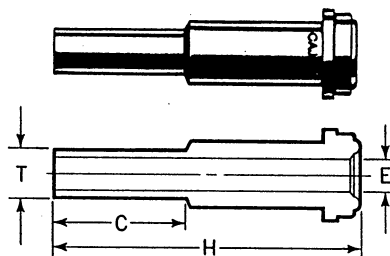


T Tube O.D.	ORDERING NUMBER	C	E	H	Nominal Wall Thickness	Working Pressure	
						psig	bar
1/8	316L-2-VCR-3-2TB7	.75	.06 [Ⓢ]	1.42	.028	8500	585
1/4	6LV-4-VCR-3-4TB2	.25	.18	1.20	.035	5100	351
1/4	316L-4-VCR-3-02205	.36	.18	1.31	.035	5100	351
1/4	6LV-4-VCR-3-4TB3	.38	.18	1.32	.035	5100	351
1/4	6LV-4-VCR-3-4TB7 [Ⓢ]	.75	.18	1.70	.035	5100	351
1/4	6LV-8-VCR-3-4TB7	.75	.18	1.80	.035	5100	351
3/8	6LV-8-VCR-3-6TB2	.25	.31	1.29	.035	3300	227
3/8	6LV-8-VCR-3-6TB7	.75	.31	1.79	.035	3300	227
1/2	316L-8-VCR-3-8TB2	.25	.40	1.29	.049	3500	241
1/2	316L-8-VCR-3-8TB3	.38	.40	1.41	.049	3500	241
1/2	6LV-8-VCR-3-8TB7	.75	.40	1.79	.049	3500	241
3/4	316L-12-VCR-3-12TB7	.75	.65	2.03	.049	2400	165
1	316L-16-VCR-3-16TB7	.75	.87	2.32	.065	2400	165

Short Automatic Tube Weld

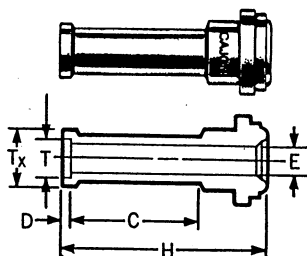


T Tube Size	ORDERING NUMBER	C	D	E	H	Tx	Nominal Wall Thickness	Working Pressure	
								psig	bar
1/4	316L-4-VCR-3AS	.75	.02	.18	1.12	.29	.035	5100	351
1/2	316L-8-VCR-3AS	.75	.04	.40	1.16	.55	.049	3500	241
3/8	316L-8-VCR-3AS6	.75	.03	.31	1.15	.41	.035	3300	227

Long Automatic Tube Weld

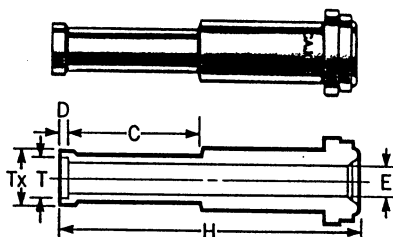

T Tube Size	ORDERING NUMBER	C	D	E	H	Tx	Nominal Wall Thickness	Working Pressure	
								psig	bar
1/4	316L-4-VCR-3A	.75	.02	.18	1.72	.29	.035	5100	351
1/4	316L-8-VCR-3A4	.75	.02	.18	1.82	.29	.035	5100	351
3/8	316L-8-VCR-3A6	.75	.03	.31	1.82	.41	.035	3300	227
1/2	316L-8-VCR-3A	.75	.04	.40	1.83	.55	.049	3500	241
3/4	316L-12-VCR-3A	.75	.04	.65	2.07	.80	.049	2400	165
1	316L-16-VCR-3A	.96	.04	.87	2.57	1.06	.065	2400	165

Short Socket Weld



T Tube Socket	ORDERING NUMBER	D	E	H	Tx	Working Pressure	
						psig	bar
1/4	SS-4-VCR-3-.50LG	.28	.18	.50	.35	5200	358
1/4	SS-4-VCR-3-.75LG	.28	.18	.75	.35	5500	378

[Ⓢ]Also available in Alloy C-22 (HC22) material.

[Ⓢ]VCR Face Seal end of the gland may be back-drilled to a larger I.D.

Features

Compact design


- accommodates tubing systems requiring miniaturization.
- allows close component spacing.
- provides flow and service ratings equal to larger weld fittings designed for the same size tubing.

Rounded body block prevents injury or damage to other components during system fabrication or maintenance.


Material heat code is roll stamped during first manufacturing operation to ensure raw material traceability.

Standard Surface finish is a maximum 11 μin . R_a

Square, sharp, burr-free tube weld ends enhance alignment, maintain tube wall uniformity, and promote weld repeatability.



Laser etch marking identifies manufacturer, material, and when applicable, the appropriate process designator according to Swagelok Specification SC-01.



Radius junction allows for a smooth flow transition and is designed to eliminate pockets and entrapment zones.

Material

- 316L VAR (vacuum arc remelt) or 316L stainless steel
- some configurations are available in Alloy C-22

Ultra-High-Purity

A variety of Micro-Fit weld fittings are available with controlled surface finishes, electropolished and specially cleaned to meet Ultra-High-Purity system requirements. For more information refer to Swagelok Specification SC-01.

Ordering Information

To order fittings manufactured according to Swagelok Specification SC-01 use the following Designator codes as a suffix to the Ordering Number.

Example: 6LV-4MW-9P

Designator	Surface Finish (R_a)	
	Average	Maximum
P	5 μin (0.13 μm)	10 μin (0.25 μm)
PX	4 μin (0.10 μm)	7 μin (0.18 μm)


Technical Data

Size	Pressure Rating ^①		Nominal Wall Thickness
	psig	bar	
1/8 in.	8500	580	0.028 in.
1/4 in.	5100	350	0.035 in.
3/8 in.	3300	220	0.035 in.
1/2 in.	3500	240	0.049 in.
6 mm	6600	460	1 mm


^① Pressure ratings are calculated in accordance with ANSI B31.3, based on equivalent wall ASTM A269 tubing and an allowable stress value of 20 000 psi.

Dimensions/Ordering Information

Reducing Union

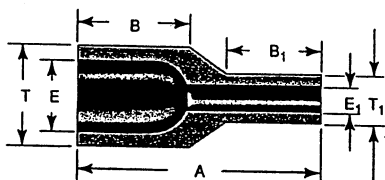


T Tube OD	T1 Tube OD	Ordering Number	Inches (mm)				
			A	B	B1	E	E1
1/4	1/8	6LV-4MW-6-2	0.75 (19.1)	0.41 (10.4)	0.25 (6.4)	0.18 (4.6)	0.06 (1.5)
3/8	1/4	6LV-6MW-6-4	0.75 (19.1)	0.41 (10.4)	0.25 (6.4)	0.31 (7.9)	0.18 (4.6)
1/2	1/4	6LV-8MW-6-4 ^②	0.75 (19.1)	0.41 (10.4)	0.25 (6.4)	0.40 (10.2)	0.18 (4.6)
1/2	3/8	6LV-8MW-6-6 ^②	0.75 (19.1)	0.41 (10.4)	0.25 (6.4)	0.40 (10.2)	0.31 (7.9)




90° Union Elbow

T Tube OD	Ordering Number	Inches (mm)				
		A	B	E	F Body Cube	L
1/8	6LV-2MW-9	0.56 (14.2)	0.25 (6.4)	0.06 (1.5)	5/16	0.41 (10.4)
1/4	6LV-4MW-9 ^②	0.56 (14.2)	0.25 (6.4)	0.18 (4.6)	5/16	0.41 (10.4)
3/8	6LV-6MW-9 ^②	0.69 (17.5)	0.25 (6.4)	0.31 (7.9)	7/16	0.47 (11.9)
1/2	6LV-8MW-9	0.81 (20.6)	0.25 (6.4)	0.40 (10.2)	9/16	0.53 (13.5)
6 mm	6LV-6MMW-9	0.56 (14.2)	0.25 (6.4)	0.16 (4.0)	5/16	0.41 (10.4)

Reducing Elbow

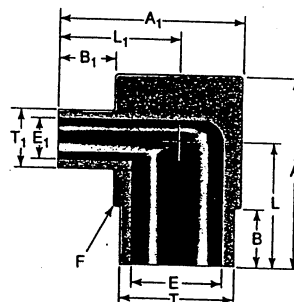

T Tube OD	T1 Tube OD	Ordering Number	Inches (mm)							
			A	A1	B	B1	E	E1	F Body Cube	L L1
3/8	1/4	6LV-6MW-9-4	0.69 (17.5)	0.69 (17.5)	0.25 (6.4)	0.25 (6.4)	0.31 (7.9)	0.18 (4.6)	7/16	0.47 (11.9) 0.47 (11.9)
1/2	1/4	6LV-8MW-9-4	0.81 (20.6)	0.81 (20.6)	0.25 (6.4)	0.25 (6.4)	0.40 (10.2)	0.18 (4.6)	9/16	0.53 (13.5) 0.53 (13.5)
1/2	3/8	6LV-8MW-9-6	0.81 (20.6)	0.81 (20.6)	0.25 (6.4)	0.25 (6.4)	0.40 (10.2)	0.31 (7.9)	9/16	0.53 (13.5) 0.53 (13.5)





Extended Leg 90° Union Elbow

T Tube OD	Ordering Number	Inches (mm)							
		A	A1	B	B1	E	F Body Cube	L	L1
1/4	6LV-4MW-9-03442	0.56 (14.2)	0.76 (19.3)	0.25 (6.4)	0.45 (11.4)	0.18 (4.6)	5/16	0.41 (10.4)	0.61 (15.5)
1/4	6LV-4MW-9-03443	0.56 (14.2)	0.81 (20.6)	0.25 (6.4)	0.50 (12.7)	0.18 (4.6)	5/16	0.41 (10.4)	0.66 (16.8)
1/4	6LV-4MW-9-03444	0.76 (19.3)	0.76 (19.3)	0.45 (11.4)	0.45 (11.4)	0.18 (4.6)	5/16	0.61 (15.5)	0.61 (15.5)
1/4	6LV-4MW-9-03445	0.81 (20.6)	0.81 (20.6)	0.50 (12.7)	0.50 (12.7)	0.18 (4.6)	5/16	0.66 (16.8)	0.66 (16.8)

^② Also available in alloy C-22 (HC22) material
Dimensions are for reference only, subject to change.


MICRO-FIT® Weld Fittings

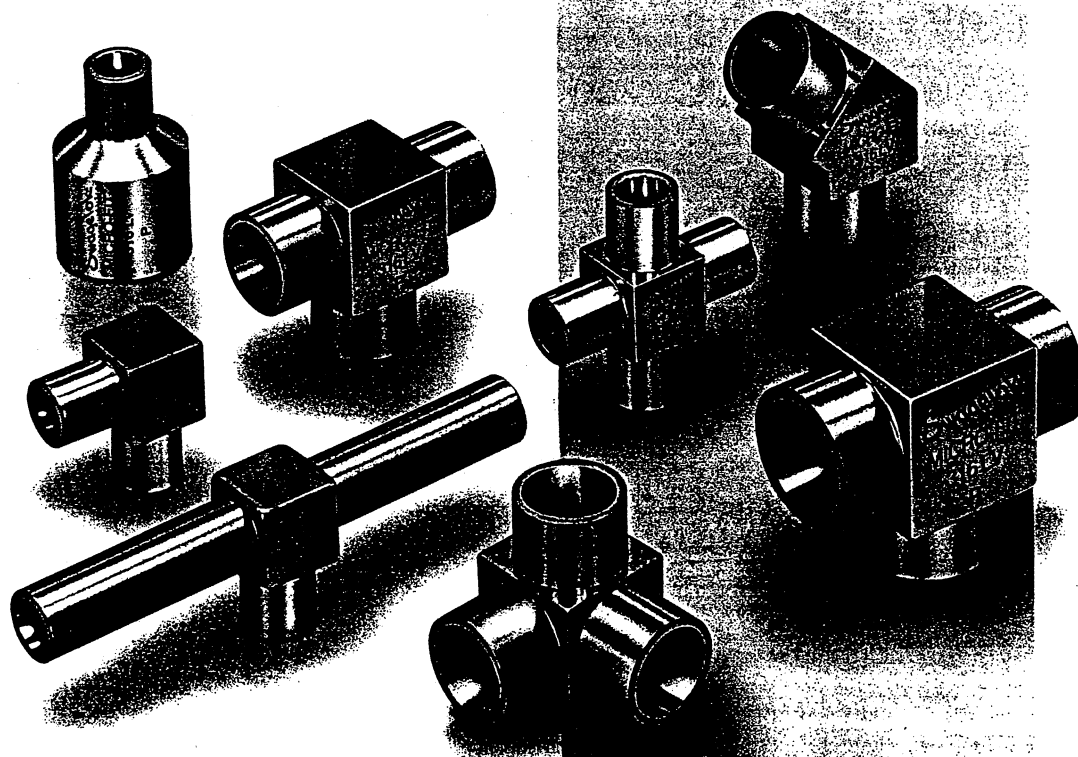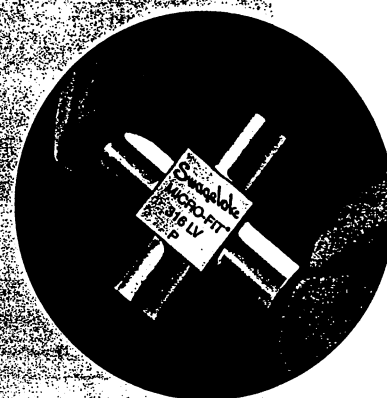

Swagelok

Cajon Company
Macedonia, Ohio 44056 U.S.A.

FEATURES/BENEFITS

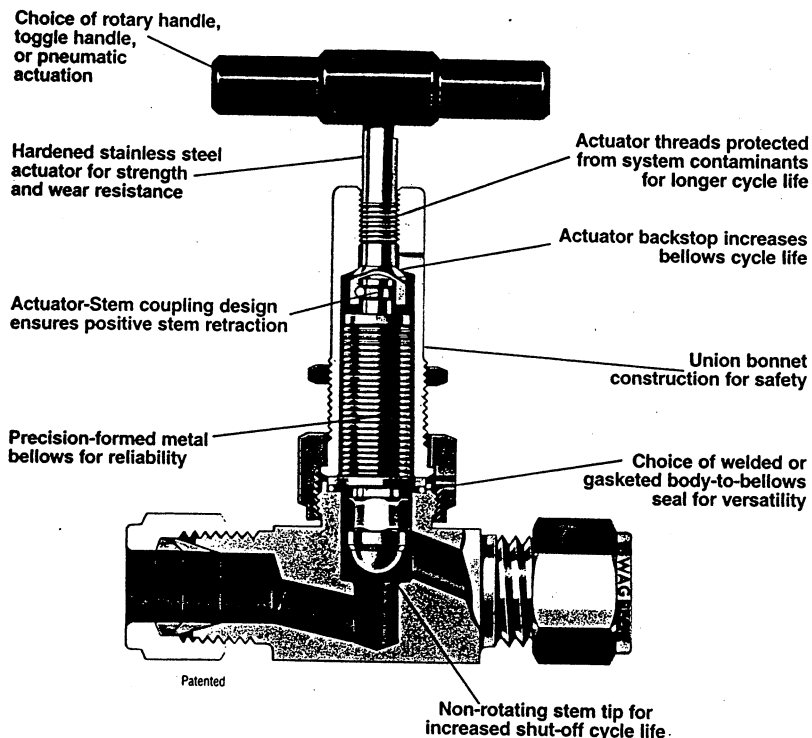

- Pressures to 1000 psig (68 bar)
- Temperatures to 900°F (482°C)
- Choice of materials: brass, 316 stainless steel, and alloy 400
- Flow Coefficients (C_v) from 0.36 to 1.2
- Gageable SWAGELOK® Tube Fitting ends 1/4" to 1/2" and 6mm to 12mm
- Tube socket weld ends: 1/4" to 1/2"
- Tube butt weld ends: 3/8" to 3/4"
- Tube extensions: 1/4" to 3/4" O.D. x 3" long
- CAJON® Male VCR® Metal Gasket Face Seal Fitting ends: 1/4" and 1/2"
- Choice of stem insert materials for shut-off and regulating service
- Panel mounting and bottom mounting
- Every valve is factory tested

TECHNICAL DATA

VALVE SIZE/SERIES	STEM TYPE	FLOW COEFFICIENT (Cv)	MAXIMUM PRESSURE RATING			MAXIMUM TEMPERATURE RATING		
			BRASS	316SS	ALLOY 400	BRASS	316SS	ALLOY 400
			Vacuum to					
-4BG-	Metal	0.39	1000 psig (68 bar)	1000 psig (68 bar)	700 psig (48 bar)	400°F (204°C)	600°F (315°C)	500°F (260°C)
-4BK-	Kel-F					200°F (93°C)	200°F (93°C)	200°F (93°C)
-4BKT-	Kel-F	0.36	100 psig (6.8 bar)			200°F (93°C)	200°F (93°C)	200°F (93°C)
-4BW-	Metal	0.39	N/A	1000 psig (68 bar)	700 psig (48 bar)	N/A	900°F (482°C)	500°F (260°C)
-4BRG-	Regulating	0.26	450 psig (31 bar)			400°F (204°C)	600°F (315°C)	
-4BRW-	Regulating		N/A			N/A		
-6BG-	Metal	1.0	1000 psig (68 bar)			200°F (93°C)	200°F (93°C)	
-6BK-	Kel-F		N/A	N/A	900°F (482°C)	500°F (260°C)		
-6BW-	Metal	1.2	1000 psig (68 bar)	400°F (204°C)	600°F (315°C)	500°F (260°C)		
-8BG-	Metal		N/A	200°F (93°C)	200°F (93°C)	200°F (93°C)		
-8BK-	Kel-F							
-8BW-	Metal							

① Due to the strength of brass threads, the cycle life of brass valves will be limited when operated frequently at pressures above 450 psig (31 bar).

Internal Volume

SERIES	INTERNAL VOLUME (approx.) ^②
4B	0.10 in. ³ (1.6 cm ³)
4BKT	0.11 in. ³ (1.8 cm ³)
4BR	0.16 in. ³ (2.6 cm ³)
6B	0.24 in. ³ (3.9 cm ³)
8BKT	0.26 in. ³ (4.3 cm ³)

Temperature Gradient 316 Stainless Steel Valves


WHEN VALVE SEATS	VALVE HANDLE IS
600°F (315°C)	195°F (91°C)
900°F (482°C)	275°F (135°C)

② Determined using SWAGELOK ended valves.

HB Series Air Actuated High Pressure Bellows Valve

VALVE FEATURES



- Choice of Normally Closed and Normally Open Modes
- Low actuation pressure of 75 psig (5 bar)
- Full pressure rating in either flow direction
- Positive stem retraction
- Easily purged
- Specially cleaned to SWAGELOK Specification SC-11
- Optional high-purity processing to SWAGELOK Specification SC-01 available
- 100% helium leak-tested
- Optional bonnet Sniffer Tube available

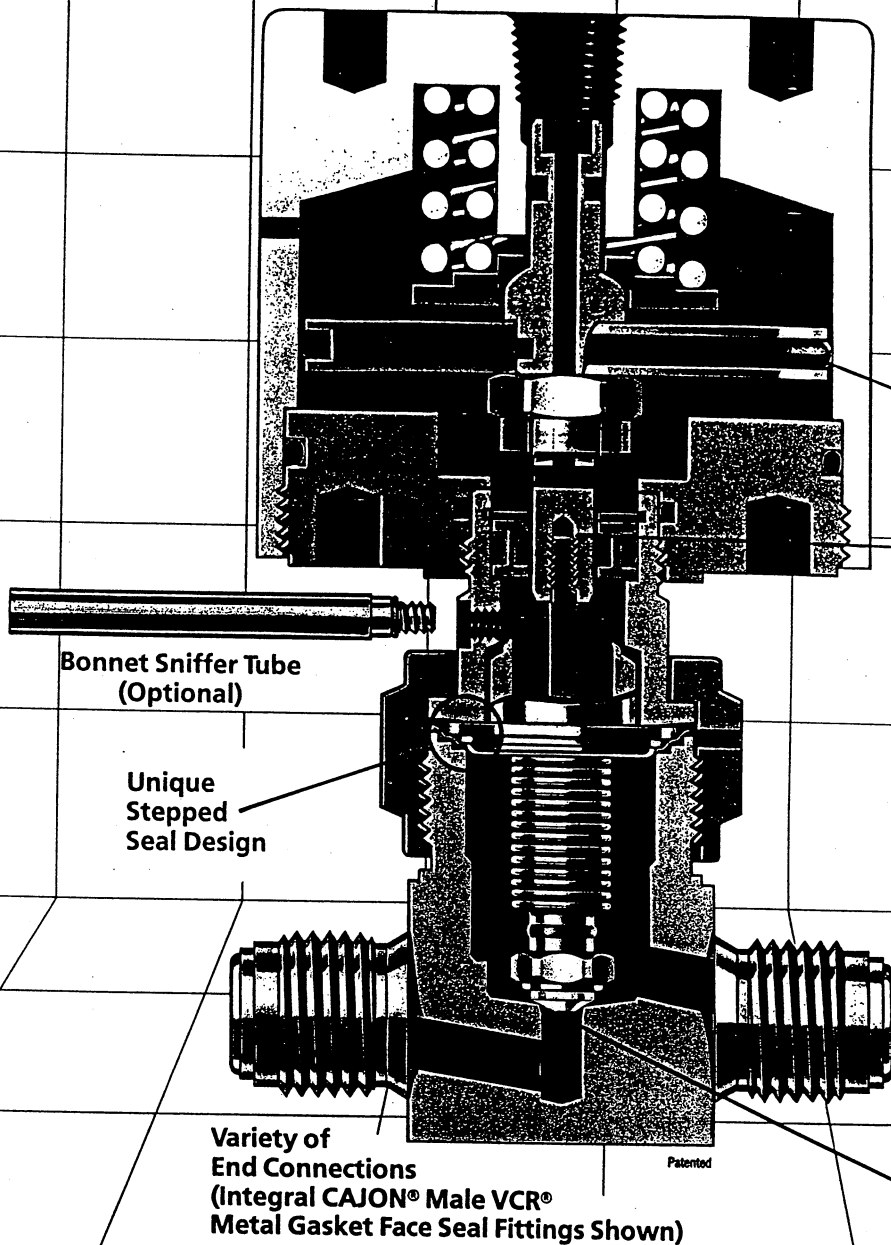


Technical Data

Orifice Size		Flow ^③ Coefficient Cv	Internal ^④ Volume (approx.)	Pressure Ratings at 70°F (20°C) ^⑥		Back Pressure Rating	Temperature Ratings ^①	
				for Valve	for Air Actuator		for Valve	for Air Actuator
0.15	3.8	0.30	0.27 in. ³ (4.4 cm ³)	3500 psig (240 bar) Maximum	30 to 110 psig ^② (2 to 8 bar) See Air Actuator Pressure at System Pressure graph.	3500 psig (240 bar)	with Kel-F Stem Insert: -40°F to 150°F (-40°C to 65°C) with Vespel Stem Insert: -40°F to 400°F (-40°C to 200°C)	-10°F to 400°F (-20°C to 200°C)

Table 8 Dimensions and Ordering Information

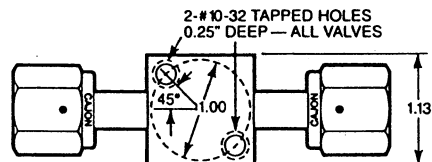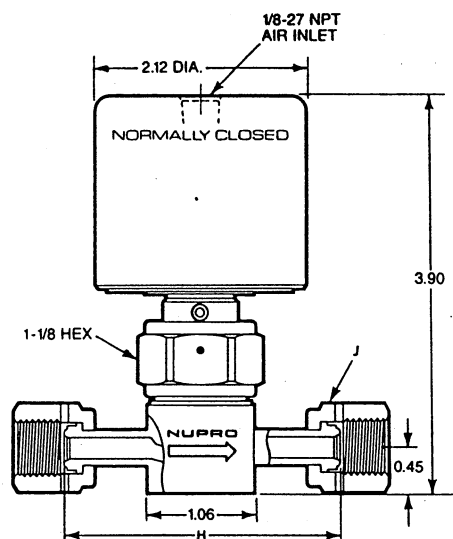

Bottom view



Gageability, an exclusive feature of SWAGELOK Tube Fittings, allows easy inspection for sufficient pull-up before a system is pressurized.

Connection Size	Basic Ordering Number ²	H	J Hex
1/4 Female VCR to 1/4 Female VCR	SS-HBV51-	2.76	3/4
1/4 SWAGELOK to 1/4 SWAGELOK	SS-HBS4- C 285.45	2.46	9/16
3/8 SWAGELOK to 3/8 SWAGELOK	SS-HBS6-	2.58	11/16
6mm SWAGELOK to 6mm SWAGELOK	SS-HBS6MM-	2.46	14mm
1/4 Male VCR to 1/4 Male VCR	SS-HBVCR4-	2.30	—
1/4 Butt Weld to 1/4 Butt Weld	6LV-HBBW4-	1.74	—
1/4 TSW or 3/8 TBW to 1/4 TSW or 3/8 TBW	SS-HBTW4-	1.75	—
3/8 TSW or 1/2 TBW to 3/8 TSW or 1/2 TBW	SS-HBTW6-	1.81	—

Ordering Number, and to specify all dimensions, refer to the Nupro Catalog or the Nupro Company for further information. Example: SS-HBV51-.

To order parts with 304 stainless steel, specify 304 in the Ordering Number. Order a Nupro Company Catalog, Nupro Company, P.O. Box 100, Nopro, N.J. 07043.

To order parts with 316 stainless steel, specify 316 in the Ordering Number. Example: SS-HBV51-316.

To order parts with 316L stainless steel, specify 316L in the Ordering Number. Example: SS-HBV51-316L.

To order parts with 316L stainless steel, specify 316L in the Ordering Number. Example: SS-HBV51-316L.


Dimensions shown with SWAGELOK and other fittings are approximate. All dimensions are subject to change without notice. For more information, please contact your Nupro representative.

SAFE INSTALLATION SELECTION

When selecting a Nupro valve for an application, the user should be aware of the valve's limitations and capabilities. The user should also consider the valve's installation, operation, and maintenance. The user should also consider the valve's safety features and the valve's compatibility with the system's design and materials.

CAUTION: Do not use a Nupro valve in an application where the valve is subjected to shock or vibration.

Typical Ordering Number Description

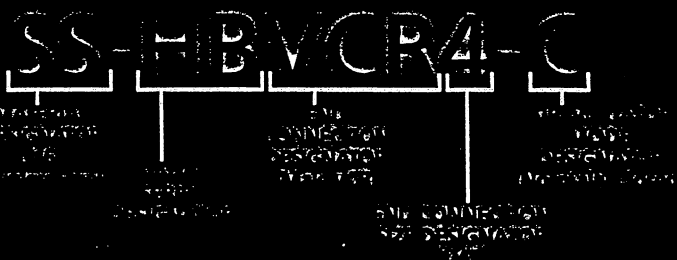



ZOOK®
ENTERPRISES, LLC
RUPTURE DISKS

16809 PARK CIRCLE DRIVE P.O. BOX 419
CHAGRIN FALLS, OHIO 44022
TOLL FREE: 800.543.1043
TEL: 440.543.1010
FAX: 440.543.4930
E-MAIL: zook@zookdisk.com
WEB URL: http://www.zookdisk.com

FAX TRANSMISSION SHEET

DATE: JUNE 25, 1999

TO: BOB PATERESON

COMPANY: LAWERNCE-LIVERMORE NATIONAL LAB.

FROM: ALAN KOHTA

SUBJECT: 1/2" - 2250 PSIG & 2" 150 PSIG RUPTURE DISKS

THE RUPTURE DISKS YOU RECEIVED ARE TESTED UNDER THE SAME
GUIDE LINES AS ASME RUPTURE DISKS.

DISK

SIZE:	1/2"	2"
TYPE:	Z	Z
S/N:	44786.010	44786.030
MATERIAL:	STAINLESS STEEL	STAINLESS STEEL
RATING	2250 PSIG	150 PSIG
TEMPERATURE:	72 DEG. F	72 DEG. F
MFG RANGE:	-3/+6%	-4/+7%
BURST TOL:	+/-5%	+/-5%

HOLDER

SIZE:	1/2"	2"
TYPE:	UNION 6U	UNION 6U
S/N:	44786.020	44786.040
MATERIAL:	STAINLESS STEEL	STAINLESS STEEL

ZOOK® Series Z

Forward Acting

Metal Rupture Disks

Bulletin no. 20100

Features:

- Forward acting tension type design without score lines
- Operates to 70% of the disk's rated burst pressure
- Sizes available from 1/4" thru 36" diameters
- Burst pressures range from 3 to 80,000 psig
- Temperature ratings up to 1000°F (538°C)
- Excels in liquid or gas applications

Options

Seating Configurations ZOOK's Series Z Rupture Disks come in two basic seating designs:



1. 30° angular *light-lip design* for normal operating pressures
2. 30° *heavy-lip design* for higher pressures.

Vacuum Supports Due to thinness of some disk materials, a vacuum support may be required. Vacuum supports are attached to a disk and allow the disk to support a full system vacuum. Consult ZOOK if back pressures are expected.

Liners/Coatings Provide additional protection from the effect corrosives might have on disk performance. Liners are made of TEFLON®. Teflon coatings also are used to protect the disk from atmospheric or corrosive media. Refer to *Table 2* for maximum temperature ratings for various disk, liner and coating materials.

Protective Rings Can be used with Series Z Disks made of thin materials or when delicate liners are used. These rings protect the rupture disk from foreign material in the sealing area where holders may be pitted or corroded from extended use.

Gaskets Can be used to provide additional sealing and prevent leakage through the seating area of a scratched or pitted holder. They are located on the process side of the disk and are usually made from Teflon. Other materials are available upon request.

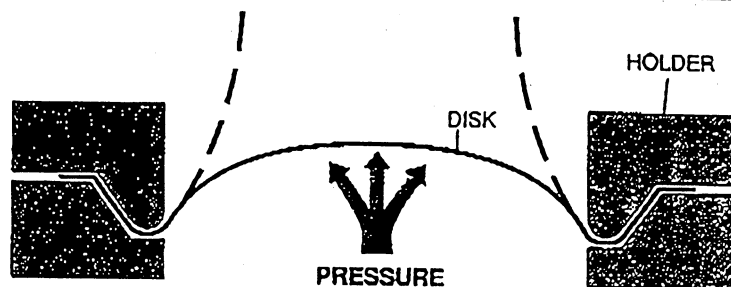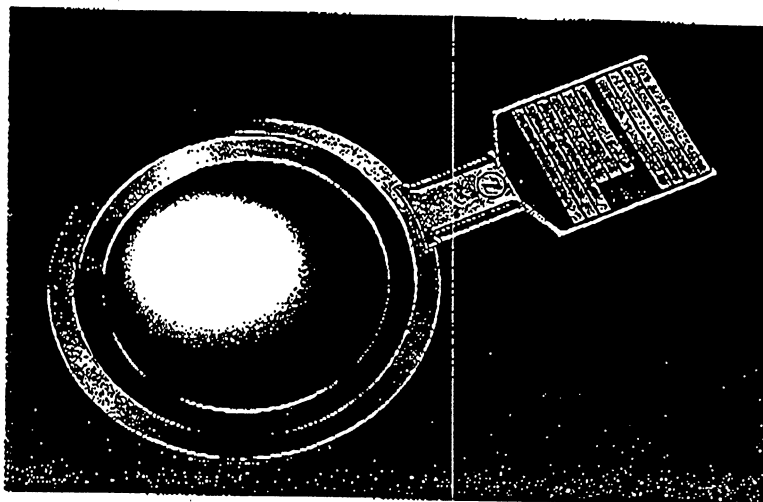

Series Z Disks mount with the concave surface toward the process media. As pressure increases above the recommended operating pressure, the disk will bulge until it reaches the maximum tensile strength of the material. When the Series Z Disk bursts, it folds back against the holder. This results in a full-opening for optimal flow conditions.

Forward Acting Rupture Disk Cross-Reference

	ZOOK	OSCO	BS & B	GDC	FIKE
Forward Acting	Z	STD	B	STD	P
W/Vacuum Support	ZV	STDV	BV	STD-V	PV
W/Top Ring	RZ	RSTD	BR	R-STD	CP
W/Top & Bottom Ring	RZR	RSTDOR	BRR	R-STD-R	CPC
W/Ring & Vacuum Support	RZV	RSTDORV	BRV	R-STD-V	CPV



ZOOK®
ENTERPRISES
16809 Park Circle Drive
Box 419
Chagrin Falls, OH 44022
Phone: (216) 543-1010
1-800-543-1043
FAX: (216) 543-4930

Table 1 – Minimum and Maximum Burst Pressures for Series Z Rupture Disks

Minimum Burst Pressure (without liners)/Maximum Burst Pressure (with Teflon liners) psig @ 72°F													For Disks with Teflon Liners (Add to Disk Minimum Burst Pressure)		
Size	Aluminum		Silver		Nickel		Monel		Inconel		316SS		Inlet Only	Outlet Only	Both Sides
	min.	max.	min.	max.	min.	max.	min.	max.	min.	max.	min.	max.			
1/4"	160	250	450	550	600	750	700	850	1120	1250	1550	1700	▲	▲	▲
1/2"	65	1500	220	2500	300	6000	350	6000	560	10000	760	10000	150	150	300
1"	29	1000	120	1800	150	3000	180	3000	250	5000	420	5000	50	50	100
1-1/2"	22	700	80	1700	100	2000	116	2000	160	3000	275	3000	35	35	70
2"	13	500	48	1500	60	1300	70	1300	110	2000	150	2000	25	25	50
3"	10	300	35	1000	45	900	50	900	80	1500	117	1500	15	15	30
4"	7	225	26	725	35	650	40	650	70	1000	90	1000	11	11	22
6"	5	140	20	420	25	500	30	500	47	800	62	800	8	8	16
8"	4	100	15	300	20	350	23	350	34	600	51	600	6	6	12
10"	4	75	▲	▲	16	300	17	300	30	500	43	500	5	5	10
12"	3	60	▲	▲	13	250	15	250	25	400	36	400	4	4	8
14"	3	45	▲	▲	11	200	13	200	21	350	31	350	4	4	8
16"	3	▲	▲	▲	10	150	12	150	19	300	28	300	3	3	6
18"	3	▲	▲	▲	9	120	11	120	17	250	24	250	3	3	6
20"	3	▲	▲	▲	8	100	9	100	16	200	22	200	3	3	6
24"	3	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	2	2	4
30"	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲
36"	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲

Protective Blings should be used when Burst Pressure is below the pressures shown (psig @ 72°F).

1/4"	▲	▲	▲	▲	▲	▲
1/2"	520	1300	2290	3000	3600	3700
1"	260	650	1145	1500	1800	1830
1-1/2"	180	450	790	1030	1240	1255
2"	110	280	485	635	760	775
3"	75	200	340	445	535	545
4"	60	150	270	350	420	430
6"	45	115	200	260	315	320
8"	35	85	155	200	240	245
10"	28	▲	125	160	195	200
12"	24	▲	105	135	160	165
14"	20	▲	90	115	140	140
16"	18	▲	80	100	120	125
18"	16	▲	70	90	110	110
20"	14	▲	62	80	100	100
24"	12	▲	52	68	80	85
30"	▲	▲	▲	▲	▲	▲
36"	▲	▲	▲	▲	▲	▲

(▲) = Consult ZOOK

Table 1 – notes

- Maximum burst pressures depend on disk size and application temperature. Pressures to 80,000 psig are available.
- Other material and sizes are available upon request.
- Other liner materials are available upon request. Minimum burst pressures will change with change in liner material.
- For larger sizes or sizes not shown, contact ZOOK.

Table 2

Maximum Temperature Ratings for Disk Materials	
Aluminum	260°F
Silver	260°F
Nickel	800°F
Monel	800°F
Inconel	1000°F
316 Stainless Steel	900°F
Maximum Temperature Ratings for Liners and Coatings	
Teflon	FEP 400°F
	TFE or PFA 500°F

Table 3


Manufacturing Range/Burst Tolerance @ 72°F			
Specified Burst Pressure Rating psig	Manufacturing Range		Burst Tolerance
	Under	Over	
2-5	-40	+40	±2 psig
6-8	-40	+40	
9-12	-30	+30	
13-14	-10	+20	
15-19	-10	+20	
20-39	-4	+14	
40-50	-4	+14	±5%
51-100	-4	+10	
101-500	-4	+7	
501-up	-3	+6	

Table 3 – notes

- Special reduced manufacturing design ranges for the Series Z forward acting metal disk. 25%, 50% and 75% ranges are available upon request. Please consult ZOOK for additional information.
- Burst tolerances are the maximum expected variation from the disk's rated (stamped) burst pressure.
- ZOOK Series Z rupture disks can be manufactured to comply with ASME code requirements.

Union Holder for Standard or Composite Type Rupture Discs


2-3308-2




Assembly #1U
Free Outlet
Threaded Inlet




Assembly #2U
Threaded Outlet
Threaded Inlet



Assembly #3U
Welded Outlet
Threaded Inlet



Assembly #4U
Free Outlet
Welded Inlet



Assembly #5U
Threaded Outlet
Welded Inlet



Assembly #6U
Welded Outlet
Welded Inlet

Union type SAFETY CROWNS are provided in 1/2", 1", 1 1/2" and 2" pipe sizes. Standard bore for welded connections in Assemblies 3U, 4U, 5U and 6U are as follows:

1/2", 1" and 1 1/2" (either 3000 or 6000 psig. rating) - Schedule 80
2" (1200 psig. Maximum rating) - Schedule 40

These units are normally furnished constructed of carbon steel. However, all parts can be supplied from 300 series stainless steel or other machinable metal. Free outlets are sometimes supplied with threaded or welded connections at no additional charge.

All units are designed with 30 degree angular seating. When ordering standard or composite discs, please state that the disc is for a (UT) union type holder. By doing so, ~~ZOOK~~ will NOT attach the tags to the disc, and we will trim the disc OD to assure a perfect fit in the holder. The tags will ship with discs as a separate item. Holes have been punched in the corner of the tag, so they can be wired to the union during installation for positive disc identification.



Union assemblies #2U and #5U can be supplied with a muffled outlet. This prevents any fragments or product from dispersing direct from nozzle. Also, there is a reduction in the noise (db) level at burst of the disc.

Dimensions and maximum pressure ratings are listed on Page 2.

DIMENSIONS

PIPE SIZE	MAX RATING PSIG	HEX SIZE	OVERALL HEIGHT (Inches)					
			1U	2U	3U	4U	5U	6U
1/2"	3000	1-3/4"	1-5/8"	2-3/8"	2-1/4"	1-3/4"	2-3/8"	2-1/4"
1/2"	6000	2"	1-7/8"	2-5/8"	2-3/4"	2-3/16"	2-11/16"	2-3/16"
1"	3000	2-1/2"	2-1/8"	3-1/4"	3-1/4"	2-1/4"	3-1/4"	3-1/4"
1"	6000	3"	2-7/16"	3-3/8"	3-1/4"	2-5/8"	3-1/2"	3-3/8"
1-1/2"	3000	3-1/2"	2-7/16"	2-7/16"	3-6/16"	2-7/16"	3-7/16"	3-1/2"
2"	1200	4-1/2"	2-5/8"	4"	4"	2-5/8"	4"	4"

PRESSURE/TEMPERATURE RATINGS FOR UNION TYPE SAFETY CROWN FITTINGS

SERVICE TEMP. °F	MAXIMUM RATING					
	1200 psi ASSEMBLY MATERIAL		3000 psi ASSEMBLY MATERIAL		6000 psi ASSEMBLY MATERIAL	
	300 Ser.		300 Ser.		300 Ser.	
	C. Std	Stainless	C. Std	Stainless	C. Std	Stainless
100	1200	1200	3000	3000	6000	6000
200	1165	1165	2915	2915	5830	5830
300	1135	1135	2845	2845	5690	5690
400	1110	1110	2775	2775	5550	5550
500	1040	1040	2605	2605	5210	5210
600	925	925	2310	2310	4620	4620
700	785	825	1960	2055	3920	4110
800	610	750	1625	1865	3050	3730
900	370	670	925	1675	1855	3350
1000	140	695	355	1485	715	2975

To change inches to millimeters multiply inches by 25.40.

To change inches to centimeters multiply inches by 2.540.

To change PSIG to Kg-cms squared multiply PSIG by 0.3417.



ZOOK®
ENTERPRISES, LLC
RUPTURE DISKS

16809 PARK CIRCLE DRIVE • CHAGRIN FALLS, OHIO 44022 •
(440) 543-1010 • FAX (440) 543-4930

ASME Sect E Div 1
UG-127 or so

ZIG-6001

306546
306593
WARNING

SERIES 'Z' INSTALLATION GUIDE

IN ZA TYPE 30° SEAT, FULL BOLTED & UNION TYPE HOLDER

@ least 2 for
agreed

740 psig ± 5%

USER SHOULD READ AND THOROUGHLY UNDERSTAND THESE INSTRUCTIONS BEFORE INSTALLING RUPTURE DISK. THESE INSTRUCTIONS DO NOT PURPORT TO ADDRESS ALL OF THE SAFETY FACTORS ASSOCIATED WITH THE RUPTURE DISK'S USE IN SERVICE. IT IS THE RESPONSIBILITY OF THE USER TO ESTABLISH APPROPRIATE SAFETY, HEALTH, AND TRAINING MEASURES FOR THEIR PERSONNEL INSTALLING, SERVICING, OR WORKING IN AN AREA WHERE RUPTURE DISK ASSEMBLIES ARE IN USE.

< 4 psig ± 2 psig

IT IS THE USER'S RESPONSIBILITY FOR DESIGN OF ADEQUATE VENTING AND INSTALLATION OF ADEQUATE VENT PIPING OR DIRECTIONAL FLOW AFTER RUPTURE OCCURS WITH THE RUPTURE DISK AS INTENDED. WHEN SIZE IS SPECIFIED, ZOOK ENTERPRISES ASSUMES THAT ADEQUATE PROVISIONS HAVE BEEN MADE BY PURCHASER FOR PROPER VENTING OF A SYSTEM TO RELIEVE THE SPECIFIC PRESSURE. LOCATE RUPTURE DISK WHERE PEOPLE OR PROPERTY WILL NOT BE EXPOSED TO THE SYSTEM DISCHARGE IN CASE OF RUPTURE. VENT TOXIC OR FLAMMABLE FUMES OR LIQUIDS TO A SAFE LOCATION TO PREVENT PERSONAL INJURY OR PROPERTY DAMAGE.

IT IS THE USER'S RESPONSIBILITY TO SPECIFY THE BURST PRESSURE RATING OF A RUPTURE DISK AT A COINCIDENT TEMPERATURE AT WHICH THE RUPTURE DISK IS TO BE USED. A RUPTURE DISK IS A TEMPERATURE SENSITIVE DEVICE. THE BURST PRESSURE OF THE RUPTURE DISK IS DIRECTLY AFFECTED BY ITS EXPOSURE TO THE COINCIDENT TEMPERATURE. GENERALLY, AS THE TEMPERATURE AT THE RUPTURE DISK INCREASES, THE BURST PRESSURE DECREASES; INVERSELY, AS THE TEMPERATURE AT THE RUPTURE DISK DECREASES, THE BURST PRESSURE MAY INCREASE. FAILURE TO PROPERLY UTILIZE A RUPTURE DISK AT THE SPECIFIED COINCIDENT TEMPERATURE COULD CAUSE PREMATURE FAILURE OR OVERPRESSURIZATION OF A SYSTEM.

THE INSTANTANEOUS RELEASE OF PRESSURE FROM THE RUPTURE DISK CAN CREATE VIOLENT NOISES DUE TO THE DISCHARGE AT SONIC VELOCITY. IT IS THE USER'S RESPONSIBILITY TO PROTECT AGAINST HEARING DAMAGE TO ANY BYSTANDERS.

PARTICLES MAY BE DISCHARGED WHEN THE RUPTURE DISK RUPTURES. THESE PARTICLES MAY BE PART OF THE RUPTURE DISK ITSELF, OR OTHER ENVIRONMENTAL MATTER IN THE SYSTEM. IT IS THE USER'S RESPONSIBILITY TO ASSURE THAT THESE PARTICLES ARE DIRECTED TO A SAFE AREA TO PREVENT PERSONAL INJURY OR PROPERTY DAMAGE.


THERE IS NO GUARANTEE OF RUPTURE DISK LIFE. SUCH LIFE SPAN IS AFFECTED BY CORROSION, CREEP AND FATIGUE, AND PHYSICAL DAMAGE. THESE CONDITIONS WILL DERATE THE RUPTURE DISK TO A LOWER SET PRESSURE. THE CUSTOMER AND/OR USER SHOULD BE PREPARED TO HANDLE A PREMATURE FAILURE OF THE RUPTURE DISK. THE MEDIA OR OTHER ENVIRONMENTAL CONDITIONS SHOULD NOT ALLOW ANY BUILD-UP OR SOLIDIFICATION OF MEDIA TO OCCUR ON A RUPTURE DISK. THIS MAY INCREASE THE PRESSURE SETTING OF THE RUPTURE DISK.

CUSTOMER AND/OR ITS INSTALLER SHALL BE RESPONSIBLE FOR THE PROPER INSTALLATION OF SELLER'S HOLDERS AND RUPTURE DISKS INTO A SYSTEM. CUSTOMER AND/OR ITS INSTALLER SHALL BE RESPONSIBLE FOR IMPROPER INSTALLATION AND PHYSICAL DAMAGE RESULTING THEREFROM, INCLUDING, BUT NOT LIMITED TO, DAMAGE RESULTING FROM LEAKAGE, IMPROPER TORQUING, AND FAILURE TO FOLLOW INSTALLATION INSTRUCTIONS.

I. Safety Precautions Before Installation

1. The SERIES "Z" Type Rupture Disk is a precision instrument and must be handled with extreme care. Rupture disks should be installed only by qualified personnel familiar with rupture disks and proper piping practices.
2. Do not install rupture disk if there is any damage in the dome area. A damaged rupture disk is any rupture disk with visible nicks or dents in the dome.
3. Zook Enterprises does not recommend reinstalling a rupture disk that has been removed from the holder as reinstallation may adversely affect the joint sealing capabilities and/or performance of the rupture disk.

BS & B

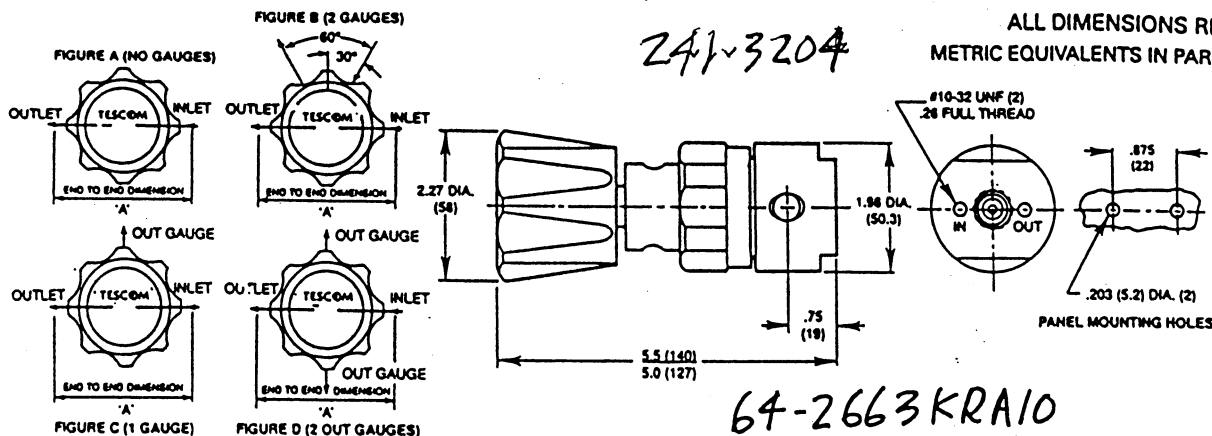

64-2663KRA10
64-2663KRH19

SPECIFICATIONS

FLUID MEDIA — All gases corrosive or non-corrosive or those requiring high purity regulation compatible with materials of construction.
Maximum rated inlet pressure.....

3500 PSIG (238 bar)

Outlet pressure ranges..... 1-30, 1-60, 1-100 and 1-250 PSIG

(.1-2, .1-4, .1-7 and .1-17 bar)

Design proof pressure..... 150% of maximum rated pressure

Design burst pressure..... 400% of maximum operating pressure

Materials:

Body..... 316L Stainless Steel

Seat..... Kel-F 81* or Teflon*

(Vespe® - optional for 3500 PSIG model only)

Diaphragm..... 316L Stainless Steel

Valve stem..... 316 Stainless Steel

Spring..... 316 Stainless Steel

Valve guide..... 316L Stainless Steel

Flow capacity..... Cv = .06 (3500 PSIG model)

Cv = .15 (600 PSIG model)

Porting..... Four High Purity Internal Connections (Style 'A')

Operating temperature..... Kel-F 81*: -40°F to +140°F (-40°C to +60°C)

Teflon*: -40°F to +160°F (-40°C to +71°C)

Vespe®: -40°F to +165°F (-40°C to +74°C)

Weight (w/o gauges)..... 2.0 lbs. (.9 kg.)

ORDERING INFORMATION

EXAMPLE: 64-2662KA410

BASIC SERIES	GAUGE PORT OPTION	NO. OF GAUGE PORTS
BODY MATERIAL	0 - None	0 (fig. A)
6 - 316L Stainless Steel	1 - 1/4" HPIC-A	1 (fig. C)
OUTLET PRESSURE RANGES	2 - 1/4" HPIC-A	2 (fig. B)
0 - 0-30 PSIG (0-2.1 bar)	3 - 1/4" HPIC-A	2 (fig. D)
1 - 0-60 PSIG (0-3.4 bar)	4 - 1/4" Male Swivel	2 (fig. D)
2 - 0-100 PSIG (0-7 bar)	5 - 1/4" Male Swivel	1 (fig. C)
3 - 0-250 PSIG (0-17 bar)	6 - 1/4" Male Swivel	2 (fig. B)
SEAT MATERIAL	7 - 1/4" Female Swivel	2 (fig. D)
K - Kel-F 81*	8 - 1/4" Female Swivel	1 (fig. C)
T - Teflon*	9 - 1/4" Female Swivel	2 (fig. B)
V - Vespe® (3500 PSIG models only)	S - 1/4" Fixed Male	2 (fig. B)
INLET & OUTLET PORT TYPE	T - 1/4" Fixed Male	1 (fig. C)
A - H.P.I.C.* Style 'A' (see below)	U - 1/4" Fixed Male	2 (fig. D)
R - Welded ** (see below)	MAXIMUM INLET PRESSURE	
	1 - 3500 PSIG (238 bar)	
	2 - 600 PSIG (41 bar)	
	INLET & OUTLET PORT SIZE	'A' ±.06"
	4 - 1/4" (HPIC only)	4.5"
	G - 1/4" Male Swivel	4.5"
	H - 1/4" Female Swivel	4.5"
	L - 1/2" Female Swivel	4.75"
	A - 1/4" Male Fixed	3.51"
	N - IN Port: 1/4" Male Swivel	4.5"
	OUT Port: 1/4" Female	4.5"
	R - IN Port: 1/4" Female	4.5"
	OUT Port: 1/4" Male Swivel	4.5"
	K - 1/2" Male Swivel	4.75"

*HIGH PURITY INTERNAL CONNECTIONS (H.P.I.C.)

Specify letter 'A' for Tescom High Purity Internal Connections. These are machined inside regulator body and are designed to be compatible with VCR® (or equivalent) male fittings — swivel only.

** WELDED FITTINGS — Optional at Additional Cost

Straight tubing or VCR® (or equivalent compatible) fittings welded to the regulator body. Consult factory for specific part number.

CLEANING: Tescom ES 500 DI water cleaning is performed on all 64-2600 models.

ADJUSTABLE STOP: This regulator incorporates an adjustable stop which allows the maximum outlet pressure to be limited to any value between the maximum rated value and 50% of the maximum rated value.


LEAK RATE CERTIFICATION To 1×10^{-9} atm cc/sec He available at extra cost. Consult factory.

ACCESSORIES (additional cost)

REPAIR KITS:

Model	Standard Repair Kit	Soft Goods Kit
64-266XXXX1X	P/N 389-3575	P/N 389-3572
64-266XXXX2X	P/N 389-3576	P/N 389-3573
64-266XTXX1X	P/N 389-3577	P/N 389-3574
64-266XTXX2X	P/N 389-3607	P/N 389-3606
64-266XVXX1X	P/N 389-3739	P/N 389-3738
64-266XVXX2X	P/N 389-3741	P/N 389-3740

Gauges: Consult GAUGES, section of catalog.

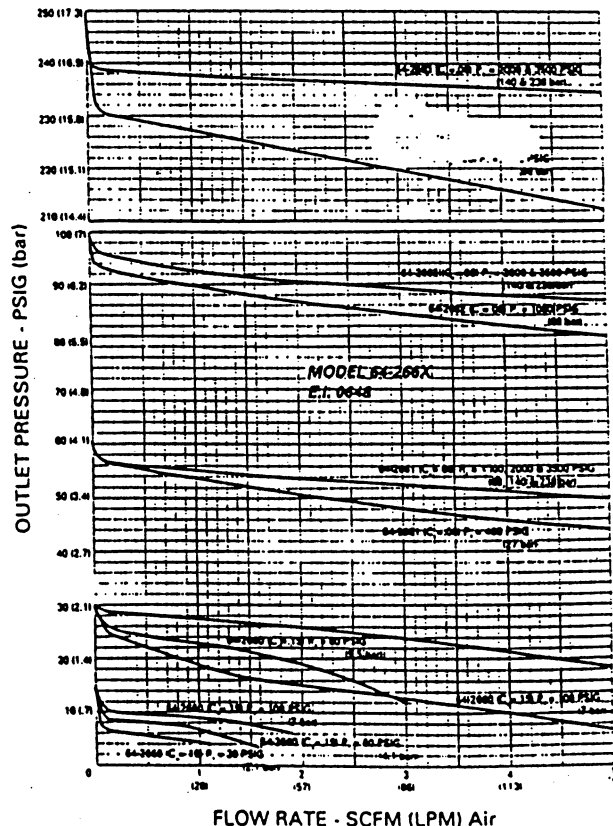FLOW CHART (Metric units are in parenthesis)
REGULATOR DISCHARGE CHARACTERISTIC CURVES

SUGGESTED SOURCE OF SUPPLY
SPAN INSTRUMENTS

PRESSURE GAUGE

2.3 O.D. 316 SST BOURDON TUBE SOCKET
AND TIP WELDED

DIAL DATA

SIZE (FACE).....	2.0 INCH DIAMETER
RANGE.....	REFERENCE TO TABLE 1
ARC OF CAL IB.....	20°
ACCURACY.....	1% OF SCALE
DIAL FACE.....	DUAL SCALE PSI/BAR

MATERIALS

CASE,-----	316 55T
RING & WINDOW,-----	SAFETY GLASS
TUBE,-----	316 55T
SOCKET,-----	316 55T
MOVEMENT,-----	55T LINKS AND PINS

CONNECTION:-----SEE TABLE II
CLEANING:-----ANSI B40.1 LEVEL IV

NOTE:



1
SCALES DIFFERENT THAN THOSE SHOWN IN THE
TABULATION NOT PERMITTED.

2. BEFORE BOXING GAUGES, CAP THE BOURDON TUBE FITTING OR SEAL IN PLASTIC BAG.

TABLE 11		
DASH NO.	CONNECTION TYPE	A REF.
N.	NPT	1.94
H	CAJON VCR (HALE) SWIVEL	2.24
R	CAJON VCR (FEMALE)	2.24

PART NUMBER DESIGNATION.

4802-0030N-5

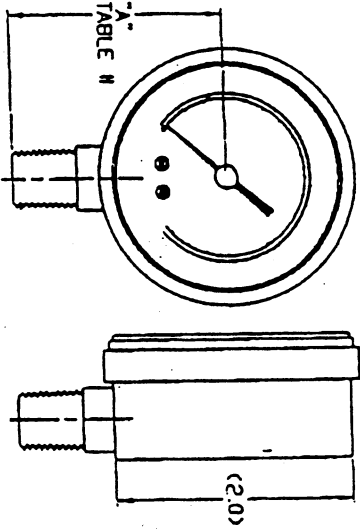

4802

TABLE I

DASH NUMBER	PSIG	MAX. INDICATION	
		BAR EQUIVALENT	INCHES Hg
-0030	30	2	---
-0060	60	4	---
-0100	100	6.7	---
-0200	200	13.3	---
-0600	600	40	---
-1000	1000	66.7	---
-3000	3000	200	---
-4000	4000	266.7	---
-6000	6000	400	---
-V030	30	2	30/1
-V060	60	4	30/1
-V015	15	1.	30/1
-V100	100	6.7	---
-10000	10000	666.7	---
-0300	300	20.1	---
-0015	15	1	---
-5000	5000	333.3	---
-0160	160	10.7	---
-V200	200	13.8	30/1

[illegible]

File No. MESN99-038-0B
January 31, 2000

MECHANICAL ENGINEERING SAFETY NOTE


Gas Delivery System and Reclamation Cylinders for Gamma Ray
Imager, B Revision

Prepared by:



Blake Myers
Mechanical Engineer
New Technologies Engineering Division

Reviewed by:

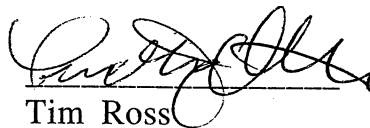

Tim Ross
Pressure Inspector
Laser Science Engineering Division


 1-31-00

Chuck Borzileri
Pressure Consultant
Applied Research Engineering Division



Dan Archer
Experimental Physicist
C&MS Directorate / NAI Program

Approved by:



Satish Kulkarni
Division Leader
New Technologies Engineering Division

Distribution:

Dan Archer, L-186
Chuck Borzileri, L-384
Neil Frank, L-113
Satish Kulkarni, L-113
Blake Myers, L-174
Tim Ross, L-474
Kathlyn Snyder, L-172
Klaus Ziock, L-43
Engineering Records Center, L-118

Purpose:

This revision has the purpose of permitting the addition of components to the time projection chambers (TPCs) in the Gamma Ray Imager.

Situation:

There are two time projection chambers which have been installed on the Gamma Ray Imager. They are covered by MESN99-020-0A which includes the following referenced drawings and which sanctions the use at an MAWP of 978 psig when used with the metal C-ring type blind flange (called a flat head in the safety note), as shown on AAA99-104243, on the main chamber flange, plus the conflat blind flange 4-5/8" D x 0.75 thick on the top chamber flange, plus the 1/2 D VCR plugs modified to give a 0.057 thick window in 5 of the 9 VCR chamber outlets and stock 1/2 D VCR plugs in the remaining outlets. The east chamber in this configuration has been pressure tested at 1470 psig and is tagged for 978 psig for reference and has a 978 psig rupture disc installed to protect this sanction.

The sanctioned MAWP for routine operations is 402 psig when used with the six-hole conflat type flange as shown on AAA99-104240 on the main chamber flange, plus the same conflat blind flange on the top chamber flange, plus the 5 and 4 VCR plugs in the 9 side outlets as above, plus a 2 3/4 D conflat blind flange, modified to give a 0.118 thick x 1.25 D gamma ray window, in the central hole of the six-holer and the five Ceramaseal part no. 19543-04-CF electrical feed thru's or the 1.33 D conflat blind flanges in the remaining five holes. The west chamber in this configuration has been pressure tested to 604 psig

and is tagged for 402 psig for reference and has a 402 psig rupture disc installed to protect this sanction.

The two chambers are connected to the gas handling system via V91, V93, V96 and V97 with Swagelok H016 flex hose rated at 1200 psig. The valves are NUPRO, p/n SS-8BGVCR3-C, rated at 1000 psig. The hoses connect from the valves to two VCRs on the 3 VCR side of the chambers.

The chambers are pressurized by filling with the appropriate measured mass of input gas at the chamber cryo leg temperature and then warming as required.

There is interest on the part of the experimenters in having flexibility in configuring the connections on the TPCs in various ways apart from the basic flex hose connection to the gas handling system. Examples include adding pressure gages and transducers, adding a quartz window, changing the Ceramaseal feedthrus and changing the rupture discs to match the pressure rating of these new components.

Plan:

The plan is very simple. Any departure from the sanctioned configurations shall be signed off by a pressure inspector and involve an independent pressure test of the proposed component(s) at 1.5X the desired MAWP and installation of a rupture disc within the subject circuit set at that MAWP. The proposed components must be used at an MAWP at or below their nameplate pressure rating as well as at or below the basic chamber MAWP. This pressure at the present time for routine operations is 402 psig.

All departures shall be entered in the TPC log in detail on each occasion and referenced on the following summary sheet in the TPC log.

Summary of Departures from Sanctioned Configuration:

<u>Brief Description</u>	<u>Page No.</u>	<u>New MAWP</u>	<u>Signed By</u>	<u>Date</u>
--------------------------	-----------------	-----------------	------------------	-------------

Interdepartmental letterhead

Revision A
END 92-072

Mail Station L- 373
Ext: 4-4688

AAN93-100021-0A




High Pressure Systems Group
Nuclear Test Engineering Division

September 8, 1993

TO: Distribution

FROM: Matt Traini, Pressure Inspector

SUBJECT: END92-072, REVISION A, PRESSURE TESTING OF VACUUM
"CONFLAT" FLANGES



Please replace your existing copy of END92-072 with the current one enclosed. The only difference is the addition of information regarding the pressure testing of 8 inch diameter flanges with viewports. Tests were conducted by Roger Carnahan, Pressure Inspector, High Pressure Laboratory. This information is summarized on page 14.

Distribution:

- C. Borzileri, L-384
- J. Brentjes, L-373
- R. Carnahan, L-373
- O. Parker, L-373
- T. Ross, L-373
- P. Smuda, L-373
- H/C File 3-ME Safety Notes
- Standards/Specification, L-129
- ME Library, L-127
- HPL Library, L-373
- NTED Division File




University of California

 Lawrence Livermore
National Laboratory

AAN93-100021-0A

Mechanical Engineering Note

PRESSURE TESTING OF VACUUM "CONFLAT" FLANGES



By

Matthew W. Traini

November 1992

Revision A, September 1993

Distribution:

C. Borzileri, L-384

J. Brentjes, L-373

R. Carnahan, L-373

O. Parker, L-373

T. Ross, L-373

P. Smuda, L-373

H/C File 3-ME Safety Notes

Standards/Specification, L-129

ME Library, L-127

HPL Library, L-373

NTED Division File

The purpose of this Engineering Note is to summarize pressure tests that were performed on a variety of vacuum "conflat" flanges. Since manufacturers offer no pressure ratings on vacuum components, it was necessary to perform tests at the Lawrence Livermore National Lab (LLNL), High Pressure Laboratory (HPL), Bldg. 343. This would assist designers in determining working pressures and establishing safety guidelines when using.

All the test results are presented in memo format as was originally issued.

The first series of tests involved testing a $1\frac{1}{3}$ " diameter flange that was welded to a valve and connected to a gas sample cylinder (Refer to memo dated January 27, 1988 to C. Borzileri). Building 343 Test Request (T.R.) #6226 required the testing of both $1\frac{1}{3}$ " and $2\frac{3}{4}$ " blank flanges.

The second series of tests are referenced to T.R. 6408 (Refer to memo dated March 31, 1988 to J. Stapleton). These tests involved $4\frac{5}{8}$ " flanges that were connected to a 2 liter volume.

The final series of test involved pressure testing of $2\frac{3}{4}$ " vacuum flanges with viewports (Refer to the 3 memos to Brad Maker dated January 23, February 6 and February 23, 1989) on several Bldg. 343 Test Requests.

The mode of failure for the blank flanges, regardless of size, is the assembly bolts would stretch causing gas to vent through the gasket. On several tests, a linear displacement transducer was used to detect any growth of the flange at test pressure, which proved minimal.

The flanges with Pyrex viewport of course failed at much lower pressures than the blank leaked. It should be emphasized that the failure pressure was very much dependent on the condition of the glass (i.e. scratches or blemishes). Further recommendation for their use are detailed in Engineering Safety Note ENW 89-901.

Mail Station L- 373

Ext: 2-9596

January 27, 1988

TO: Chuck Borzileri
FROM: Matt Traini
SUBJECT: PRESSURE TESTING OF "CONFLAT" VACUUM FLANGES

The purpose of this memo is to document information on test results pertaining to knife-edge type vacuum ("conflat") flanges when used in positive pressure situations.

These components are known to be used in pressure systems throughout the laboratory and because commercial manufacturers offer no pressure (only vacuum) data, it became necessary to perform a series of tests in order to establish guidelines to be followed when using vacuum flanges for pressure requirements.

The nature of these tests evolved as a result of Building 343 Test Request No. 6196. The customer requested us to pressure test a gas sample bottle that consisted of a 1-1/3" Ø vacuum flange welded to a valve. This assembly was then threaded to the sample bottle. The area of concern was the weld integrity between the flange and valve and the pressure at which the flange would leak or fail. Therefore, test requests were generated internally in order to obtain this information. These results will be explained later in this report.

The results summarized in this document were comprised of three separate Building 343 Test Requests: T.R. #6202 tested the weld integrity between the conflat flange and valve. T.R. #6226 determined at what pressure a conflat flange will begin to leak. The purpose of T.R. #6196 was to proof-test the gas sample bottle assembly. Figures 1, 2 and 3 illustrates each of these arrangements.

All tests were performed using knife-edge "conflat" flanges and copper gaskets. Tests performed on 1-1/3" Ø flanges used #8-32 bolts and were torqued to 70 in-lbs. (5.8 ft-lbs.). The 2-3/4" Ø flanges used 1/4-28 bolts and were torqued to 192 in-lbs. (16 ft-lbs.). An anti-seize lubricant ("Silver Goop") was used on all threads.

Each test was performed using helium. New gaskets and bolts were used for each run. Results are summarized below.

T.R. #6202

The purpose of T.R. #6202 was to test the weld joint between the valve and flange and to determine the weakest point in the assembly. The flange tested was an MDC Model No. F133000 (1-1/3" Ø blank flange). The valve that was threaded and then welded to the flange was a Whitey "DK" series shut-off valve, Model No. SS-14DKM4 rated for 3,000 psi.

Testing procedure included pressurizing flange/valve assembly and then isolating the flange from the valve and checking leak pressure across the valve stem.

Five assemblies were tested. In all cases except one, the vacuum flange was the first to fail. The average pressure where leakage occurs for the tests performed was at 10,970 psi, with a range of 10,150 to 12,700 psi. With the flange isolated from pressure, leakage at the valve stem occurred at an average of 12,200 psi, with a range of 9,700 to 13,400 psi. This valve confirmed an industry standard of a 4 to 1 safety factor on valves.

It should be noted that failure in all cases were not catastrophic, but took the form of small leaks. No failure concerning the welds were noted. The stainless steel bolts used to assemble the flanges stretched 0.010 - 0.020 inches in length under pressure allowing the flanges to separate from each other resulting in leakage at the gasket.

T.R. #6226

The purpose of T.R. #6226 was somewhat similar to T.R. #6202. However, both 1-1/3" Ø and 2-3/4" Ø flanges were tested. Also, tests were made for flanges with stainless steel and Grade 8 alloy bolts in order to make comparisons. In addition, a linear variable differential transformer (LVDT) was used to measure flange movement when subjected to a pressure load. Three tests were performed for each size flange and bolt material in order to obtain an average value.

The 1-1/3" Ø flanges assembled with stainless steel bolts leaked at an average of 15,170 psi. The same size flange assembled with alloy bolts leaked at an average of 14,170 psi.

The 2-3/4" Ø flanges (MDC Model No. F 275000) assembled with stainless steel bolts leaked at an average of 5,050 psi; at 4,860 psi with those assembled with alloy bolts.

The LVDT measured movement in the center of the test flange and ranged from 0.0005 to 0.001 inch at full pressure. It should be noted that a new flange was used for each test to eliminate any cumulative fatigue that may have occurred.


T.R. #6196

The final portion in this series involved proof-testing the gas sample bottles with the valves and flanges in position. The cylinders were a Whitey Part No. 304L-HDF4-500. Their volume was 0.5 liter and a 1800 psi maximum operating pressure. Testing pressure was 2,700 psi. A total of 9 vessels and 5 valve/flange assemblies were tested. An Engineering Safety Note should have accompanied this test request in order to certify these vessels. An identifying T.R. number was etched on each vessel and released to the customer. However, it was made clear that an Engineering Safety Note needed to be provided in order to use the valve/flange assembly with the Whitey vessel for their intended purpose.

Conclusion:

It should be noted that the intention of these tests were to provide guidelines for usage of "conflat" flanges. Any modifications to hardware may alter test results and would require additional engineering and testing. Therefore, it is necessary to understand under what conditions results were derived from and decisions can be made accordingly. It should be further emphasized that failure was not catastrophic, but rather took the form of a small leak resulting from flange bolts stretching and allowing gas to pass between the gasket and "knife-edge" seal.

If there are any questions regarding these tests, please contact me at (415) 422-9596.


Matt Traini
High Pressure Laboratory
Building 343

0264mt

Distribution:

D. Frischknecht	L-373
T. Gates	L-236
D. Holten	L-122
O. Parker	L-373
B. Schleicher	L-122

SUBJECT		SKETCH		JOB NO.		TAG NO. Revision A	
DRAWN BY M. TRAINI		LAWRENCE LIVERMORE LABORATORY UNIVERSITY OF CALIFORNIA		SERIAL NO.		END 92-072	
DATE 23 DEC 87		BUILDING NO. 343		ROOM NO.		Page 6	
APPROVED BY		DATE		JOB ORDER INFORMATION		DELIVER TO	

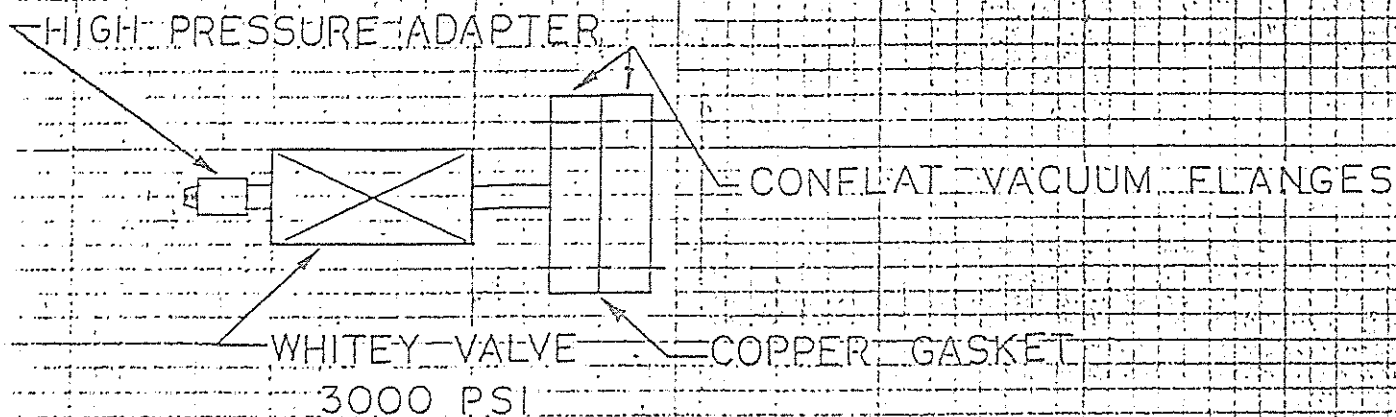


FIGURE 1: VALVE FLANGE ASSEMBLY
(T.R. 6202)

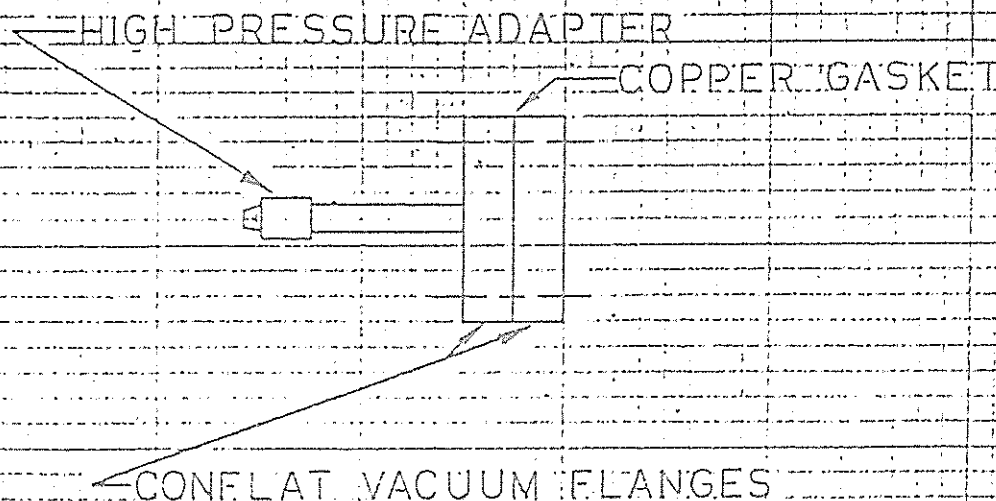


FIGURE 2: FLANGE-BLANK ASSEMBLY
(T.R. 6226)

SUBJECT		SKETCH		JOB NO.		TAB NO. END 92-072	
DRAWN BY M. TRAINI		LAWRENCE LIVERMORE LABORATORY UNIVERSITY OF CALIFORNIA		SERIAL NO.		RECO. Page 7	
DATE 23 DEC 87		BUILDING NO. 343		ROOM NO.		DATE ISSUED	
APPROVED BY		DATE		DELIVER TO		RECO.	


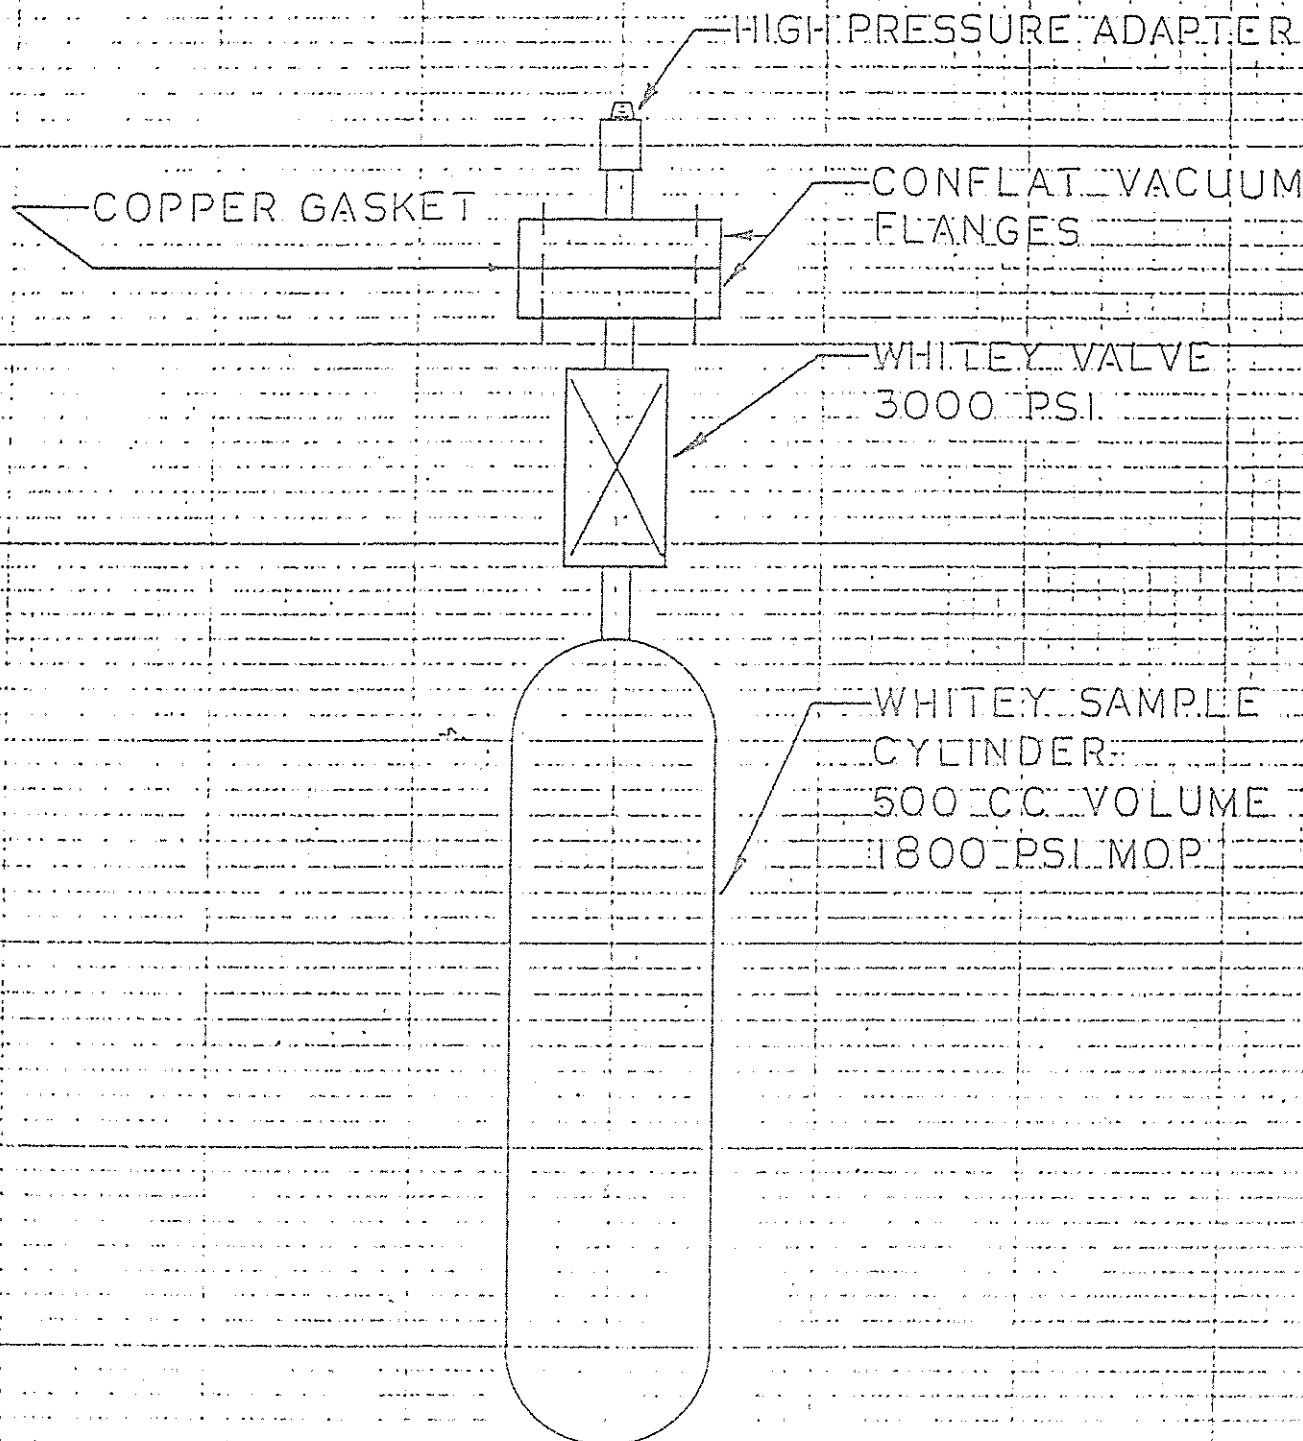


FIGURE 3: GAS SAMPLE BOTTLE
ASSEMBLY (T.R. 6196)

SHEET
NUMBER

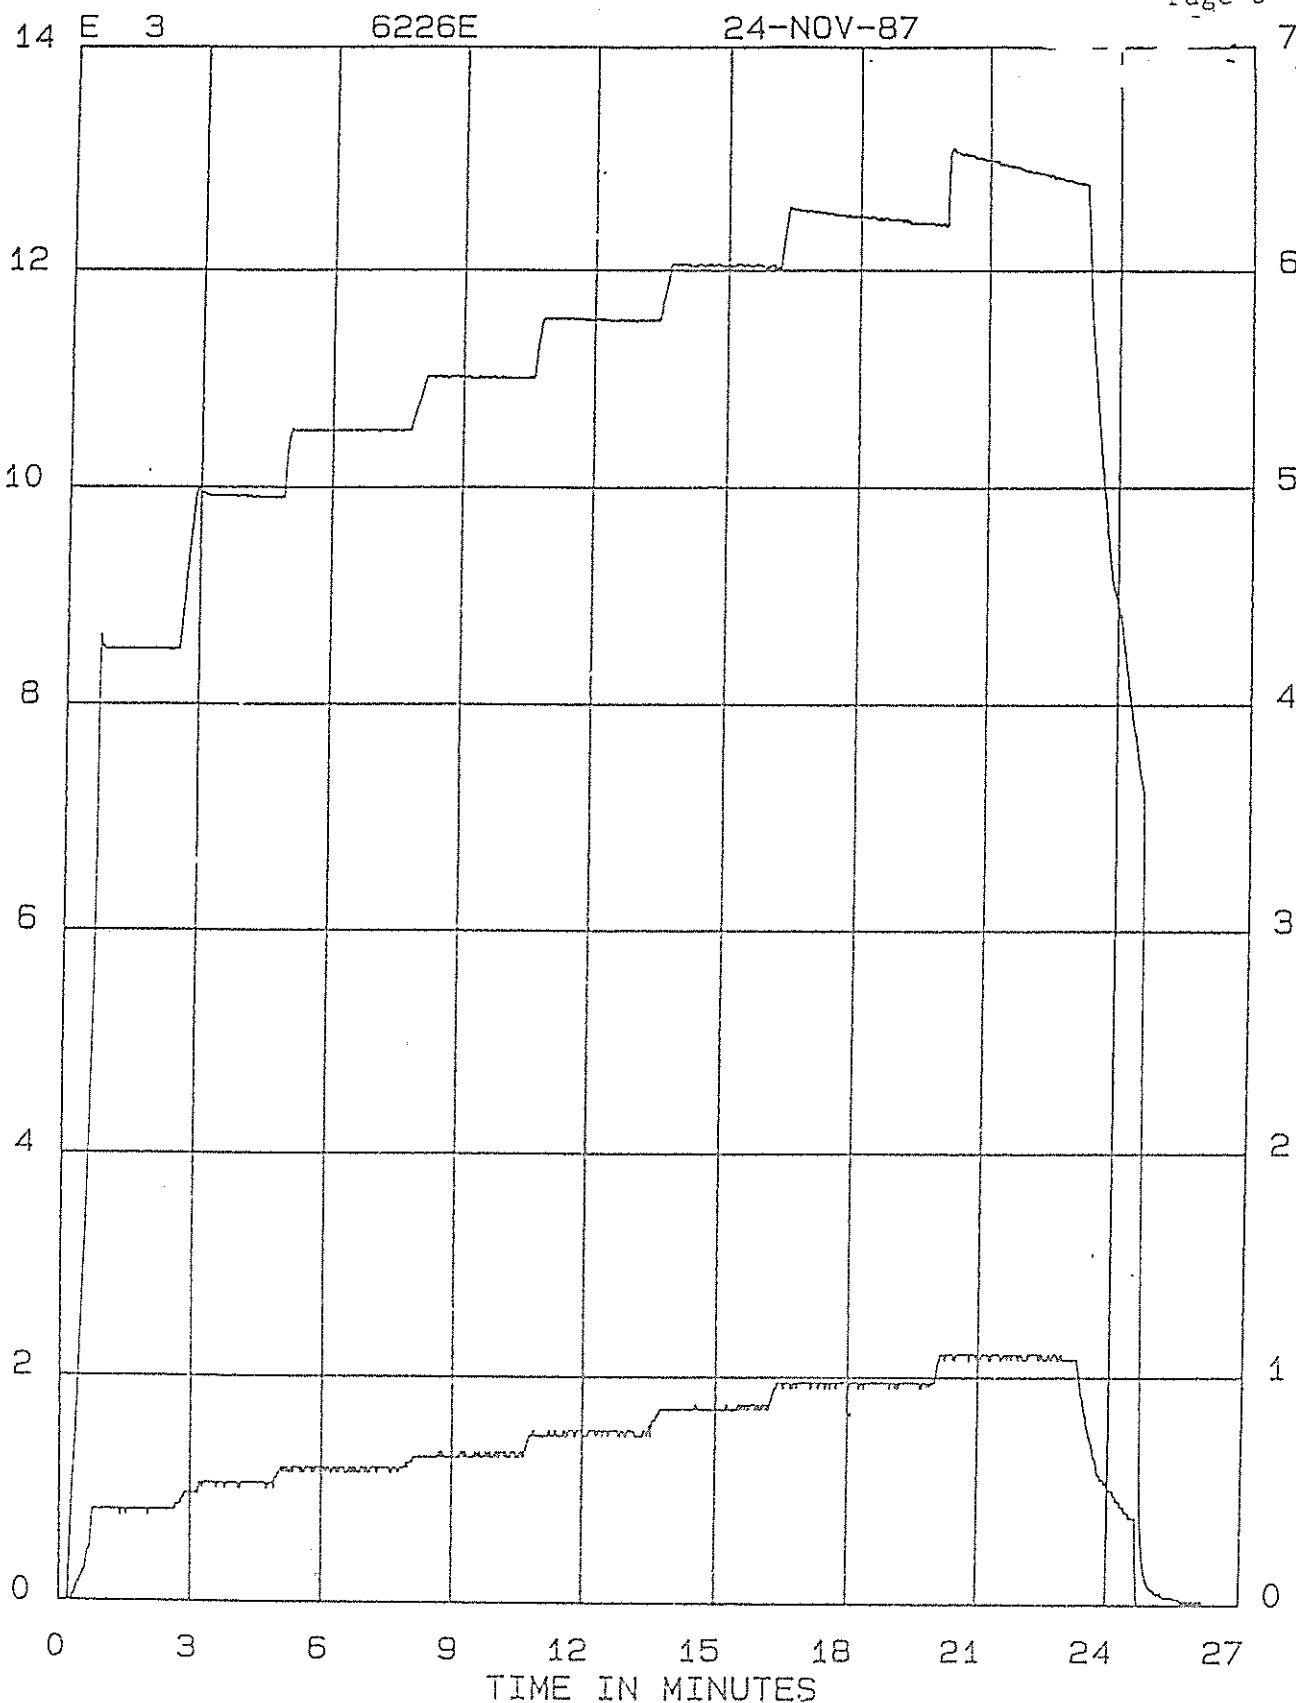

NAME OF EXPERIMENTER

MATT TRAINI

NAME OF OPERATOR

MATT TRAINI

1 PSIG 30K TD

REL MAX= 0.1310E+05

2 MILS LVDT

MAX= 7.000

MIN= 0.0000

Interdepartmental letterhead

Mail Station L-373

Ext: 2-9595

March 31, 1988

TO: Jerry Stapleton

FROM: Matt Traini - High Pressure Laboratory

SUBJECT: PRESSURE TESTING OF 4 5/8" Ø "CONFLAT" VACUUM FLANGES

The following is an explanation of pressure tests performed on 4 5/8" Ø "Conflat" vacuum flanges. These tests are referenced to Bldg. 343 Test Request No. 6408.

Two test assemblies were provided and the flanges were bolted together using 12 point stainless steel capscrews. Each of the vessels were initially hydro tested to 1200 psi and no leaks were present. The purpose for the initial hydro testing was to minimize any catastrophic failure that may have occurred due to the relatively large volume (approximately 2 liter) of the assemblies. In addition, 300 psi NPT fittings were welded into the assemblies (for testing purposes only) and this was also an area of concern. Each assembly was tested separately and initially pressurized to approximately 500 psi. Pressure increased in 50 to 100 psi increments to a maximum test pressure of 1200 psi. These tests are referenced to T.R. 6408B and 6408C.

Following hydro testing the vessels were disassembled and cleaned. They were reassembled using new stainless steel hardware and gaskets and tightened to a specified torque of 9 ft-lbs. Next, they were pressurized with helium in 100 psi increments until a helium mass spectrometer could detect any leaks. Following the series of tests using stainless steel hardware, the vessels were reassembled using grade 8 alloy steel cap screws. They were tightened to a specified torque of 30 ft-lbs. These results are referenced to T.R. 6408D thru 6408H and are detailed at the end of this memo.

It should be noted that no significant conclusions could be drawn when comparing alloy bolts to stainless steel hardware. Past similar tests indicate there is no pressure advantage using one over the other.

New hardware was used for each test and the bolt lengths were measured before and after testing. No increase in bolt length occurred. In addition, the portion of the adapter where the cap was welded on was measured before and after testing. No growth was evident. Refer to the attached data for the pressure/time plots for each test.

University of California

 Lawrence Livermore
National Laboratory

<u>Test No.</u>	<u>Assembly No.</u>	<u>Fluid</u>	<u>Hardware</u>	<u>Leakage / Range</u>
6408B	#1	Water	SST	No leaks @ 1200 psi
6408C	#2	Water	SST	No leaks @ 1200 psi
6408D	#1	Helium	SST	930 psi / 10^{-6} Torr
6408E	#2	Helium	SST	500 psi / 10^{-6} Torr
6408F	#2	Helium	SST	525 psi / 10^{-6} Torr
6408G	#1	Helium	Alloy	550 psi / 10^{-6} Torr
6408H	#2	Helium	Alloy	900 psi / 10^{-6} Torr

If there are any questions regarding these tests, please contact me at
Ext. 2-9596.

Matt Traini
Matt Traini
High Pressure Laboratory

0281mt

Distribution:

C. Borzilleri L-384
D. Holten L-122
O. Parker L-373
B. Schleicher L-122

Interdepartmental letterhead

Mail Station L- 373

Ext: 2-9596

January 23, 1989

TO: Brad Maker
FROM: Matt Traini
High Pressure Laboratory

SUBJECT: PRESSURE TESTING OF CONFLAT FLANGES WITH PYREX VIEWPORTS

The purpose of this memo is to summarize work performed under Bldg. 343 Test Request No. 6709.

Five VARIAN conflat flanges, 2 3/4" diameter, with Pyrex windows were to be pressurized with helium gas to failure. Pressure was increased in 10 psi increments with a one minute hold at each pressure. The flanges were assembled using copper gaskets. Following manufacturer's specifications, the bolts were tightened to 16 ft-lbs. New bolts and gaskets were used for each flange.

The test results are summarized in the table below.

<u>Flange Number</u>	<u>Failure Pressure, psig</u>	<u>Nature of Glass</u>
6709 A	108 psig	Normal
6709 B	39	2 Scratches
6709 C	140	Normal
6709 D	116	Normal
6709 E	54	1 Scratch

If there are any questions regarding these tests, please contact me at Ext. 2-9596.

Matt Traini
Matt Traini
High Pressure Laboratory

0358mt

Distribution:
D. Holton
O. Parker

University of California

 Lawrence Livermore
National Laboratory

Interdepartmental letterhead

Mail Station L- 373

Ext: 2-9596

February 6, 1989

TO: Brad Maker, L-125
FROM: Matt Traini
SUBJECT: Testing of MDC flanges with Pyrex viewports

The purpose of this memo is to summarize work performed under Bldg. 343 Test Request No. 6726.

Three MDC "conflat" flanges, part number VP-150 (2 3/4" diameter), were pressurized with helium gas to failure. Pressure was increased in 10 psi increments with a 30 second hold at each pressure. The flanges were assembled using copper gaskets and bolts were tightened to 16 ft-lbs. New hardware was used on each of the flanges and threads were lubricated with "Silver Goop". Tests were similar to those performed previously under Test Request No. 6709 where VARIAN flanges were used.

Mention should be made regarding the types of failure. With the VARIAN flanges (TR 6709), the viewports fractured into small pieces. With the MDC flanges (TR 6726), the viewport actually separated intact from the seam of the flange.

Test results for the MDC flanges are summarized in the table below:

<u>FLANGE NUMBER</u>	<u>FAILURE PRESSURE</u>
6726A	190 psig
6726B	110 psig
6726C	141 psig

If there are any questions regarding these tests, please contact me at ext.2-9596.


Matt Traini

Matt Traini
High Pressure Laboratory

Distribution:

D. Holten L-122
O. Parker L-373

University of California

 Lawrence Livermore
National Laboratory

Interdepartmental letterhead

Mail Station L- 373

Ext: 2-9596

February 23, 1989

TO: Brad Maker

FROM: Matt Traini

SUBJECT: PRESSURE TESTING OF CONFLAT FLANGES WITH PYREX VIEWPORTS

The purpose of this memo is to summarize work performed under Bldg. 343 Test Request No. 6741.

It was requested that three VARIAN flanges were pressurized with helium gas to failure. The flanges were 2-3/4" diameter. These tests were similar to those previously performed under Test Requests 6709 and 6726. The purpose for testing this set of flanges was to determine if there had been any degradation caused by cleaning the flanges in a caustic solution. The flanges were assembled using copper gaskets and the hardware used for assembly were lubricated with "Silver Goop". The bolts were tightened to 16 ft-lbs. All three viewports fractured into small pieces upon failure.

Results for this series of tests as well as previous ones are summarized in the table below.

<u>FLANGE NUMBER</u>	<u>NATURE OF GLASS</u>	<u>FAILURE PRESSURE, PSIG</u>
6741 A	Normal	180 psig
B	Normal	250
C	Normal	150
6726 A	Normal	190 psig
B	Normal	110
C	Normal	114
6709 A	Normal	108 psig
B	2 Scratches	39
C	Normal	140
D	Normal	116
E	1 Scratch	54



Matt Traini
High Pressure Facility

0359mt

Distribution:

D. Holten L-122

O. Parker L-373

University of California

 Lawrence Livermore
National Laboratory

This additional information regarding the proof and burst testing of new 8" O.D. vacuum "conflat" flanges with viewports is being added to the existing engineering note. These series of tests were performed under Bldg. 343 Test Request number 1489 by Roger Carnahan.

Viewports from 2 manufacturers' were supplied for the tests and results are summarized below:

<u>Flange Mfg.</u>	<u>Proof Pressure/Hold Time</u>	<u>Burst Pressure</u>
MDC	15 psig/15 minutes	
Varian	15 psig/15 minutes	
MDC		54 psig

Two of the flanges were taken to proof test pressure with no leaks and the third to burst. Upon burst, the entire viewport remained intact and separated from the seam of the flange. This is the same type of failure that had occurred on the smaller 2 ³/₄" diameter flanges (MDC) with viewports (see pg. 12).

It should also be stated that as an added safety precaution, a lexan shield should be installed over the viewport in the event of a failure.

ASME Code Qualification of ConFlat Flanges

Overview

ConFlat (CF) flanges or their equivalent are available from a number of vacuum supply companies (i.e. MDC Vacuum, Kurt J. Lesker Co., NorCal, etc.). They have been designed for vacuum service only. It has been standard practice at a number of facilities, Jefferson Lab being one, however, to use these fittings as pressure fittings where high purity and extremely cold ($<4.5\text{K}$) (non permanent or semi permanent) connections are required. Figure 1 gives a cutaway view of a typical CF connection. The all metal leak tight seal is achieved by extruding the gasket between the opposing conical sealing (knife) edges. This causes the gasket material to flow against the capture rings. The extruded gasket material fills small imperfections in the sealing surfaces and provides a reliable leak tight seal. It is commonly thought that the actual sealing surfaces are the knife edges. We will assume, however, that they are the outer capture rings.

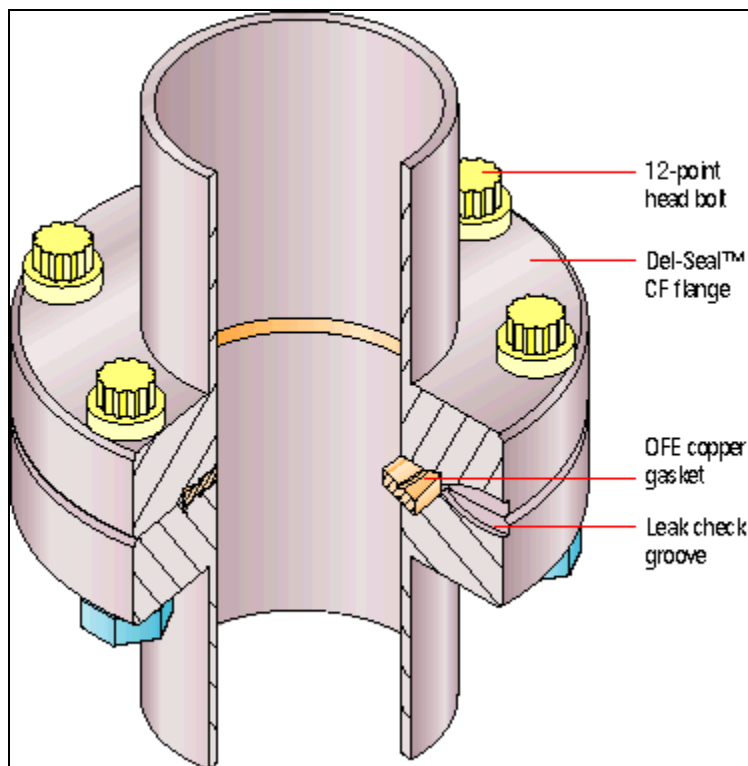


Figure 1: Cutaway view of CF assembly. From MDC Vacuum Catalog.

The purpose of this technical note is to qualify as much as possible the CF flange connection for use in ASME (B31.3 and Section VIII Div. 1) coded pressure systems and components. Pressure design of flanges and blanks is covered in Appendix 2 of the ASME Boiler and Pressure Vessel Code Section VIII Div. 1. Other necessary

information is contained in Appendix S of the same code. The B31.3 code, for process piping, (Section 304.5) refers to this section of the B&PV code for flange design.

UG-34 Eq (2) of Section VIII gives the required minimum thickness for a blank flange or flat cover as

$$t = d \sqrt{CP/SE + 1.9Wh_g / SEd} \quad (1)$$

where

C is a constant determined by flange geometry. Using sketch (k) it is 0.3

d is the mean gasket diameter

P is the pressure loads

W is the gasket seating bolt load

E is a casting factor

h_g is the

A slight modification of this equation should be used. The pressure seal should be taken as the gasket OD. The gasket seating moment arm h_g is determined as the radial distance from the bolt circle to the knife edge. The first term in the radical considers on the pressure load. The second term considers only the moment from the bolt load. Thus, the minimum thickness of the CF flange is given by

$$t = \sqrt{CPd_g^2 / SE + 1.9Wh_g d_k / SE} \quad (2)$$

where

d_k is the knife edge diameter

d_g is the gasket ring diameter

An expression for stress can easily be derived from the above equation for a given thickness. The standard CF flange available from MDC can be supplied with a certificate of conformance. This states that the material is SST 304. From Table 1A in Section II of the ASME B&PV code, the maximum allowable stress for SST 304 plate is 20 ksi.

Test Procedure

Materials

The following is a list of the tools and materials used to assemble the CF test joints.

1. Torque wrenches
 - 1.1. Kobalt 3/8 drive (Ser#1001500784)
 - 1.2. KD 1/4 drive (Ser#991135747)
2. Snap-On torque tester (Ser # 0699800012) calibrated.
3. Transducer Techniques load cell Model THC-7.5K-S Serial # 114657
4. Test flanges were supplied by MDC vacuum
5. Gaskets (both OFHC copper and aluminum) were supplied by Kurt J. Lesker Co.
6. Loctite 51609 anti-seize
7. Bolting hardware (18-8 SST nuts and bolts no washers were used)
 - 7.1. 1.33" nominal flange hardware from Kurt J. Lesker Co.

- 7.2. 2.75" and 2.125" flange hardware from Kurt J. Lesker Co. (1/4-28 x 1.25 12pt)
- 7.3. 13.25" flange hardware from York Bolt (3/8-24 x 3.5 HHCS)
- 7.4. All other flanges (5/16-24 x 3.5 12pt) from Kurt J. Lesker Co.

Torque wrench calibration

It is recognized that there will be significant error in the actual bolt torque for an individual technician using a given torque wrench. In an effort to minimize this error and quantify it, the technician performing all assembly work and torque wrench calibration/force measurements was kept constant. Both torque wrenches are "snap" type. The assembly technician and torque wrenches were checked for consistency using the Snap-On torque tester at multiple torque settings. Table A1 in Appendix A summarizes the measurements made to check the consistency of the small 1/4 inch drive KD torque wrench and technician. Measurements were made at 10, 20, 30, 40, and 68 inch pounds. Similar measurements were also taken with the Kobalt 3/8 in drive torque wrench at larger values of torque. These data are shown in Table A2.

While it is necessary to understand the consistency of the actual torque, it is most important to know the actual force (bolt load) relative to a given torque setting. The total bolt load will be required in the analysis of the flange and fastener stress. It is common practice to determine the force on a bolt assembly using the standard equation for fastener torque τ

$$\tau = kFD \quad (3)$$

Where

k is a coefficient determined by friction geometry etc.

F is the bolt load force

D is the nominal outer diameter of the fastener

The coefficient k is nominally taken as 0.2 in many conditions and Machinery's Handbook suggests 0.18 for lubricated assemblies. For our case, however, it is proper to measure the value of k where possible. Indeed it is even better to measure the absolute force applied by the fastener for a given torque setting. The load cell was used to determine the actual force applied by a given fastener for a given torque setting. Figure xxx shows the technique. Measurements were performed with both torque wrenches at several torque settings. These data are summarized in Table A3. Accounting for torque consistency and load cell error, the data indicate that a conservative error for absolute force applied is 10%.

CF test assemblies

The test assemblies were made by assembling two blank CF flanges with a copper gasket (from Lesker) and, when available, aluminum gaskets (from Lesker). The flanges were tightened using the cross flange pattern recommended in the MDC catalog until the flanges were visibly close to "metal to metal". At this point, the fasteners were torqued in a clockwise pattern until the flange faces were visibly "metal to metal". This is the

standard practice of many of the technicians at Jefferson Lab. No washers were used on any assembly. In all cases, a backing wrench was applied to the nut and the torque wrench was applied to the bolt head (see Figure xxx).

The torque was incrementally increased in 5 inch lb steps when using the smaller KD wrench and in 1 ft lb steps when using the Kobalt wrench. The fasteners were tightened at a given torque setting in repeated patterns until no rotation was felt. If needed the torque setting was increased and the tightening pattern repeated. The final torque setting was recorded. In the case of the smaller flange sizes, many assemblies were measured. In all cases (with the exception of the aluminum seals), at least 2 assemblies were measured. No measurable deviation in torque required to complete the assembly was found at any flange size, thus it is felt that more test assemblies are unnecessary. Assemblies using “plate nuts” (Ref 1) were also tested.

After the initial gasket crushing assembly, the bolts were loosened to less than finger tight and retightened following the same procedure above so that the flanges were again “metal to metal”. This was done to determine the gasket sealing torque. This is the final gasket seating torque required to maintain a leak tight connection. The final gasket seating torque values were also recorded.

Results

The torque values required to make each CF connection are summarized in Table xxx. The 1.33 and 2.75 (aluminum gasket only) inch CF joints were assembled using the KD torque wrench. All other assemblies were performed with the Kobalt torque wrench.

Nominal Flange Size (in)	Torque Cu (in lb)	Torque Al (in lb)
1.33	40	31
2.125	163.2	n/a
2.75	163.2	67
3.375	197.5	142
4.5	217.7	142
4.625	190.4	n/a
6	217.7	163.2
8	246.8	146.8
10	260	163.2
13.25	330	n/a

Table 1: Torque values required to make CF assemblies "metal to metal"

Analysis

Flanges

The actual force required to make the CF seal was determined from the final torque wrench setting and the data in Table A3. It is clear from equation (2) that an expression

for stress in the flange may easily be derived. Table xxx shows the final bolt loads for copper gasket assemblies.

Fasteners

Appendix A

This appendix contains the torque wrench consistency and calibration data.

Table A2 : Torque consistency data for 1/4 inch drive KD torque wrench all data are in inch pounds

Torque Setting (in-lb)	10	20	30	40	68
Data	12.7	24	32	40.1	66.1
	12.7	22	29.4	39.9	66.9
	13.9	19.2	29.1	39.6	66
	13.9	20.8	28.4	38.5	67
	11.1	19.3	29.4	40.4	67.7
	11.6	20.3			66.9
	12.1				
	11.1				
	12.6				
	11.1				
	10.6				
Average	12.12727	20.93333	29.66	39.7	66.76667
Std dev	1.137621	1.823915	1.370401	0.731437	0.631401

Table A3: Torque consistency data for 3/8 inch drive Kobalt torque wrench all data are in inch pounds

Torque Setting (ft-lb)	10	11	12	13	15	16	17	18	19	20
Data (in-lb)	117	131	142	168	182	191	219	236	243	250
	121	131	144	162	182	196	215		247	256
	115.2	138	146	162	189	195	217		247	260
	117.2	140	138	159	178.3	198	212		247	252
	117.2	142	146.6	161.7	194	196	212		243	245
		140		150	179	195	209		243	241
				151	188				243	252
				148						
				150						
				156						
				157						
Average	117.5	137	143.3	156.8	184.6	195	214	236	245	251
Std deviation	2.119	4.8	3.48	6.423	5.829	2.3	3.7		2.1	6.4

Table A3: Torque wrench setting to absolute force calibration data

Torque wrench setting to force calibration										
Excitation voltage is 10V 2mV per V full scale (7500 lb)										
Kobalt wrench										
Torque setting	Torque Setting	Actual torque	Error	Load Cell readout	Fastener OD	Force	Coefficient	Error	Error	Error
(ft lb)	(in-lb)	(in-lb)	Torque (in-lb)	(mV)	(in)	(lb)	K	K	K	Force (lb)
10	120	118	2	5.35	0.313	2006.25	0.19	0.01	0.01	112.0501604
11	132	137	5	5.81	0.313	2178.75	0.20	0.01	0.01	134.479561
12	144	143	3	6.34	0.313	2377.5	0.19	0.01	0.01	133.3982048
13	156	157	6	6.77	0.313	2538.75	0.20	0.01	0.01	161.0098237
14	168	168	0	7.57	0.313	2838.75	0.19	0.01	0.01	150.1375589
15	180	185	6	7.95	0.313	2981.25	0.20	0.01	0.01	178.7758102
16	192	195	2	8.76	0.313	3285	0.19	0.01	0.01	176.4593824
17	204	214	4	9.75	0.313	3656.25	0.19	0.01	0.01	207.1244576
18	216	236	0	10.45	0.313	3918.75	0.19	0.01	0.01	203.6701817
19	228	245	2	10.86	0.313	4072.5	0.19	0.01	0.01	214.4773258
20	240	251	6	11.77	0.313	4413.75	0.18	0.01	0.01	264.8551591
21	252	252	0	12.28	0.313	4605	0.17	0.01	0.01	263.3922946
22	264	264	0	12.74	0.313	4777.5	0.18	0.01	0.01	270.6087294
25	300	300	0	13.66	0.313	5122.5	0.19	0.01	0.01	273.7707319
27	324	324	0	14.36	0.313	5385	0.19	0.01	0.01	280.1371736
27	324	324	0	9.16	0.375	3435	0.25	0.01	0.01	136.5651042
KD wrench										
	20	21	2	0.87	0.313	326.25	0.21	0.02	0.02	44.40902721
	30	30	1	1.41	0.313	528.75	0.18	0.01	0.01	34.08049604
	40	40	1	1.91	0.313	716.25	0.18	0.01	0.01	43.95591393
	50	50	0	2.47	0.313	926.25	0.17	0.01	0.01	53.70698531
	68	67	1	3.41	0.313	1278.75	0.17	0.01	0.01	78.73891481



Heat Exchangers, ASME Pressure Vessels & Tanks

HYDROSTATIC TEST CERTIFICATION

DATE: 5-27-2010

The following reference pressure vessel(s) were successfully hydrostatically tested in accordance with the ASME Code Section VIII, Section 1.

JOHANSING JOB #: 6528

CUSTOMER: Lawrence Bereley National Labs

PURCHASE ORDER #: 6922618

NATIONAL BOARD #: N/A

VESSEL SERIAL #: 6528

GAUGE #: 3259

GAUGE RANGE: 0-2000

GAUGE CALIBRATION DATE: 5-6-2010

HYDROSTATIC TEST PRESSURE: 550 PSI


VESSEL DESCRIPTION: 1 1/4" OD 304 S/S Pipe Spool x 10.0"

OTHER: _____

2955 Ford St.
Oakland, CA 94601

(510) 261-1800
FAX (510) 261-1870

CERTIFIED BY: 
Quality Control Manager, Johansing Iron Works, Inc.

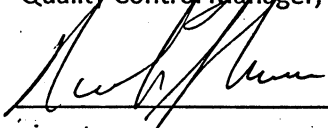WITNESS BY:  Name: Derek Shuman
signature print name
Tom Miller

TITLE: _____